



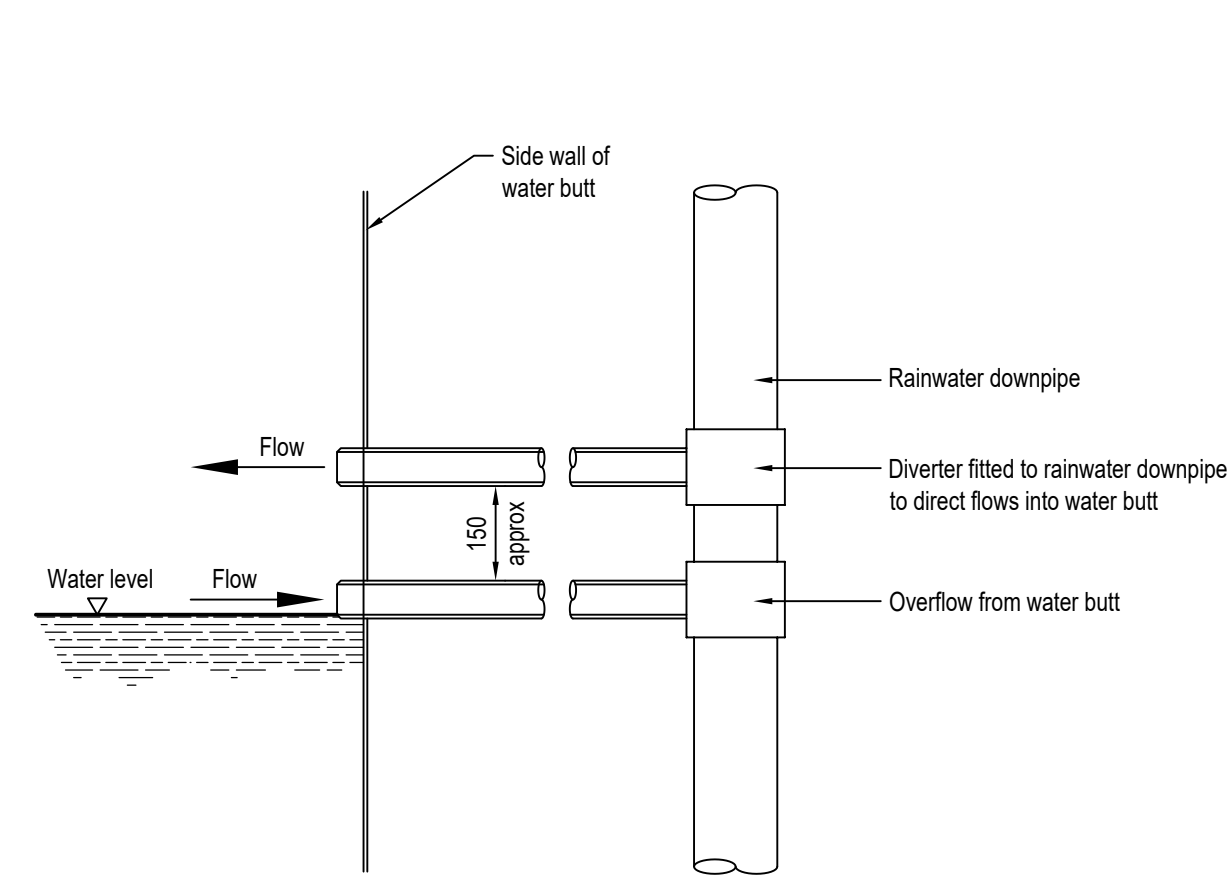


TYPICAL SECTION THROUGH RAINWATER DIVERTER

TO BE FITTED TO EACH RAINWATER BUTT
Scale 1:10

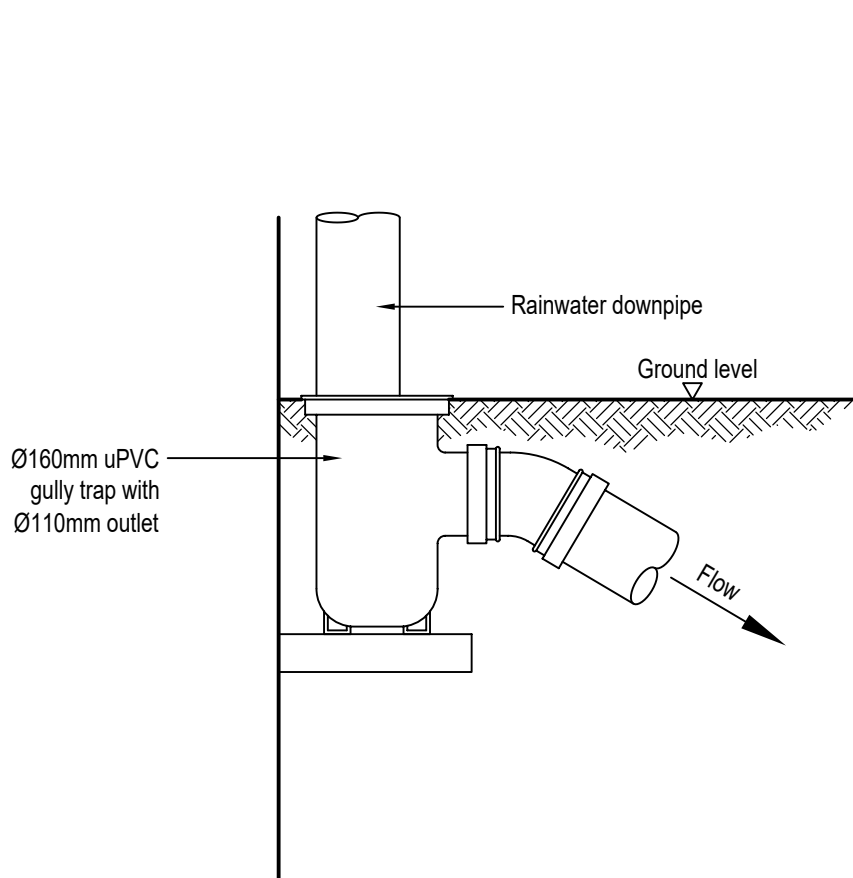



TYPICAL DETAIL AT BASE OF RAINWATER DOWNPIPES

FOR USE WHERE DOWNPIPES DO NOT DISCHARGE INTO WATER BUTTS FIRST
Scale 1:10

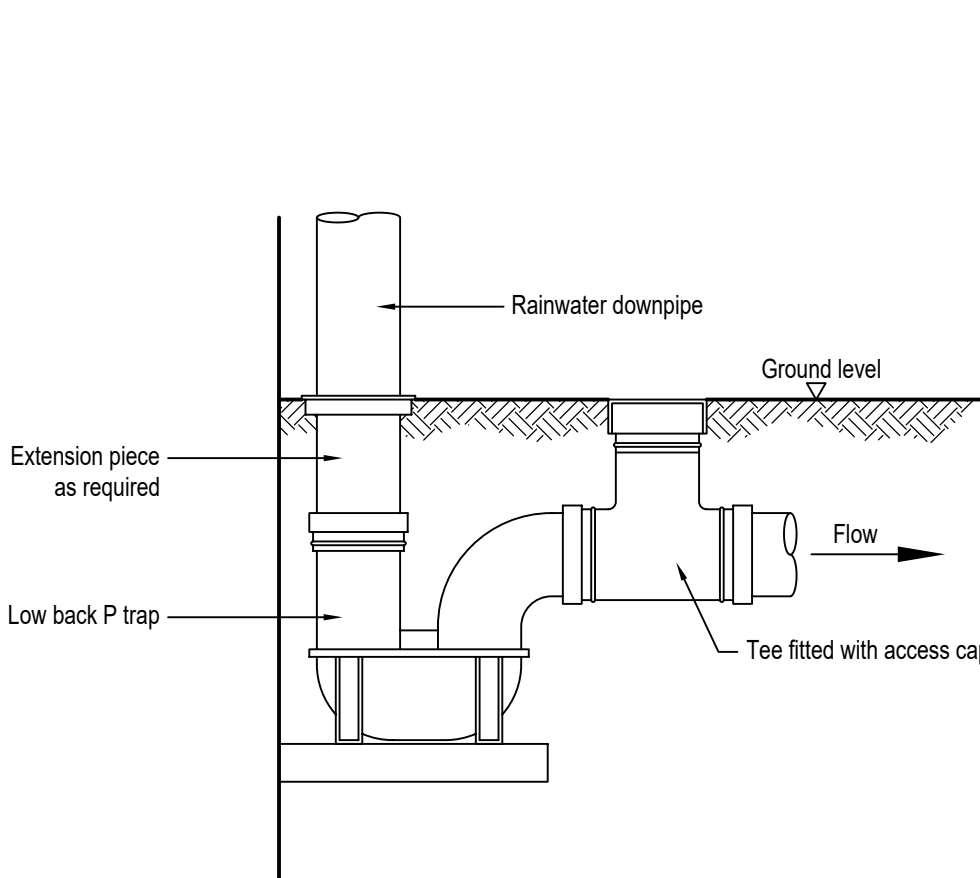

TYPICAL DETAIL AT BASE OF RAINWATER DOWNPIPES


FOR USE WHERE DOWNPIPES DO NOT DISCHARGE INTO WATER BUTTS FIRST
Scale 1:10

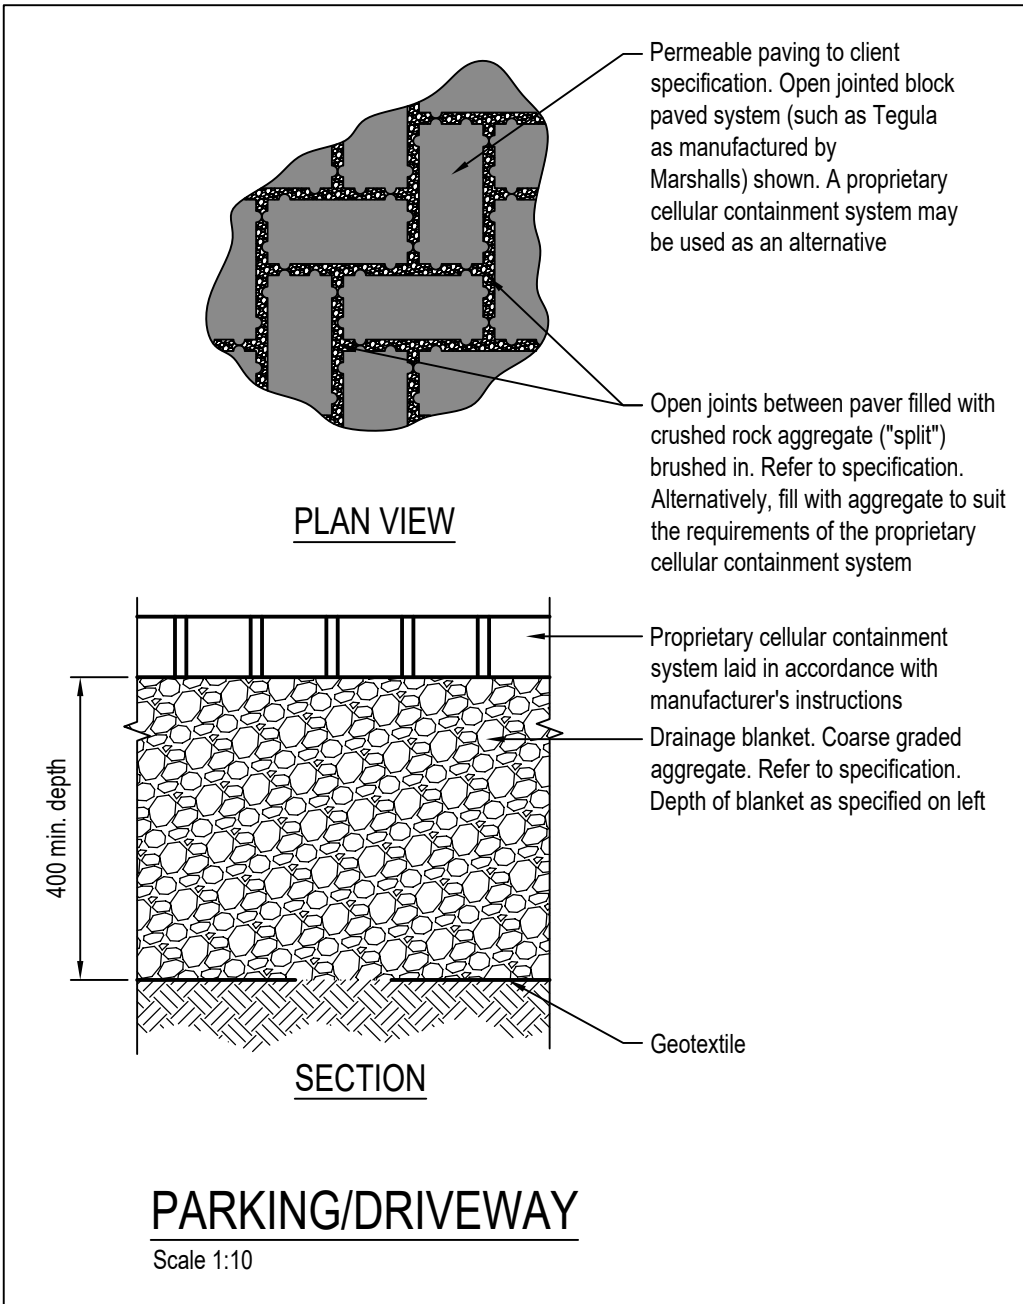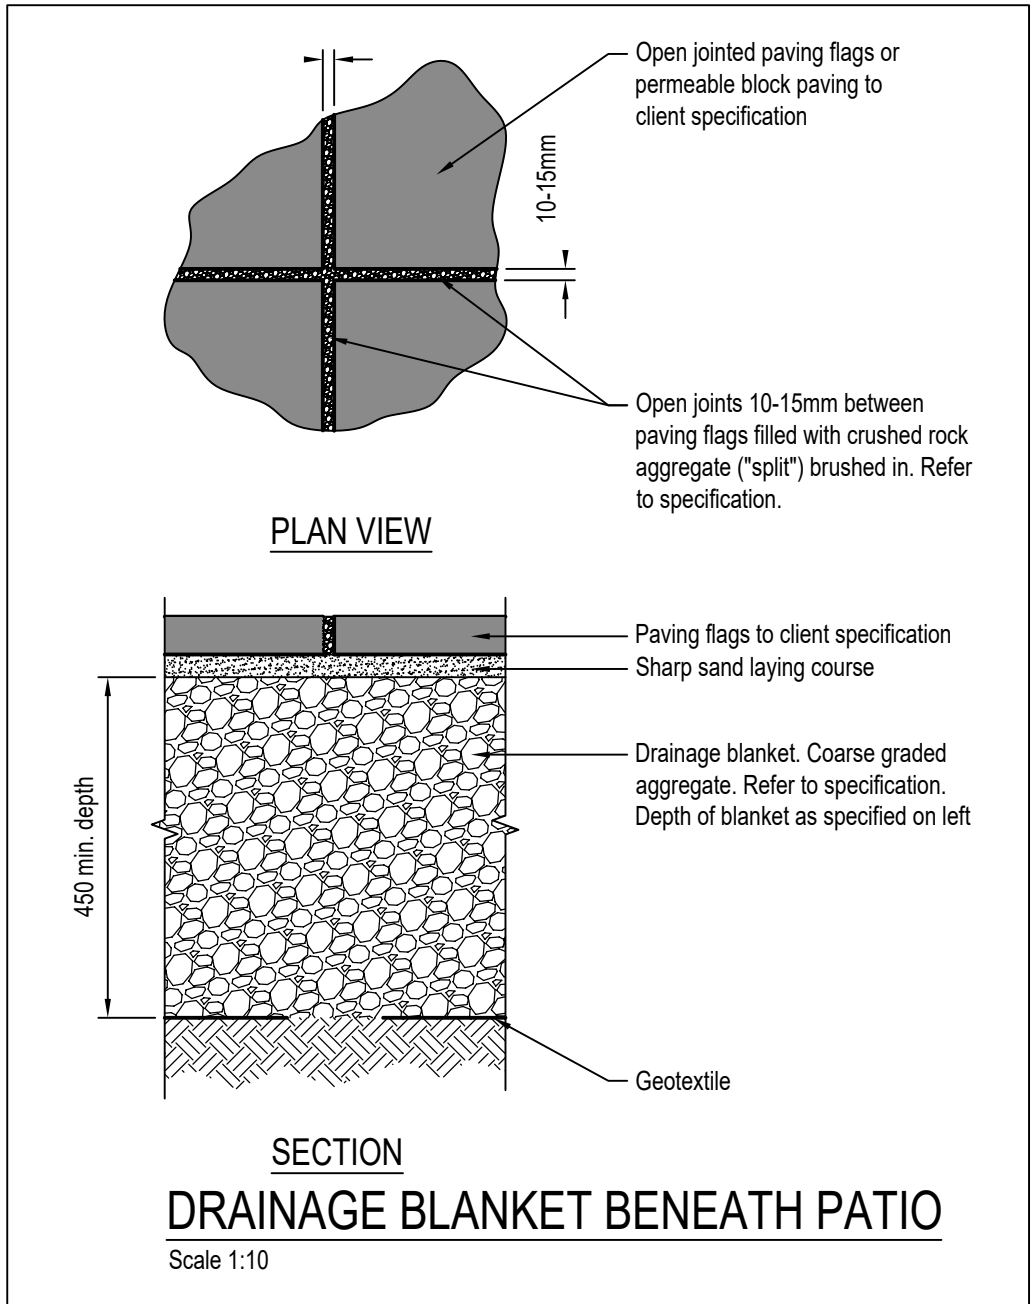



- SPECIFICATION FOR PERMEABLE SURFACING**
- Permeable paving: minimum thickness 50mm in pedestrian only areas and 65mm in driveway and vehicle crossover
 - Laying course and jointing aggregate: 2-6.3mm granite grit to BS EN 13242 lightly compacted. Re-grit 3 months after 3-4 months and upon final completion to allow for settlement.
 - Coarse graded aggregate: 4-20mm to BS EN 13242 lightly compacted in 150mm layers
 - Geotextile: Needle punched polypropylene across base and taken up sides of excavation
 - Soft spots in formation to be removed and backfilled with SHW Clause 805 Type 3 material to BS EN 13242

- GRANULAR BEDDING REQUIREMENTS - RIGID PIPES:**
- PIPE INTERNAL DIAMETER:
UP TO 100mm: 6 or 10 single size or 10 to 5 graded
100mm to 150mm: 10 or 14 nominal single size or 14 to 5 graded
150mm to 225mm: 10, 14 or 20 nominal single size or 14 to 5 graded or 20 to 5 graded
225mm to 525mm: 10, 14, 20 or 40 nominal single sized crushed rock or 14 to 5 graded or 20 to 5 graded or 40 to 5 graded
600mm and above: 14 to 5 graded or 20 to 5 graded or 40 to 5 graded
- GRANULAR BEDDING REQUIREMENTS - FLEXIBLE PIPES:**
Either 6mm single size granular material or graded granular material 5mm minimum 10mm maximum size
- PIPE STRENGTH AND BEDDING COMBINATIONS:**
For concrete pipes with 0.9m to 1.2m cover to crown of pipe use Concrete Class M or Class H with Class A bedding
For concrete pipes with 1.2m to 2.5m cover to crown of pipe use Concrete Class M or Class H with Class B bedding
For clay pipes with 0.9m to 1.2m cover to crown of pipe use ES/C with Class A bedding
For clay pipes with 1.2m to 2.5m cover to crown of pipe use ES/C with Class B bedding


- PIPE BEDDING NOTES:**
- Bc = Outside diameter of pipe
DN = Internal diameter of pipe
- DIMENSION Y: EITHER:** 1/6 of external pipe diameter OR 100mm under barrels and 50mm under sockets, whichever is greater. Maximum 400mm
- Where a concrete surround is specified, Flexcell or equivalent compressible material is to be provided in the concrete surround at each pipe joint. Minimum thickness of compressible material 25mm
- Selected as dug fill material or granular material free from stones larger than 40mm nominal size, lumps of clay over 100mm timber, frozen material and vegetable matter
- Granular bed (refer to granular bedding requirements)
- Concrete Grade ST4

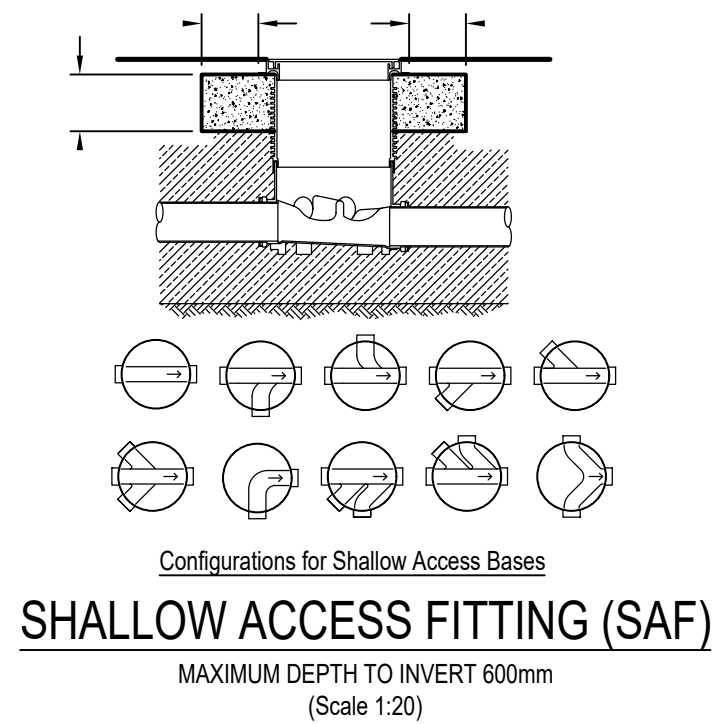


- NOTES FOR POLYPROPYLENE INSPECTION CHAMBERS AND SHALLOW ACCESS FITTINGS:**
- Provide a 100mm thick bed of selected as-dug or granular material. If ground conditions are unstable use a 150mm thick bed of either ST4 or GBN designated mini in-situ concrete, placing the pre-formed polypropylene base of the chamber in position whilst the concrete is still wet so that it may adopt the shape of the base of the chamber
 - Polypropylene inspection chamber shaft sections are to provide set inverts using standard height shaft sections or are to provide inverts as specified by site cutting shaft sections to required height
 - 150mm minimum thickness of selected as-dug or granular material shall be placed and rammed firmly around pipes and fittings until adequate support is achieved
 - A 150mm minimum thickness grade ST4 concrete collar shall be provided around the top of the shaft to provide seating for cover and frame where the chamber is located in non-adopted hard landscaped areas or in soft landscaped areas where there is access by construction traffic
 - A minimum 150mm thick grade ST4 concrete bed and surround is required where chambers are located in soft landscaped areas subject to construction traffic
 - Proprietary inlet adaptors are to be used to connect 100mm diameter pipes to 150mm diameter inlets
 - Unused inlets are to be sealed off using proprietary blanking-off plugs or plates

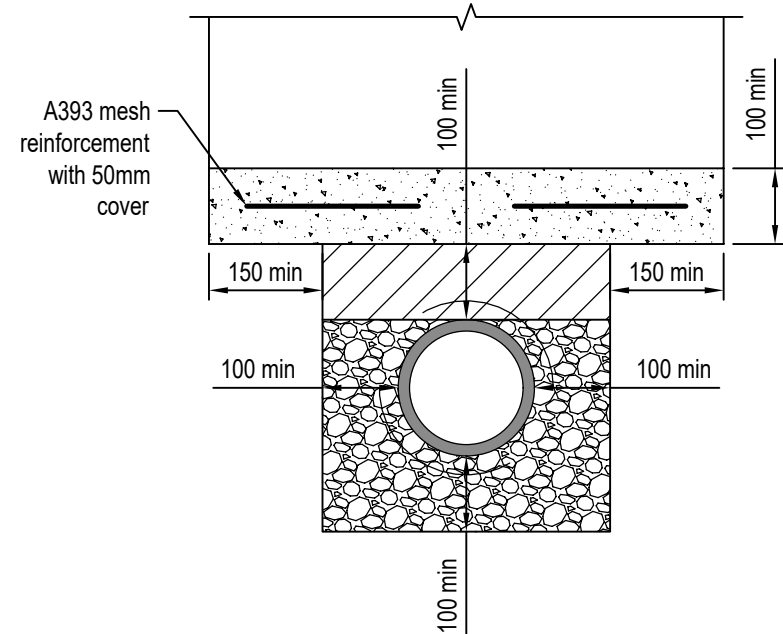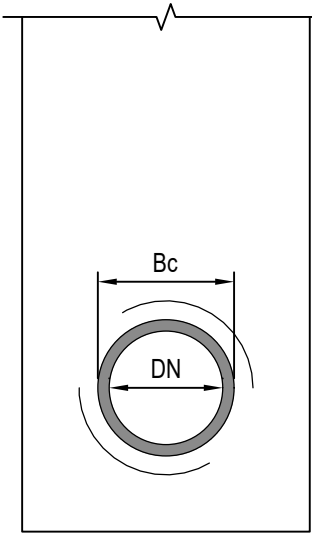


PIPE BEDDING FOR FLEXIBLE PIPES WITH LESS THAN 0.9m COVER BENEATH DRIVEWAYS AND VEHICULAR ACCESSES
(Scale 1:10)

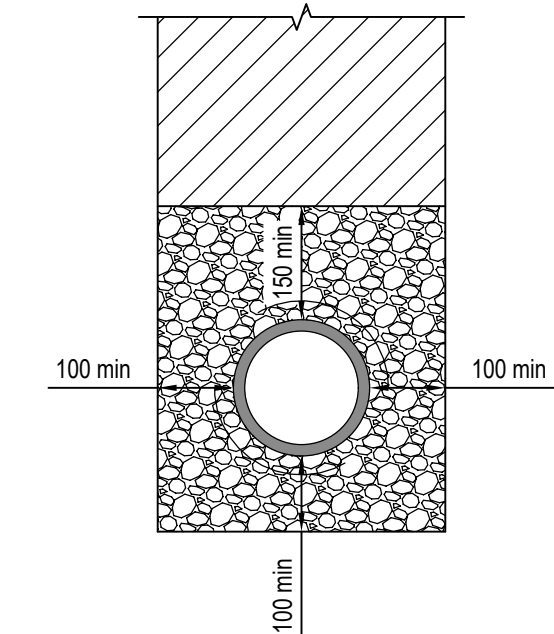

PIPE BEDDING FOR FLEXIBLE PIPES WITH MORE THAN 0.9m COVER BENEATH DRIVEWAYS AND VEHICULAR ACCESSES
(Scale 1:10)

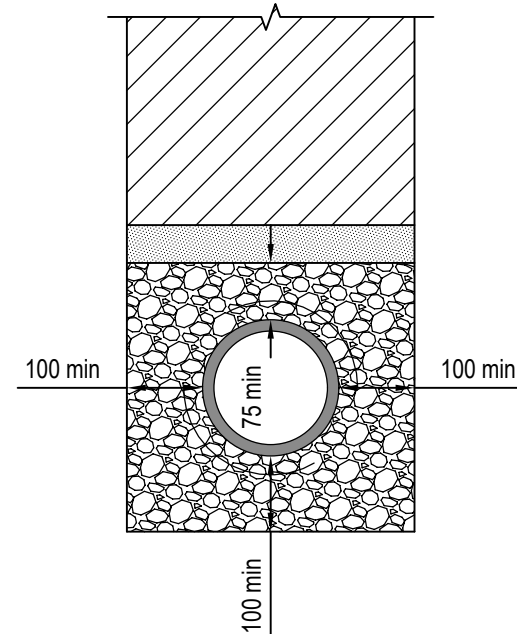


PIPE BEDDING FOR FLEXIBLE PIPES WITH LESS THAN 0.6m COVER BENEATH AREAS WITHOUT VEHICULAR ACCESS
(Scale 1:10)

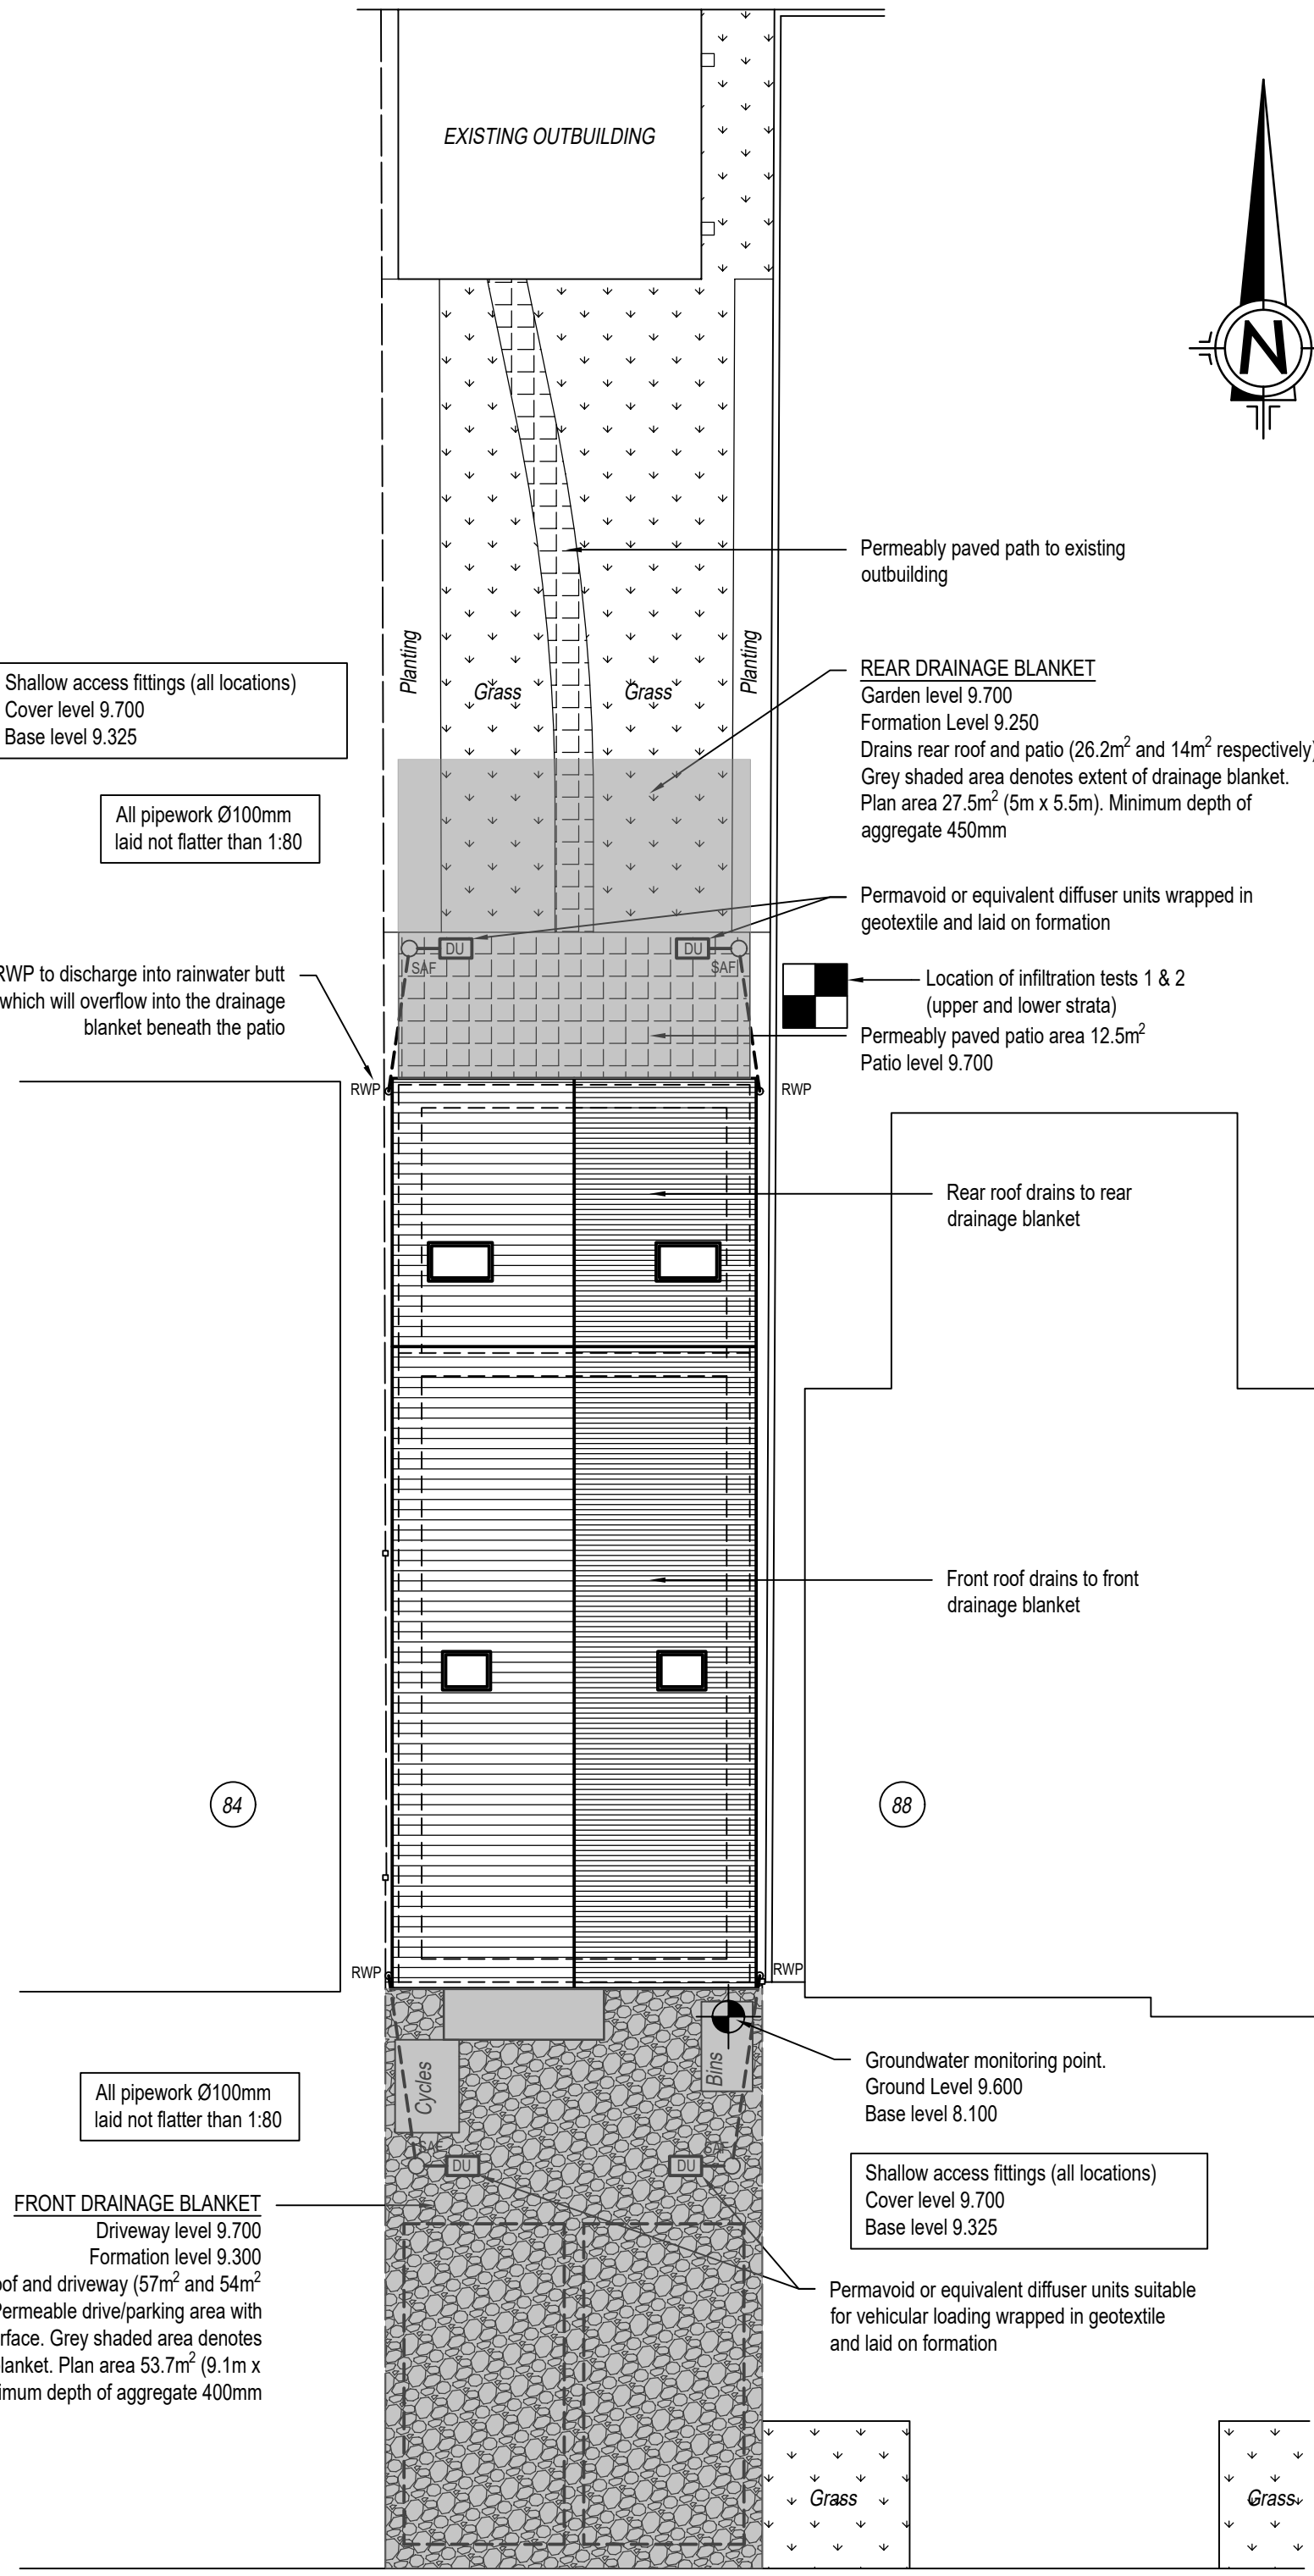

PROPOSED SURFACE WATER DRAINAGE

Scale 1:100

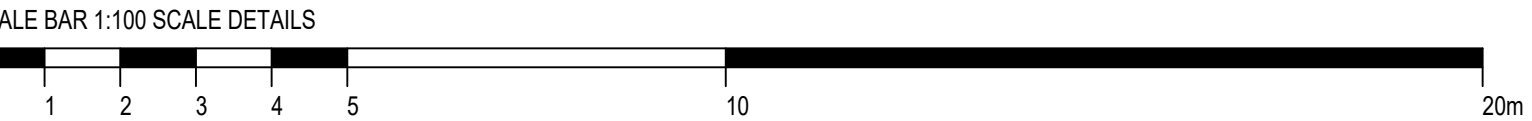

Revisions:
PL1: PL2 19.02.2025: Draft issue
PL3 23.06.2025: Issued for planning
Revised to reflect Arun DC drainage engineer comments

ORIGINAL DRAWING SIZE: A1

HERBERT STUMPP
LIMITED
Civil & Structural Engineers
Party Wall Surveyors
07921 214399
Email: info@herbertstump.co.uk

Project
86 ANCTON WAY, BOGNOR REGIS, WEST SUSSEX PO22 6JP

PROPOSED SURFACE WATER DRAINAGE

- NOTES**
- TAKE TIME TO READ AND UNDERSTAND THIS DRAWING AND FAMILIARISE YOURSELF WITH ITS CONTENT. DO THIS IN GOOD TIME BEFORE COMMENCING ANY WORK, AND IN THE EVENT OF ANY QUERY, REFER TO HERBERT STUMPP LTD IN A TIMELY MANNER.
 - Do not scale from this drawing for construction or fabrication. Work to figured dimensions only
 - This drawing is to be read in conjunction with all other relevant Architects and Engineer's drawings
 - The contractor's attention is drawn to the drawing status and is to note the following:
PLANNING (PL): The drawing is for planning only
TENDER (T): The drawing is for pricing purposes only
PRELIMINARY (P): The drawing has not received technical approval from the relevant approving authority
CONSTRUCTION (C): The drawing is for construction
THE CONTRACTOR MUST BE AWARE THAT ANY WORKS CARRIED OUT BASED UPON DRAWINGS MARKED TENDER OR PRELIMINARY ARE CARRIED OUT AT THE CONTRACTOR'S OWN RISK
 - The Construction (Design and Management) Regulations 2015 apply to this project. It is the client's responsibility to ensure that the requirements of the Regulations are satisfactorily addressed prior to commencement of any works.

Drawing status
PLANNING
Scale
PP
Drawing Number
006
Date
January 2025
Scale
As shown
Revision
PL 3