


GENERAL NOTES

1. THIS DRAWING TO BE READ IN CONJUNCTION WITH THE RELEVANT CONTRACT DOCUMENTATION AND DRAWINGS
2. THE LIGHTNING PROTECTION SHALL PROVIDE A MAXIMUM RESISTANCE OF 10 OHMS.
3. THE LIGHTNING PROTECTION INSTALLATION SHALL COMPLY IN FULL WITH BS 6651 : 1990.
4. THE EARTHING INSTALLATION SHALL COMPLY IN FULL WITH BS 7430, 1998.
5. MECHANICAL, ELECTRICAL, EARTHING & LIGHTNING PROTECTION SERVICES SHALL ALL BE INSTALLED IN ACCORDANCE WITH THE DESIGN GUIDE
6. EARTH PIT INSTALLATIONS SHALL BE A MINIMUM OF 3m APART.
7. ON COMPLETION OF THE ELECTRICAL WORKS, TEST CERTIFICATES SHALL BE PROVIDED FOR THE FOLLOWING :
i) ELECTRICAL INSTALLATION
ii) LIGHTNING PROTECTION SYSTEM
8. THE ELECTRICAL INSTALLATION SHALL COMPLY IN FULL WITH BS 7671 : 2008.

CONTRACTOR TO CARRY OUT HAND DUG TRENCH ACROSS EQUIPMENT C/L TO LOCATE ALL EXISTING SERVICES PRIOR TO MECHANICAL EXCAVATIONS. WHERE NECESSARY SERVICES ARE TO BE DIVERTED BY SERVICE PROVIDER PRIOR TO COMMENCEMENT OF WORKS

NOTE: ALL EXPOSED EARTH TAPE TO BE PVC SHEATHED

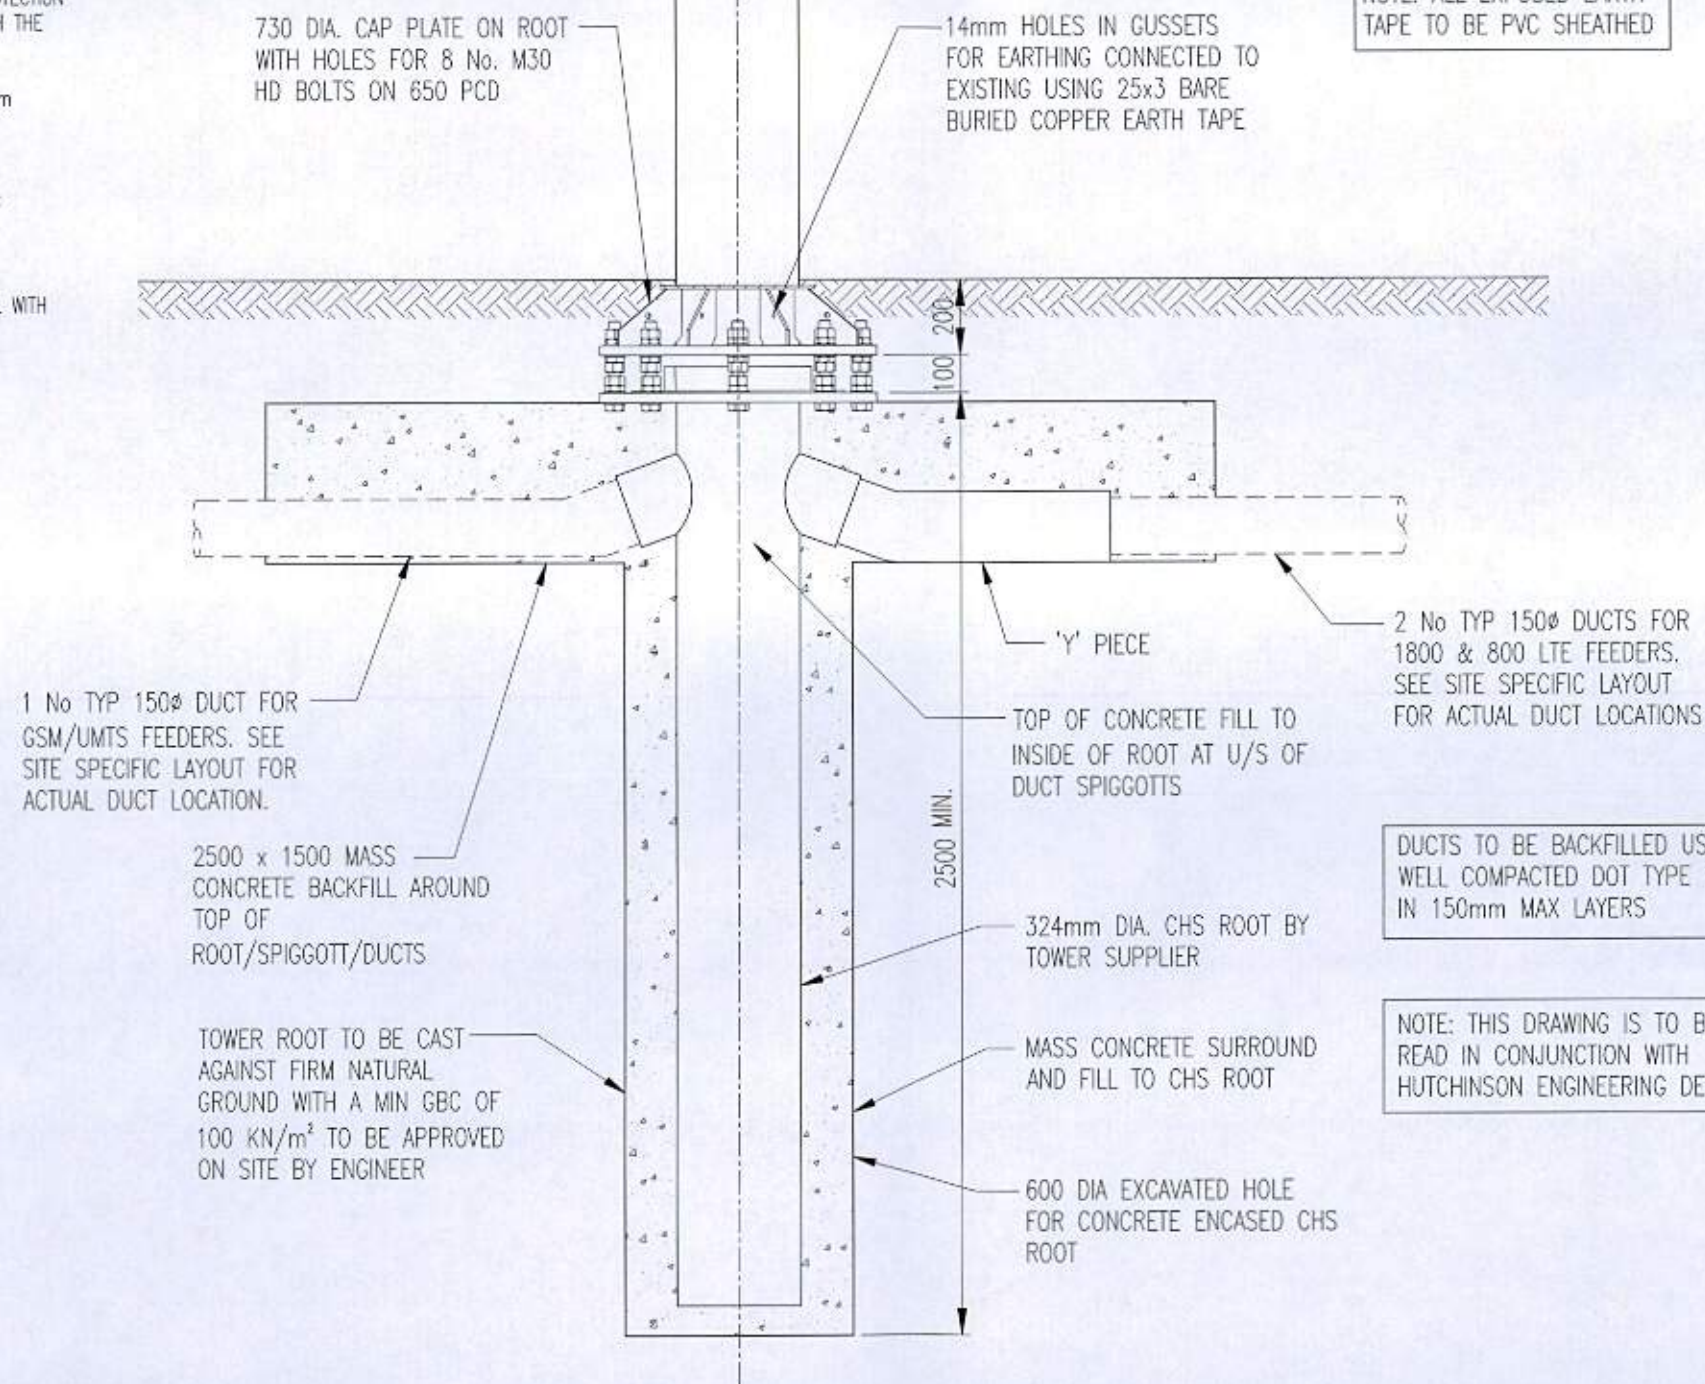

SECTION THROUGH PHASE 5 ROOT

SCALE 1:20

CONCRETE NOTES

1. ALL MATERIALS AND WORKMANSHIP TO BE IN ACCORDANCE WITH BS:8110 PARTS 1&2 - THE STRUCTURAL USE OF CONCRETE.
2. CONCRETE TO BE GRADE FND3
3. REINFORCEMENT TO BE PLACED IN ACCORDANCE WITH BS:8110.
4. CEMENT CONTENT NOT LESS THAN 330Kg/m, FREE WATER CEMENT RATIO NOT MORE THAN 0.50.
5. COVER TO REINFORCEMENT TO BE 50mm, UNLESS NOTED OTHERWISE.
6. ALL EXPOSED CONCRETE TO BE CHAMFERED 25x25mm
7. ALL DUCTS TO BE LAID WITH DRAW CORDS TO ENABLE CABLES TO BE PULLED THROUGH DUCTS
8. ALL DUCTS TO BE SEALED WITH EXPANDING FOAM AFTER CABLE INSTALLATION
9. WHERE POSSIBLE ALL DUCTS TO BE LAID WITH A MINIMUM BEND RADIUS OF 450mm

10. TELECOM AND POWER DUCTS TO BE KEPT SEPARATE				
D	EQUIPMENT LOCATION CORRECTED TO SUITE LPA COMMENTS	13.07.15	MAS	REM
C	CONSTRUCTION ISSUE	08.07.15	L.P.	REM
B	PRELIMINARY ISSUE FOR PLANNING	07/07/15	MAS	REM
No.	Revision	Date	By	ckd

MBNL

6 Anglo Office Park
67 White Lion Road
Amersham
HP7 9FB

Tel: 01494 762 923
Email: info@mbnl.co.uk



WHP Wilkinson Helsby
Unit 17B, Astley Way Industrial Estate
Astley Lane, Swillington, Leeds
LS26 8XT

Tel: 0113 3023550 Fax: 0113 2876834
e-mail: info@wilkinson-helsby.co.uk

Site Name & Address:

ELMER ROAD BOGNOR REGIS WEST
SUSSEX PO22 6DZ

Title:

PROPOSED TELECOMMUNICATIONS
STREETWORKS UPGRADE
TOWER ROOT DETAILS

Purpose of Issue:

CONSTRUCTION

Drawing No:

71562 - 10

Cell No:

71562

MBNL Ref:

ARN008

Issue:
D

Scale: AS STATED
Dm: MAS

Ch'd: REM Date: 05/06/15
App: REM Date: 05/06/15