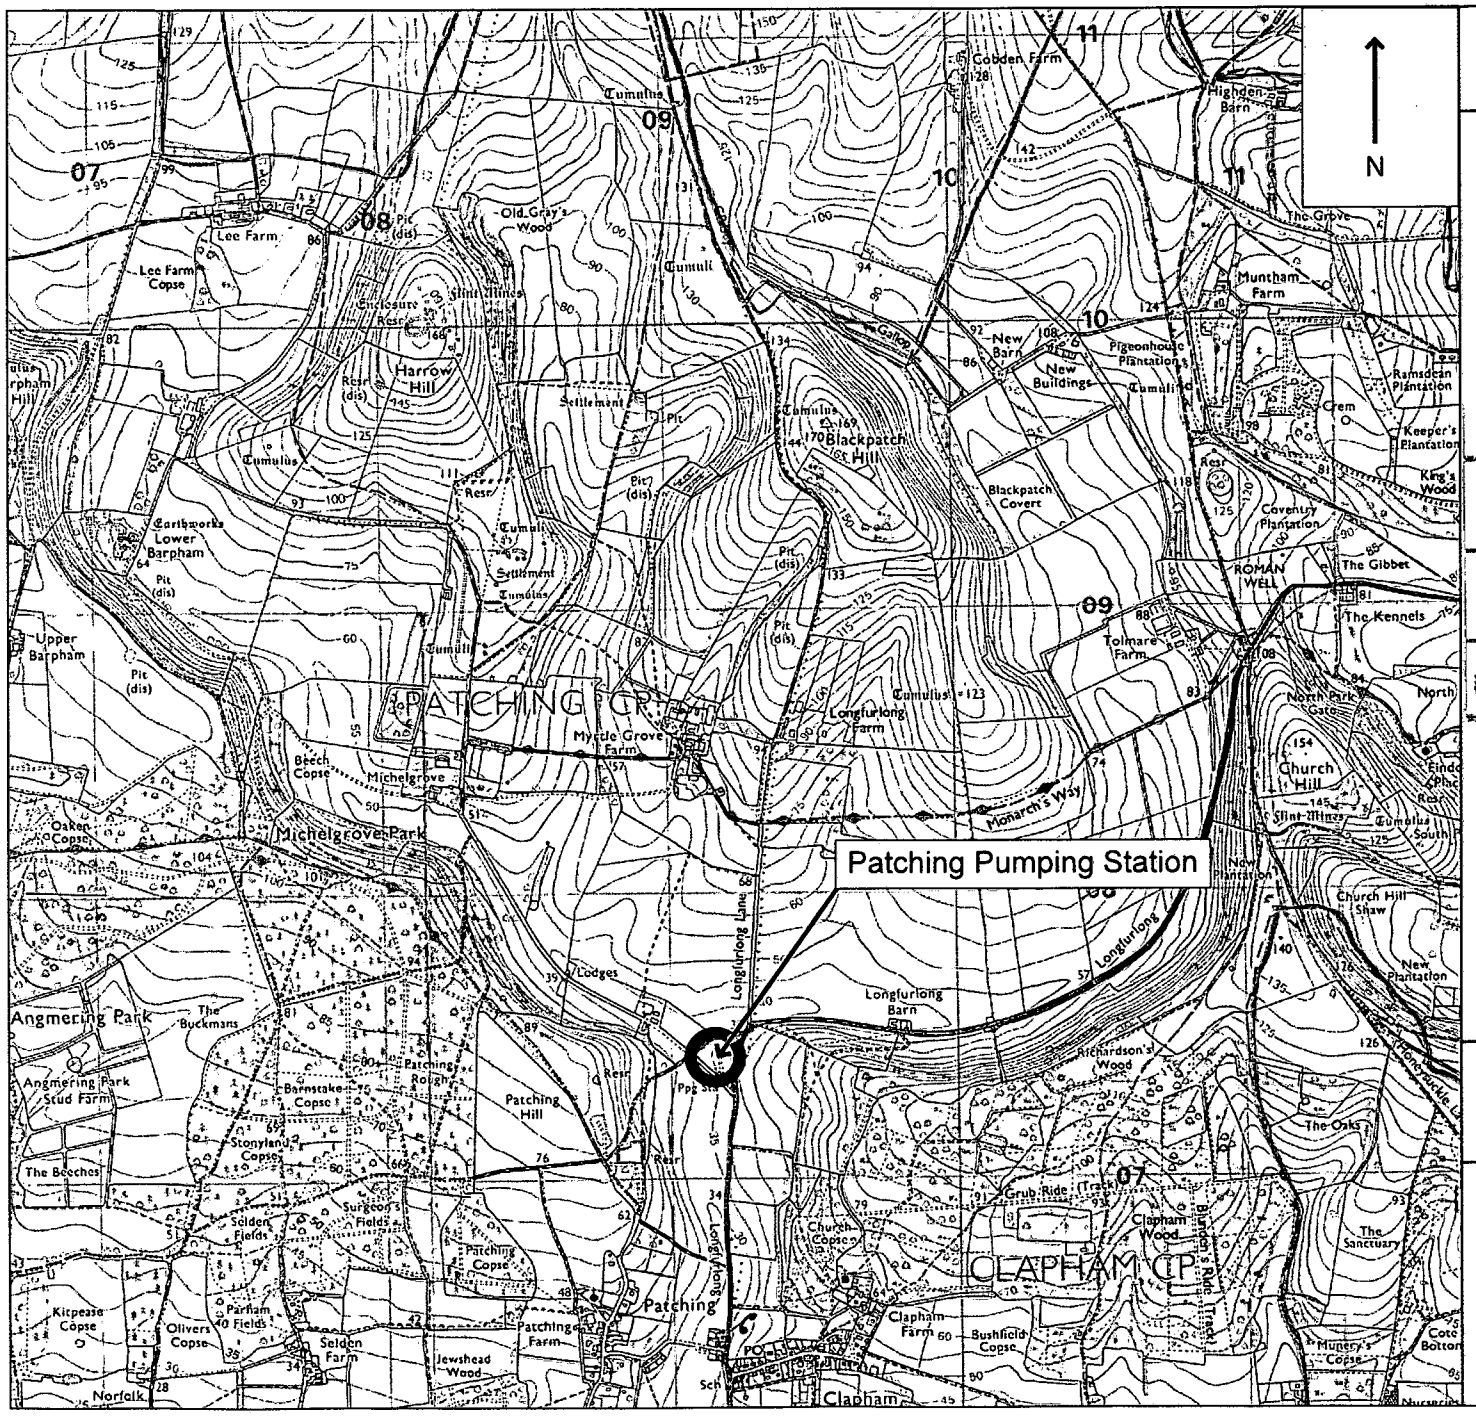

ATKINS

Southern Water

ARUN DISTRICT COUNCIL

No.	PA	13	06	

RECEIVED 30-5-06

Scale:

0 500 1000km

Title: Disinfection Kiosk Gas and UV Chlorination System

Figure 1: Location Plan - Patching Pumping Station

Client: Southern Water

ARUN DISTRICT COUNCIL:PA/13/06/ 30/05/2006