


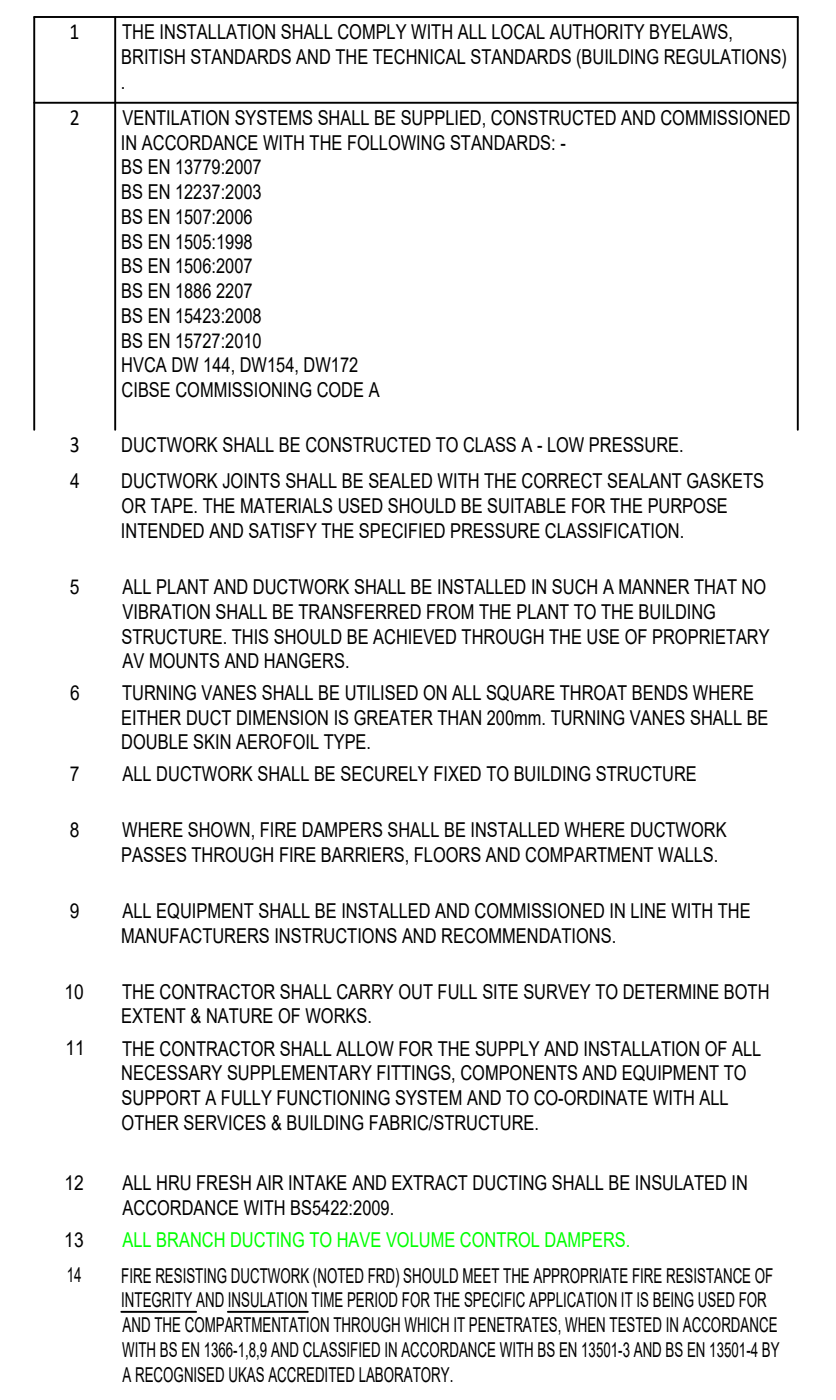

- | | | | | |
|---|--|----------|----|------|
| E | FAN TAGS ADDED AT KITCHEN DSR AND WC | 16.09.25 | KM | NMGN |
| | KITCHEN AND LUNDRY LAYOUTS ADDED TO SUIT SPECIALIST PROPOSALS | 06.06.25 | KM | NMGN |
| C | DUCTS RISE FROM BELOW, TO ROOF | 19.06.25 | KM | NMGN |
| | HRUs REMOVED FROM CORRIDORS. ENSURE SPIRAL DUCTWORK REPLACED WITH PVC FIRE DAMPERS ADDED. COWL POSITIONS UPDATED TO SUIT ROOF LAYOUT | 21.02.25 | KM | NMGN |
| A | ISSUED FOR TENDER | 16.09.24 | KM | NMGN |

Figure 1.1 shows two graphical scales. The top scale is labeled '1:100' and has major markings at 0, 1m, 2m, 3m, 4m, 5m, 6m, 7m, 8m, and 9m. The bottom scale is labeled '1:1' and has major markings at 0, 10, 20, 30, 40, 50, 60, 70, 80, and 90.