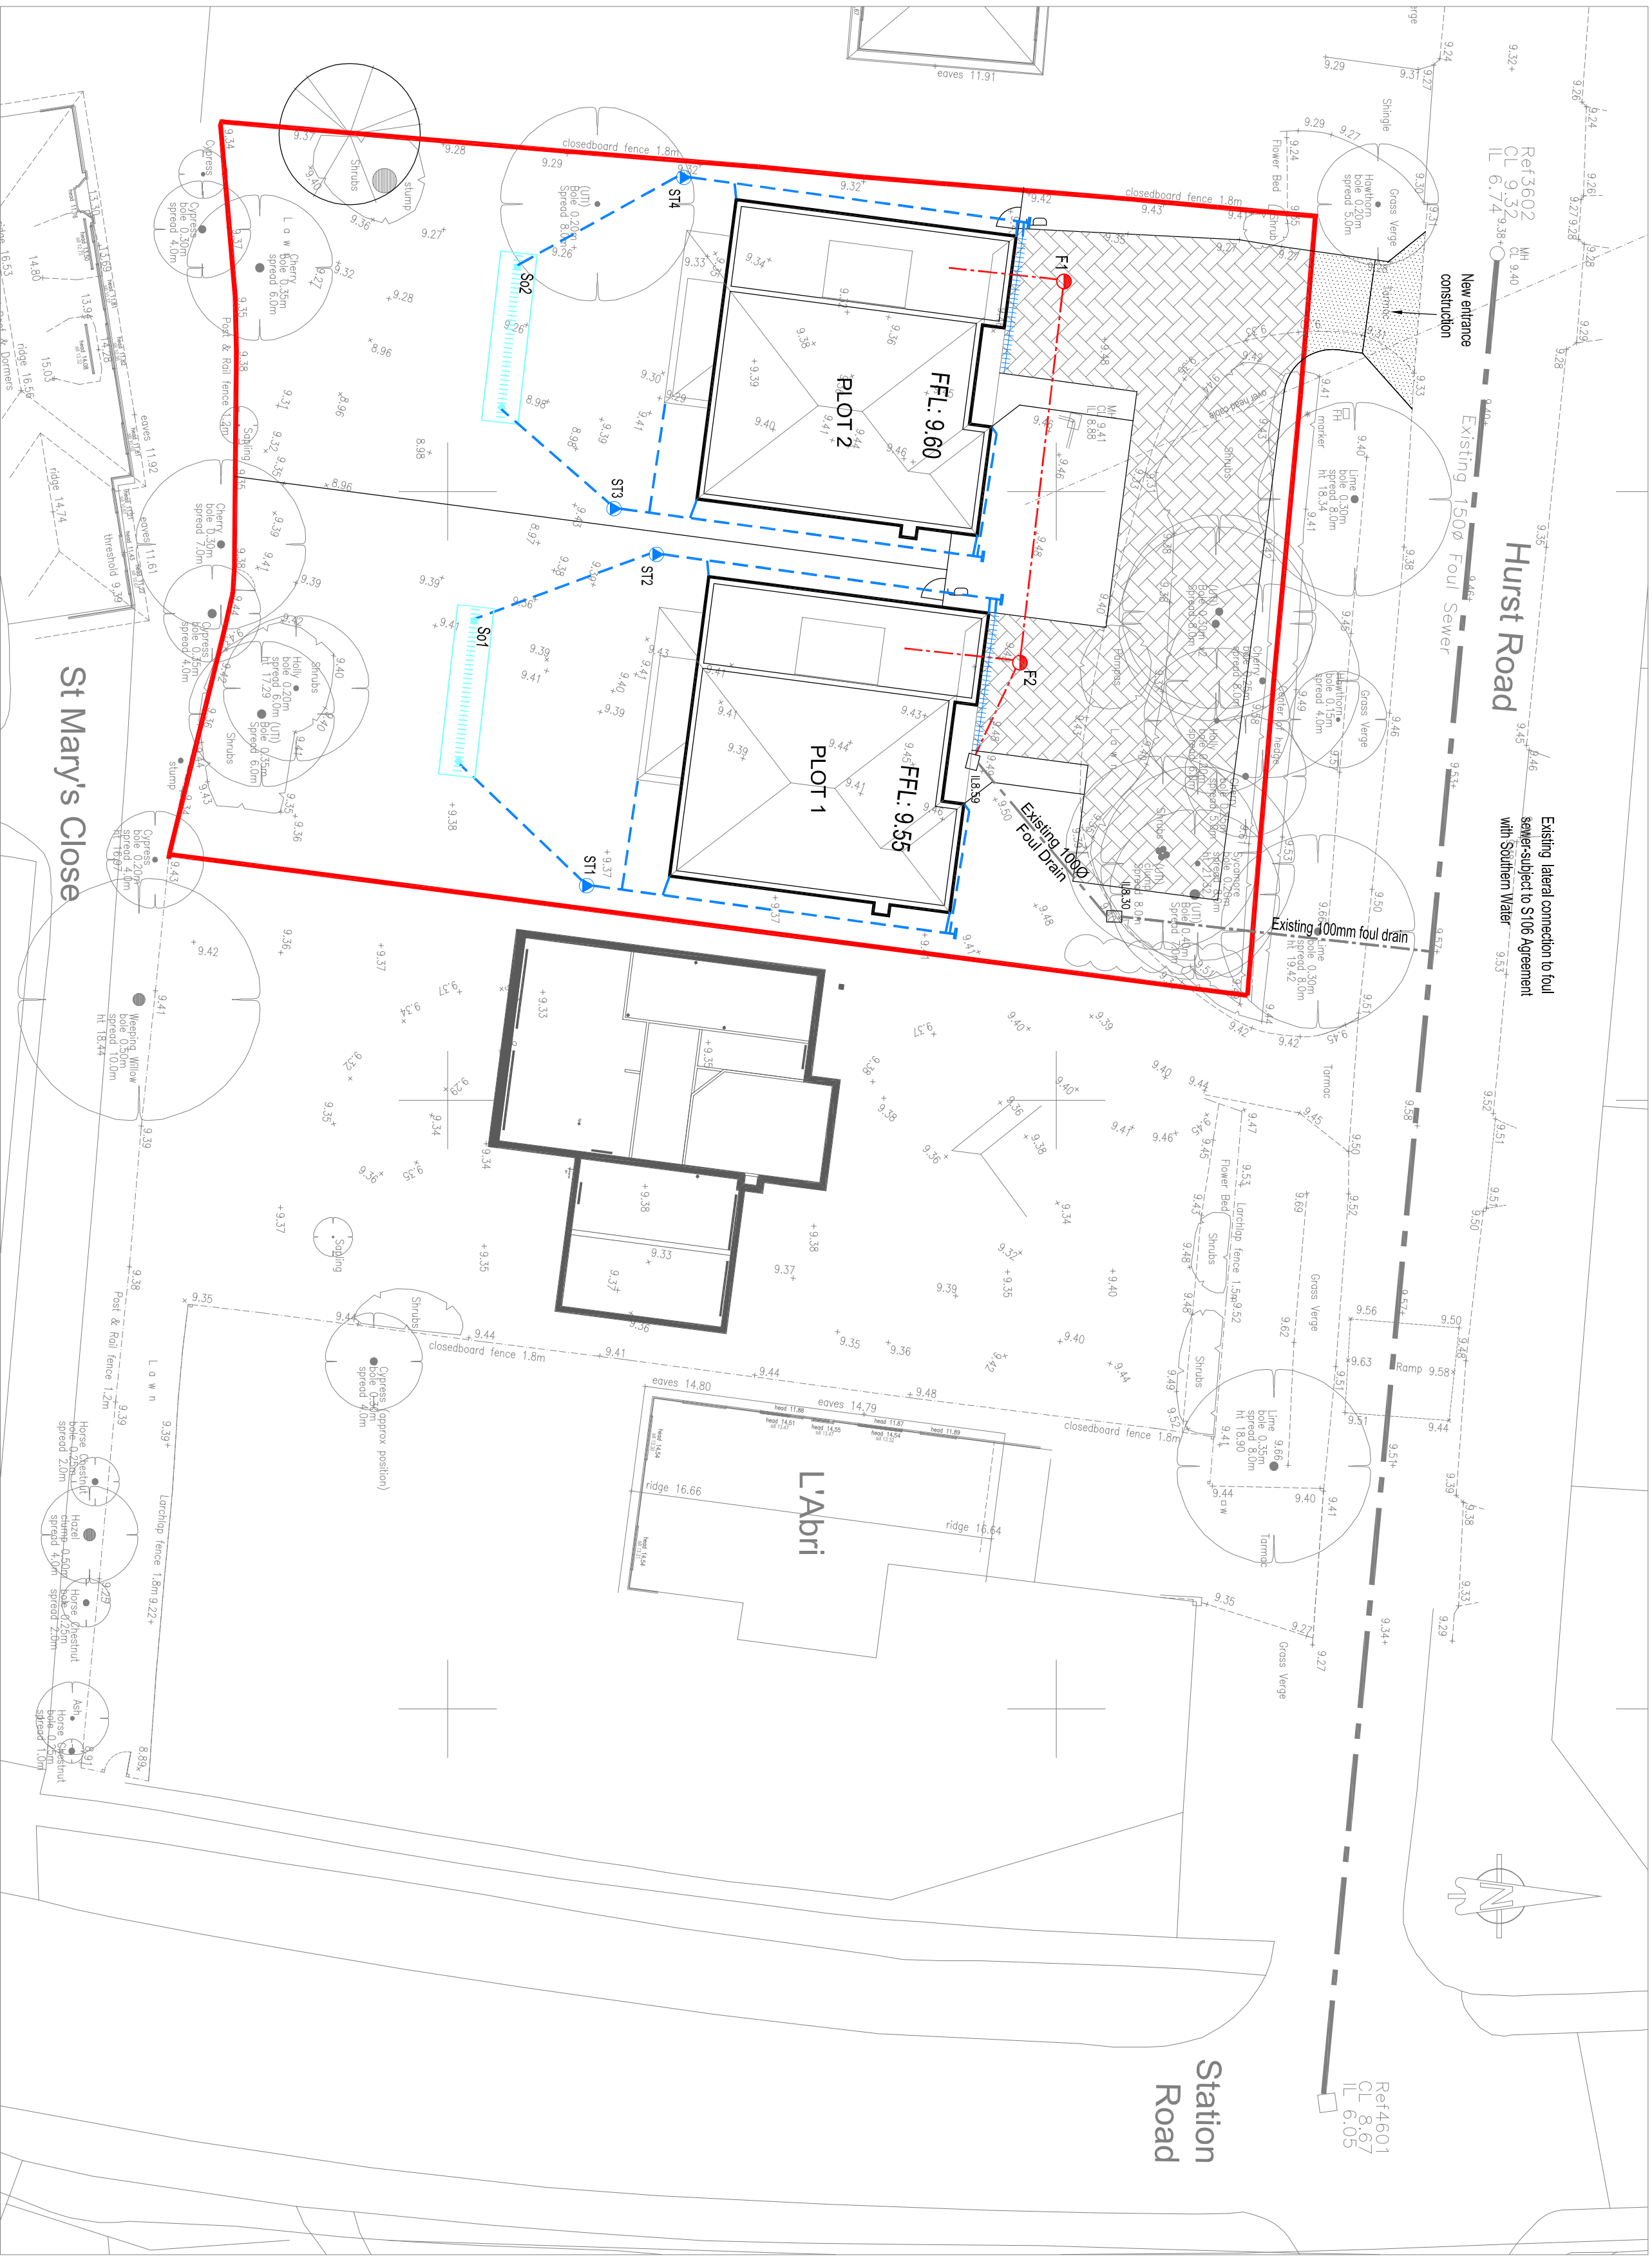


Notes:

1. All domestic drainage to be 100mm U.N.O. Minimum (4 inch) and 150mm for commercial/industrial. All pipes must be installed in accordance with BS 5533:1990. All pipes must be installed in accordance with BS 5533:1990. All pipes must be installed in accordance with BS 5533:1990.
2. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
3. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
4. All concrete and concrete products to be in accordance with BS 5533:1990. All concrete and concrete products to be in accordance with BS 5533:1990. All concrete and concrete products to be in accordance with BS 5533:1990.
5. Position of all pipes, standing water, etc. to be in accordance with BS 5533:1990. Position of all pipes, standing water, etc. to be in accordance with BS 5533:1990. Position of all pipes, standing water, etc. to be in accordance with BS 5533:1990.
6. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
7. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
8. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
9. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
10. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
11. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
12. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.
13. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.

Drainage Legend:

- Domestic foul water drainage
- Domestic surface water drainage

Proposed drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990. All drainage to be installed in accordance with BS 5533:1990.

Polypropylene Inspection Chamber Type:

- Type 3 - 450mm Ø with 115/125/150 cover
- Type 5 - 450mm Ø Open SM Top with 115/125 cover

Surfacing Legend:

- Permeable block paved access and drive
- New entrance construction
- Development Area
- Proposed level

SAFETY, HEALTH & ENVIRONMENTAL INFORMATION

CDM Regulations 2015

In addition to the hazards/risks normally associated with the type of work detailed on this drawing note should be made of the following:

- Working in vicinity of deep excavations.
- Working in live Highway
- Existing Services across site and in Highway

It is assumed that all works will be carried out by a competent contractor working where appropriate, to an approved method statement.
Contractor is not relieved of any of his obligations under all applicable health and safety regulations.

Drawing Title			
Indicative Drainage Layout			
Drawn	Checked	Scale	Page Size
KN	KN	1:250	A1
Job No.	Drawing No.	Revision	
ES1702	502-03	A	

ESCHER · SILVERMAN	
Civil & Structural Consulting Engineers	
Boulogne, 42 Orange Walk, Bessons Way, Cambridge Road, Hangerhill, SO15 1BE	
Tel: 01753 600000 Fax: 01753 600001	
www.escher-silverman.com	

MICHAEL HARTNETT	
EXECUTIVE MONITOR	

**HURST ROAD
EAST PRESTON**

Rev.	Date	Details	Initials
1	05.01.10	1st issue	KN