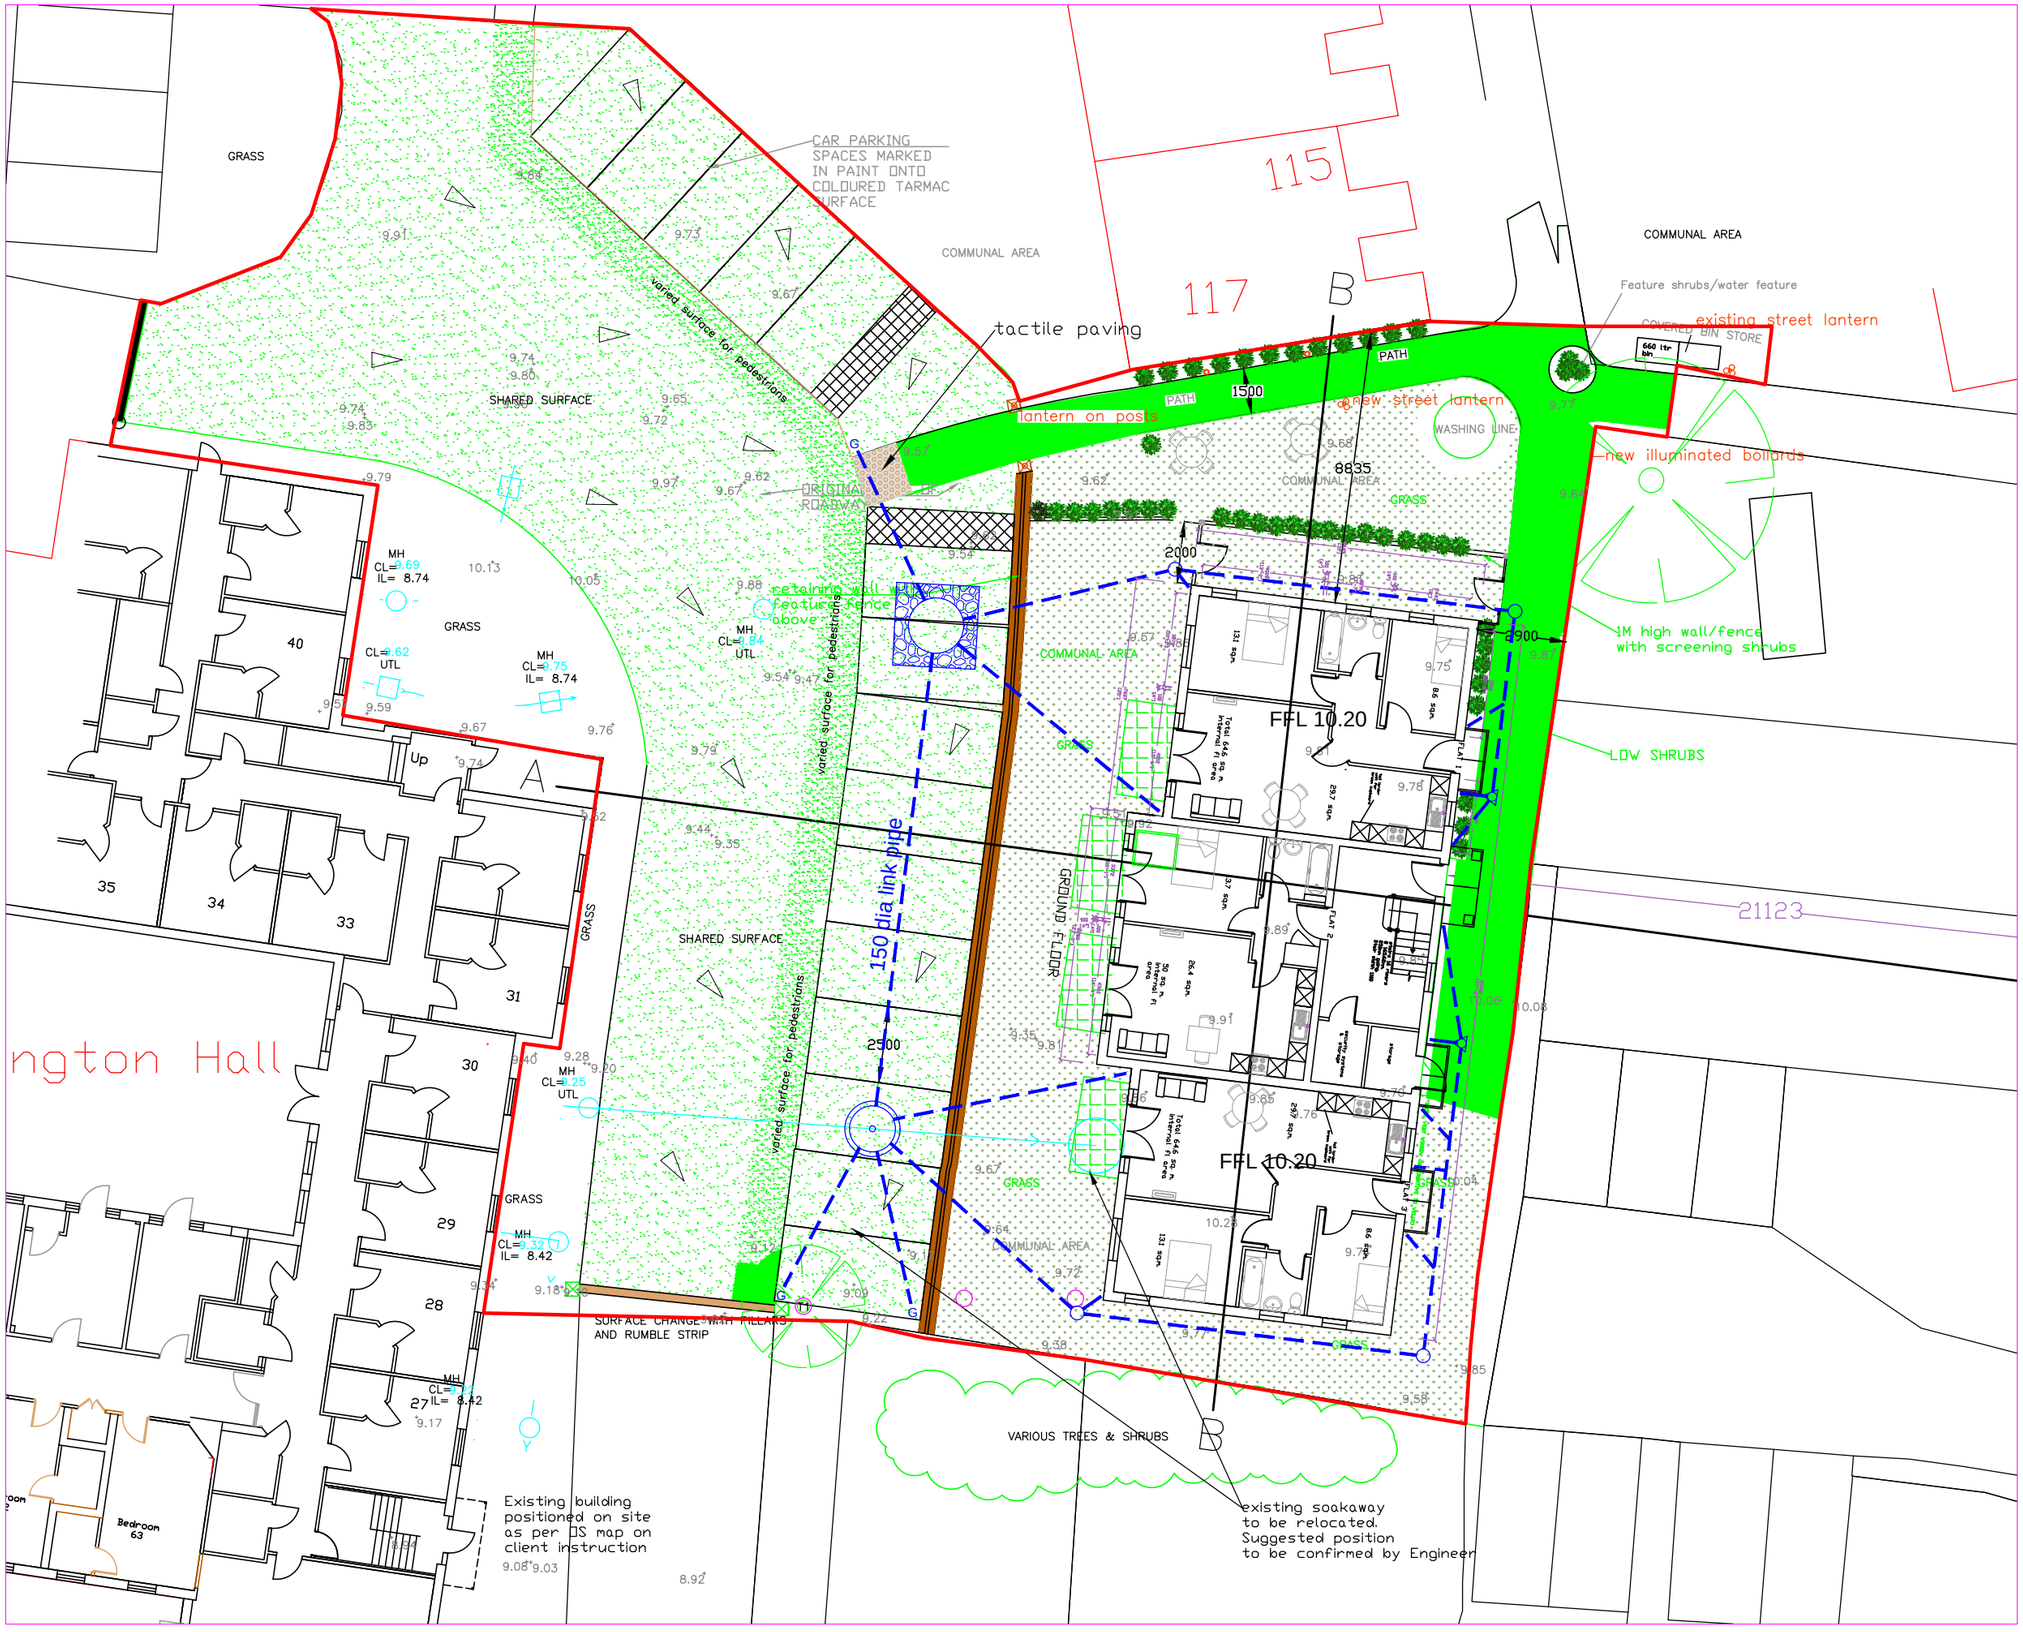


KEY

- Proposed storm drainage 100mm dia at min 1:100
- 250 dia surface water inspection chamber
- 450 dia surface water inspection chamber
- Concrete ring soakaway 1.8m internal diameter, 3.0m deep
- Direction of fall arrows
- Replacement deep-bore soakaway subject to specialist site testing and design. Soakaway required to drain approx. 1756 sq.m of impermeable area on a 1 in 100 year return period rainfall event + 40% for climate change to bring to current design standards.

Rev.	Description	Drn.	Date
-	Original	RTFC	16.3.51

Project

Rustington Hall

Client

Caldotec

Drawing Title

Surface Water Drainage

Robert Clark Associates Ltd
Chartered Civil Engineers
Willow Cottage, Herne Lane, Rustington
West Sussex BN16 3EE
T: 01903 778945 E: rca-ltd@talktalk.net

© This drawing is the copyright of Robert Clark Associates Limited
It may not be copied or reproduced without their written authority

Scale	At original
1:200	A3

Drawing Number	Revision
1786/D/SK1	-