

SuDS MAINTENANCE SCHEDULE – PHASE 1

REPORT REF: JL/183249-01C

DOCUMENT CONTROL

REV	ISSUE PURPOSE	AUTHOR	CHECKED	APPROVED	DATE
	ISSUE	JL	MJR	JEC	10.01.23
A	Updated to suit revised phasing plan	MJR	MJR	JEC	22.05.24
B	Updated to suit LPA comments	MJR	MJR	JEC	29.11.24
C	Updated to suit further LPA comments	MJR	MJR	JEC	18.03.25

DISTRIBUTION

This briefing note has been prepared for the exclusive use of **Vistry South East**. It should not be reproduced in whole or in part by third parties, without the express written authority of Ardent Consulting Engineers.

1.0 INTRODUCTION

This report is intended to outline the proposed maintenance regime of the surface water drainage network and Sustainable Drainage System (SuDS) pertinent to Phase 1 of the development at the Land East of Tye Lane, Walberton.

Reference should be made to:

- i) **Appendix A** for the location of the proposed SuDS within the main drainage system in the *Main Drainage Plan* (drawing number LHS240-1201).
- ii) **Appendix B** for the locations of the proposed SuDS within the Plot Drainage system in Phase 1 within the *Plot Drainage General Arrangement* (drawing numbers LHS240-1212/1213).
- iii) **Appendix C** for a Surface Water Drainage Phasing Plan (drawing number LHS240-1240).
- iv) **Appendix D** for Drainage Operation and Maintenance Log (pro-forma)
- v) **Appendix E** SuDS Estate Key Plan demonstrating maintenance responsibility
- vi) **Appendix F** ACE Drainage Construction Details (LHS240-1221-1223)
- vii) **Appendix G** Potential pollution Action Plan

It is worth noting that the drawings provided relate to Phase 1 of the development (as shown in Appendix C). All drawings relating to Phase 2 of the development are detailed within a separate report.

2.0 SCOPE

This report considers whole life design & maintenance criteria for the SuDS features proposed as part Phase 1 of the development. These features include permeable block paving, swales (lined, piped and conventional), headwalls, soakaway tank and an infiltration pond. The design and management of these features needs to consider all the following issues to ensure that risks to performance are minimised:

- Hydraulic design objectives of the scheme;
- Amenity objectives;
- Ecological benefits;
- Health and safety issues, e.g. effective inlet and outlet structures that are easy to maintain.

Regular inspection, monitoring and maintenance will be required to ensure the effective long-term operation of the SuDS on-site. This will be included as part of the overall site management company contract and would form part of the non-adopted estate road maintenance regime.

A management company will be in place, which will employ suitable landscape contractors to maintain the SuDS. They should have a comprehensive knowledge of the development and visit the site on a regular basis to undertake routine care such as cleaning of inlet and outlet pipework, grass cutting, tree and shrub maintenance, sweeping and litter picking.

Such attendance will ensure regular monitoring of the drainage system, a rapid response to maintenance needs, and a feeling of ownership of the SuDS features.

As part of the management company contract, the following landscape maintenance procedures will be applied:

- **Management Plan** - describing the management objectives for a site over time, and the management strategies that will be employed to both realise these objectives and reconcile any potential conflicts that may arise.
- **Specification** - detailing the conditions under which the work will be done, the materials to be used and the standard of work required.
- **Schedule of Work** – itemising the tasks to be undertaken and the frequency at which they will be performed.

As landscape maintenance contract periods are usually 1 or 3 years duration, this is a convenient starting point for SuDS maintenance contracts. The frequency of regular maintenance tasks in a contract period will vary from fortnightly to monthly periods, unless in situations where grass or weed growth requires a higher frequency of work.

Maintenance tasks which suit a performance approach commonly include plant growth, grass cutting, pruning and tree maintenance. However, work tasks such as sweeping paths, regular litter collection and cleaning road surfaces will require work at an agreed frequency with a more specific timing such as weekly, monthly or annually. Where the frequency and

SuDS MAINTENANCE SCHEDULE – PHASE 1

timing of tasks is critical then a mixture of performance and frequency specification is necessary to ensure effective maintenance. This type of specification is useful where SuDS features require regular attention.

SuDS maintenance tends towards a frequency requirement to ensure a predictable standard of care which can be recorded on site and which provides a reasonable basis for pricing work. A convenient frequency for many tasks is at a monthly inspection as this is the usual minimum site attendance required in a landscape specification. The monthly frequency provides for an inspection of all SuDS features and checking of all inlets and outlets.

It is recommended that SuDS are not handed over to those responsible for maintenance until upstream construction has ceased, the contributing catchment has stabilised, and any necessary rehabilitation of downstream components has been undertaken by the construction contractor. However, if maintenance agreements have to be put in place in advance of this time, and the level of construction activity in the contributing catchment is still high, bespoke temporary maintenance specifications should be prepared that take account of high sediment accumulation rates and the increased risks of potential spillages.

3.0 SURFACE WATER DRAINAGE OWNERSHIP PROPOSALS

It is the intention that ownership and responsibility of all various surface water drainage elements will be managed and maintained by the private management company. This will receive annual contributions from all residents.

The management company is called Gateway Property Management, contact details below:

Gateway Property Management

Head Office

Gateway House

10 Coopers Way

Southend-on-Sea

Essex

SS2 5TE

4.0 SUDS MAINTENANCE PROPOSALS

The proposed drainage strategy utilises sustainable drainage techniques to ensure that the site can accommodate all storm events up to and including the 1 in 100-year storm event with allowances for future climate change.

It is the intention that all SuDS features including permeable block paving, swales (lined, piped and conventional), headwalls and an infiltration pond are to be maintained by a private management company. The tables below outline the maintenance requirements of the SuDS components throughout the drainage strategy. These have been informed by the

guidance outlined within CIRIA C753 and best practice guidance. The following information would be supplemented by manufacturer’s specifications where applicable and be obviously dependent on the type of system involved.

Details of the SuDS operation and maintenance requirements are provided in the tables below, with drainage operation and maintenance log (pro-forma) in **Appendix D**.

Maintenance Regime for Grassed Swales (lined, conventional and piped)

Description:

Swales are linear vegetated drainage features in which surface water can be stored or conveyed. Phase 1 contains 3 types of swales – conventional, piped and lined swales. Lined swales store water before enabling surface water to drain naturally to an endpoint. Conventional swales are similar except for allowance of infiltration during surface water conveyance, while piped swales enable direct conveyance of surface water through pipes directly through their centre.

The swales act to convey surface water runoff from the catchment to the south-eastern infiltration pond on the site.

Locations (refer to APPENDIX A):

Across northern and north-eastern perimeters in addition to roadside swales adjacent to the main spine road and near the basin.

MAINTENANCE SCHEDULE	REQUIRED ACTION	FREQUENCY
Regular Maintenance	Sediment, debris and litter removal from swales & pipes	Monthly
	Grass cutting at 75-100mm, not to exceed 150mm. Cuttings not to be left within the swale.	Monthly (or as required)
	Remove any root ingress from pipework	As required
Occasional Maintenance	Remove leaves in autumn to prevent damage to grass	As required
	Cut back overhanging branches to allow dense grass growth	As required
	Inspect silt accumulation rates and establish appropriate clearance rates	As required
	CCTV survey of drains to check alignment, cracking and joint displacement	10-year intervals
Remedial Actions	Repair erosion, level uneven surfaces or damage by re-turfing or seeding	As required
	Remove silt and spread locally outside design profile and reinstate surface	As required
	Inspect for evidence of poor operation, weed growth and/or excessive sediment build up. If required, take remedial action.	3-monthly, 48 hours after large storm
	Repair/rehabilitation of inlets and outlets	As required

SuDS MAINTENANCE SCHEDULE – PHASE 1

Maintenance Regime for Lined Permeable Paving Areas**Description:**

Lined blocked permeable paving that allow rainwater to infiltrate through its surface course to underlying open graded aggregate. The permeable paving across the site is lined with an impermeable liner and discharges un-restricted to strategically placed manholes in proximity to the permeable paving.

Locations (refer to APPENDIX B):

Private Drives to the north and south of the main spine road including; Dowling Way, Fairway Close and Rosemary Lane.

MAINTENANCE SCHEDULE	REQUIRED ACTION	FREQUENCY
Regular Maintenance	Brushing and vacuuming (standard cosmetic sweep over whole surface)	Once a year, after Autumn leaf fall, or reduced frequency as required, based on site-specific observations of clogging or manufacturer's recommendations – particular attention is to be paid to areas where water runs on to pervious surface from adjacent impermeable areas as this area is most likely to collect the most sediment.
Occasional Maintenance	Stabilise and mow contributing and adjacent areas	As required
	Removal of weeds or management using glyphosate applied directly into the weeds by an applicator rather than spraying.	As required – once per year on less frequently used pavements.
Remedial Actions	Repair/rehabilitation of inlets, outlet, overflows and vents.	As required
	Remedial work to any depressions, rutting and cracked or broken blocks considered detrimental to the structural performance of the pavement or a hazard to users, and replace lost jointing material	As required
	Rehabilitation of surface and upper sub-structure by remedial sweeping	Every 10-15 years or as required
Monitoring	Initial inspection	Monthly for 3 months after installation
	Inspect for evidence of poor operation and/or weed growth. If required take remedial action	3-monthly, 48 hours after large storm
	Inspect silt accumulation rates and establish appropriate brushing rates	Annually
	Monitor inspection chambers	Annually

SuDS MAINTENANCE SCHEDULE – PHASE 1
Maintenance Regime for Headwalls, Catchpits and Pipes
Description:

Headwalls – Bespoke structures, open to the air, which provide a formal pipe outfall or inlet.

Catchpit – A manhole with a sump to capture sediment.

Location (refer to APPENDIX A):

Headwalls – located at the end of swales and inlet of infiltration basin.

Catchpit – Manhole SW8.5

MAINTENANCE SCHEDULE	REQUIRED ACTION	FREQUENCY
Regular Maintenance	Remove sediment and debris from chambers	Annually
	Remove sediment and debris from headwall aprons and rip-rap	Annually
	Remove any root ingress from chambers/pipework	As required
	Remove vegetation blocking sight of and access to headwalls	As required
Occasional Maintenance	CCTV survey of drains to check alignment, cracking and joint displacement	10 year intervals
Remedial Actions	Repair/rehabilitation of inlets, outlet, overflows and railings.	As required
Monitoring	Initial inspection	Monthly for 3 months after installation
	Inspect for evidence of poor operation, weed growth and/or excessive sediment build-up. If required take remedial action	3-monthly, 48 hours after large storm
	Inspect silt accumulation rates and establish appropriate clearance rates	Annually
	Monitor chambers and headwalls	Annually

Maintenance Regime for the Infiltration Pond



Description:

A pond with wetland planting for the storage, treatment and infiltration of runoff prior to attenuated discharge to Swale A. The pond will retain a permanent water volume; aiding biodiversity and water quality treatment purposes. A section of the pond is non-infiltrating with a geomembrane.

Location (refer to APPENDIX A):

Located to the south of Plots 22/23. The pond receives flow from P1.007 & P7.003 via two headwalls.

MAINTENANCE SCHEDULE	REQUIRED ACTION	FREQUENCY
Regular Maintenance	Litter and debris removal	Monthly (or as required)
	Grass cutting to access routes and side slopes at 75-100mm, not to exceed 150mm. Cuttings not to be left within the pond.	As required
	Inspect inlets, banksides, structures, pipework etc. for evidence of blockage and/or physical damage.	Monthly
	Trimming any roots that may be causing blockages	Annually (or as required)
	Inspect marginal and bankside vegetation and remove nuisance plants (for first 3 years)	Monthly (at start, then as required)
	Inspect water body for signs of poor water quality	Monthly (May-October)
	Remove 25% of bank vegetation from water's edge to a minimum of 1m above water level	Annually
	Tidy all dead growth (scrub clearance) before start of growing season	Every 1-5 years, or as required
Occasional Maintenance	Remove leaf accumulation	As required
	Cut back overhanging branches to allow dense vegetation growth	As required
	Cut aquatic vegetation back to design area to maintain open water	As required
	Remove sediments from inlets and main body of pond when pool volume is reduced by 20%	As required
Remedial Actions	Inspect and repair damage to inlets. Clear if required	As required
	Replace topsoil if infiltration performance deteriorates or failure occurs	As required
	Repair erosion or other damage	As required

SuDS MAINTENANCE SCHEDULE – PHASE 1

Monitoring	Replant, where necessary	As required
	Aerate pond when signs of eutrophication are detected	As required
	Inspect sediment accumulation within basin grassed base ensuring topsoil consists of a sand: soil mix ratio of 40:60.	As required
	Check pond to ensure infiltration is occurring	As required

Maintenance Regime for the Soakaway tank**Description:**

Soakaway tank – a substructure into which surface water is conveyed, designed to promote infiltration.

Location (refer to APPENDIX A):

Located to the north-east of the site.

MAINTENANCE SCHEDULE	REQUIRED ACTION	FREQUENCY
Regular Maintenance	Inspect and identify any areas that are not operating correctly. If required, take remedial action.	Monthly for 3 months, then 6 monthly
	Debris removal from catchment surface (where may cause risks to performance)	Monthly
Occasional Maintenance	Remove sediment and debris from the inlet pipe and the soakaway grate itself	As required, based on inspections
Remedial actions	Removal, cleaning and reinstatement of the granular soakaway surround if performance deteriorates or failure occurs	As required
	Replacement of clogged geotextile (will require reconstruction of soakaway granular surround)	As required
Monitoring	Check and record water levels in soakaway to ensure emptying is occurring. Consistent presence of water would require remedial actions stated above. The remedial actions are to be undertaken as soon as possible and within 2-months of noting an issue.	Every 6-months
	Inspect/check the inlet and access point to ensure they are in good condition and operating as designed	Annually and after large storms

SuDS MAINTENANCE SCHEDULE – PHASE 1

Proposed Action Plan

It is considered that the risk of spillage across this site is very low, however an action plan has been considered with regards to potential spill of pollutants on the main access road though the development.

The majority of the access road on Phase 1 has been designed to drain directly into the roadside swales (0mm upstand channel kerbs). These swales are then piped to the infiltration basin to the south. In the event of a spillage on the access road, it is proposed that the downstream swale outfall will be blocked so that the potential pollutants are not able to discharge into the infiltration basin. Any spillage contained in the swale will then be pumped out and taken offsite to a designed waste management facility.


Other sections of the access road utilise more traditional gully drainage which discharged into a gravity piped network that either discharges into the infiltration basin or the soakaway to the north of the site. In this instance, an expanding pipe stopper would be used to bung the downstream manhole to prevent pollutants reaching the infiltration basin/soakaway. The manhole cover will need to be lifted so that the pipe stopper can be placed on the outgoing pipe and once secured, the polluted water can be pumped out of the manhole and taken offsite to a designed waste management facility. The manhole in question will be SW1.7 (525mm diameter) to the infiltration basin and SW16.1 (225mm diameter) to the soakaway. Management company to ensure they have expanding pipe stoppers of these two diameters to hand on-site in case of such spillages.

It is to be noted that there are elements of the current design that are there to treat the runoff prior to infiltrating into the ground such as the wetland planting and sediment forebay in the infiltration basins, and rip-rap aprons in the basins and swales.

A sketch demonstrating the proposed Action Plan items can be found in **Appendix G**.

APPENDIX A

Main Drainage Plan (Drawing number LHS240-1201)

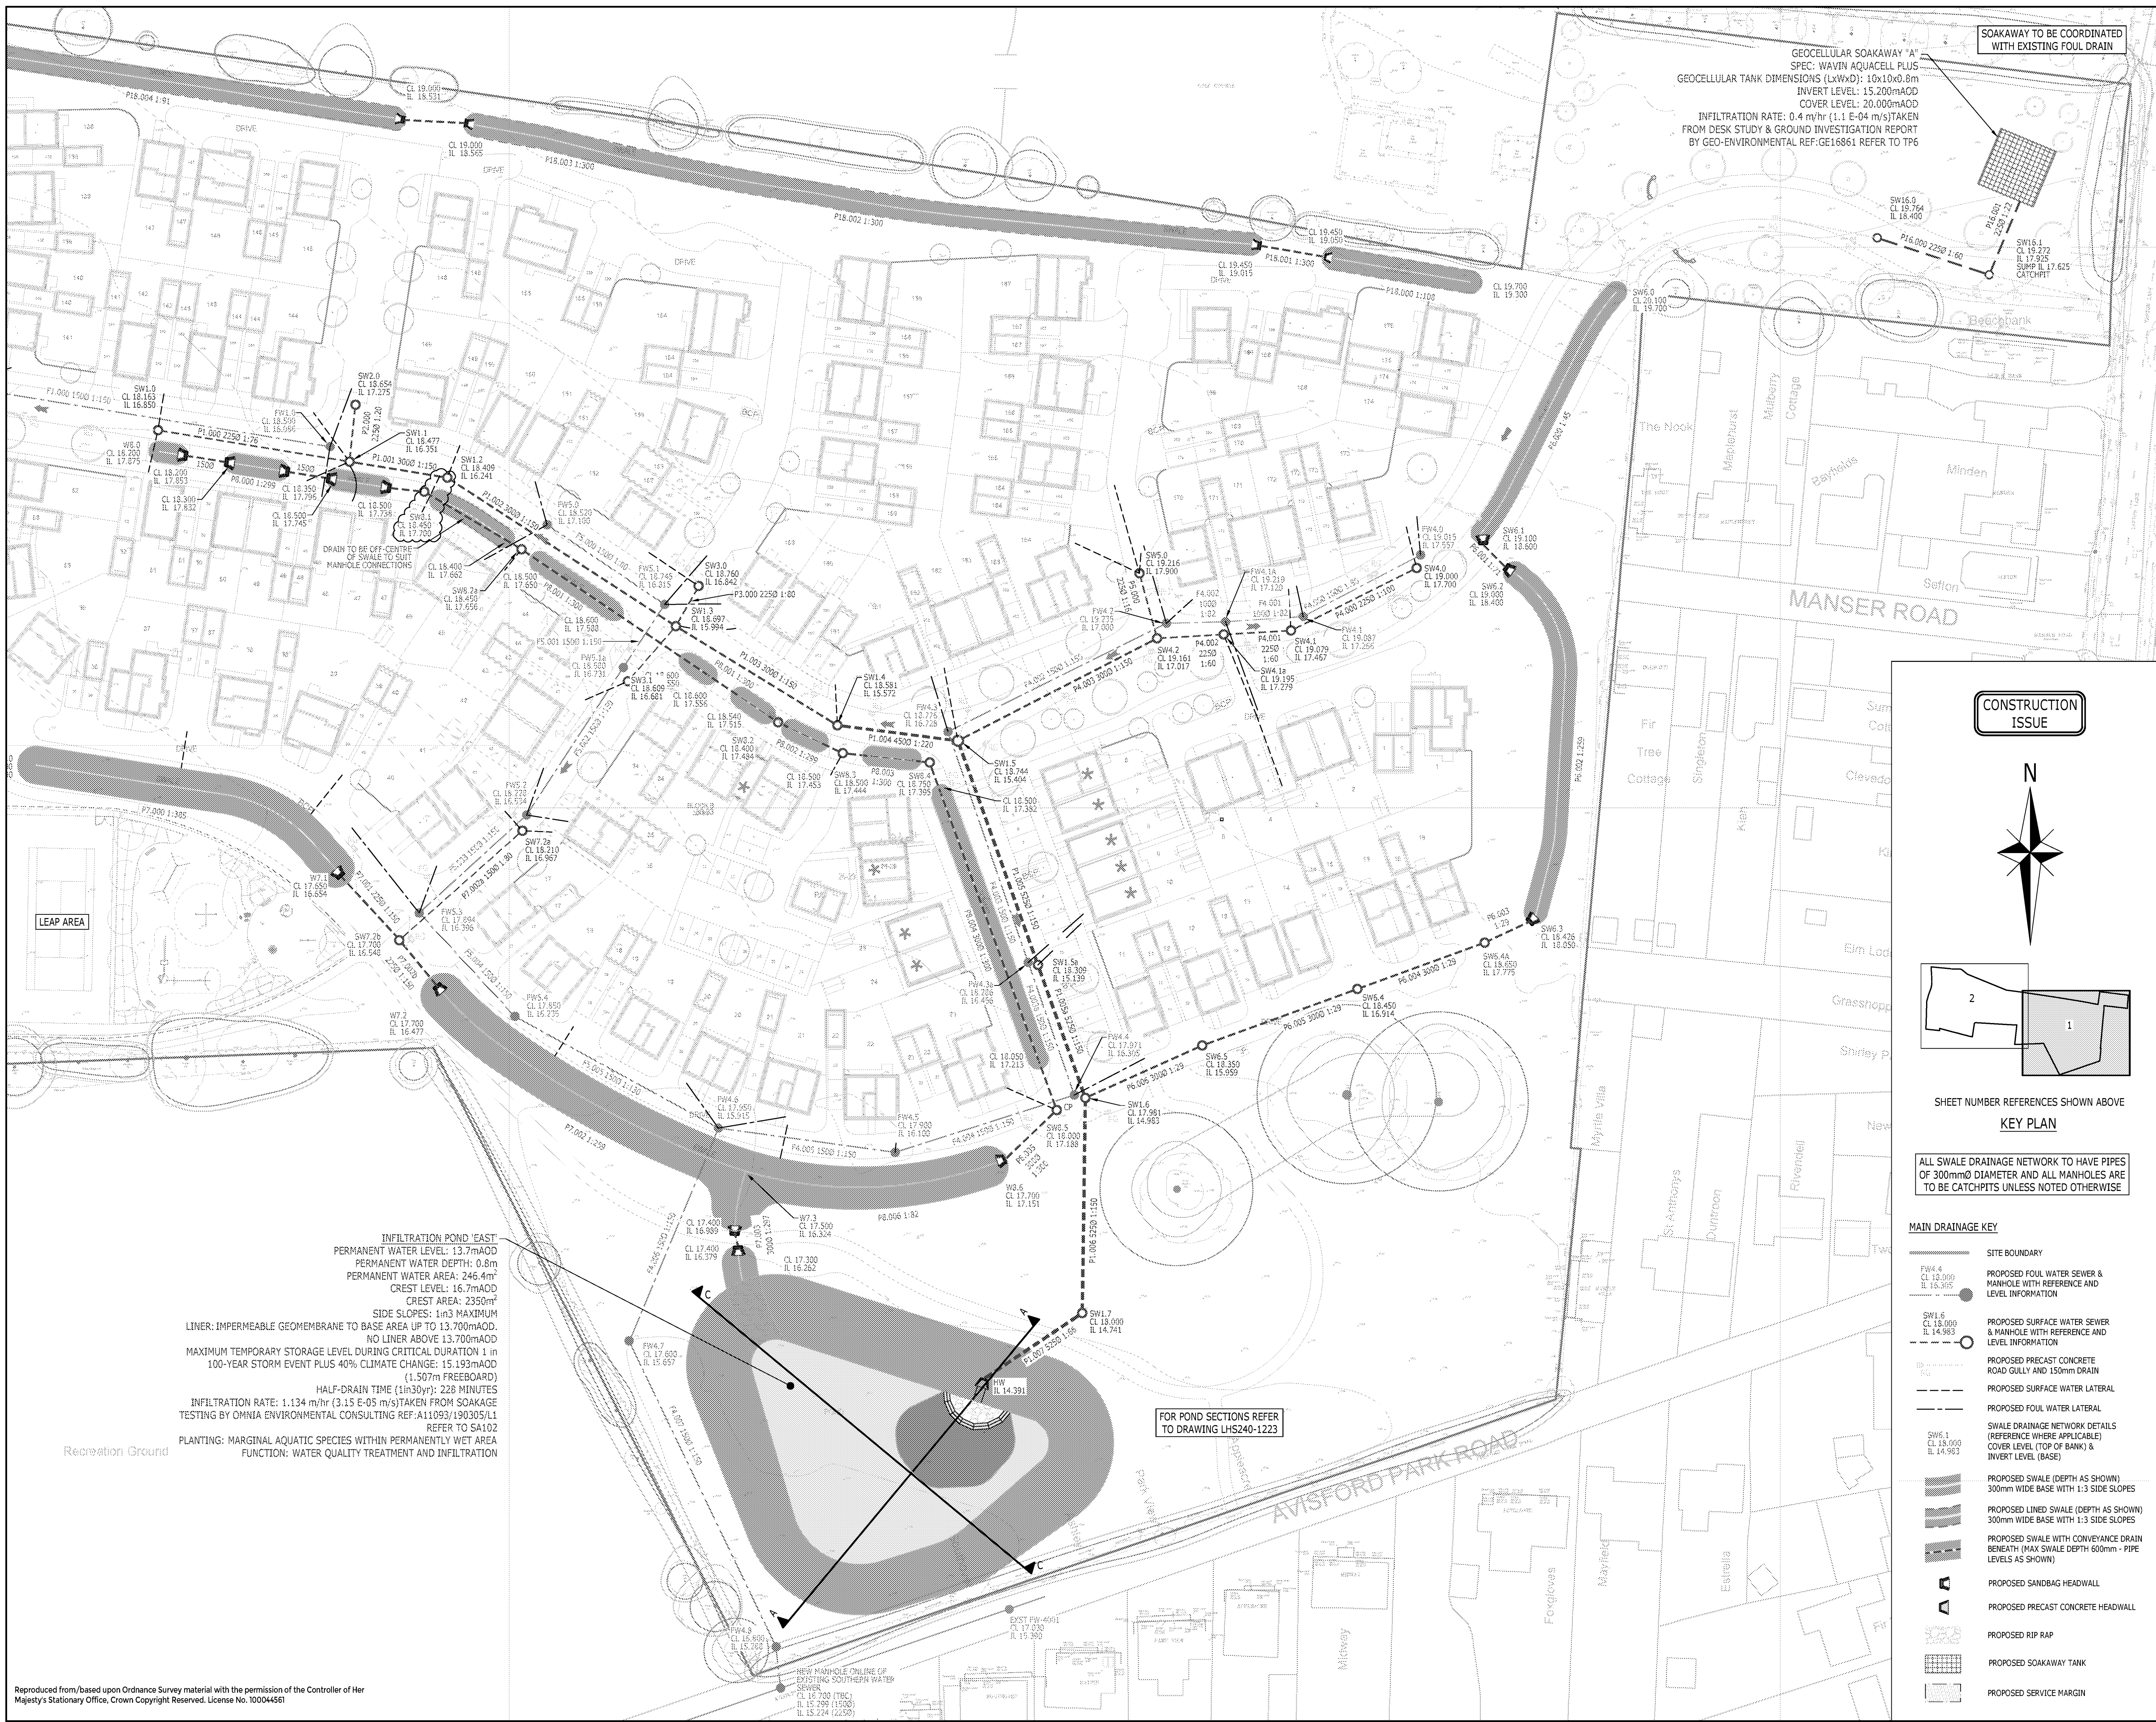

Reproduced from/based upon Ordnance Survey material with the permission of the Controller of Her Majesty's Stationary Office, Crown Copyright Reserved. License No. 10004561

NOTES:

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION, INC. RISK ASSESSMENTS (SEE CDM NOTES) AND ALL OTHER RELATED DRAWINGS ISSUED BY THE ENGINEER.
- DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
- ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES UNLESS OTHERWISE STATED.
- ALL DIMENSIONS, LEVELS AND SURVEY GRID CO-ORDINATES ARE TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF THE WORKS.
- NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PRIOR PERMISSION FROM THE ENGINEER.
- ALL PRIVATE DRAINAGE IS TO COMPLY AND BE LAID IN ACCORDANCE WITH CURRENT PART H OF BUILDING REGULATIONS, BS 8301 AND BS 5955.
- REFER TO ARCHITECT'S HOUSE TYPE (WORKING) DRAWINGS FOR EXACT POSITION OF DRAINAGE POINTS.
- POSITION & INVERT LEVELS OF ALL EXISTING MANHOLES, SEWERS AND LATERALS TO BE CONFIRMED PRIOR TO CONSTRUCTION & ANY DISCREPANCIES REPORTED TO THE ENGINEER.
- ALL DRAIN AND SEWER PIPES ARE TO BE LAID SOFFIT TO SOFFIT, UNLESS SHOWN OTHERWISE (SEE ALSO MANHOLE SCHEDULE DRAWINGS).
- ALL PLOT DRAINAGE TO BE 100mm Ø UNLESS SHOWN OTHERWISE, LAID IN ACCORDANCE WITH BS 8301.
- ALL MATERIALS SHALL COMPLY TO THE BSI KITE MARK CERTIFICATION SCHEME AND MUST BE MARKED ACCORDINGLY.
- COVER AND FRAMES TO MANHOLES/INSPECTION CHAMBERS TO COMPLY WITH BS EN124. REFER TO PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWING.
- WHERE FINISHED GROUND LEVELS FALL TOWARDS BUILDING, AN OPEN GULLY IS TO BE PROVIDED AT THE FOOT OF ALL RAINWATER PIPES. ALL RAINWATER PIPES TO HAVE RODDING ACCESS.
- FINAL POSITIONS OF INSPECTION CHAMBERS WITHIN PRIVATE AREAS ARE SUBJECT TO CONFIRMATION ON SITE TO SUIT PIPE CONFIGURATIONS AND CHAMBER INLET POSITIONS.
- WHERE A DRAIN RUN PASSES THROUGH A WALL OR FOUNDATION IT IS NECESSARY TO:
 - FORM AN OPENING USING A CONCRETE LINTEL WITH AT LEAST 50mm CLEARANCE AROUND THE PIPE AND THE OPENINGS MASKED WITH RIGID SHEET MATERIAL TO PREVENT ENTRY OF FILL OR VERMIN, OR
 - BUILD IN A LENGTH OF PIPE WITH ITS JOINTS AS CLOSE AS POSSIBLE TO THE WALL FACES (150mm MAXIMUM) AND CONNECTED ON EACH SIDE TO 600mm LONG ROCKER PIPES WITH FLEXIBLE JOINTS.
- PLOT DRAINAGE TO BE BEDDED ON GRANULAR MATERIAL AND BACKFILLED WITH SUITABLE CLEAN MATERIAL, AS DESCRIBED ON THE PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWINGS. SEE ALSO SHALLOW DRAINAGE TRENCH DETAIL AND PIPE RUNS NEAR BUILDING DETAIL FOR CONCRETE BED AND SURROUND PIPE PROTECTION MEASURES WHERE APPLICABLE.
- BACKFILL SHOULD BE PLACED IN LAYERS NOT EXCEEDING 300mm (UNCOMPACTED THICKNESS). EACH LAYER BEING WELL COMPACTED. MECHANICAL COMPACTION EQUIPMENT SHOULD NOT BE USED UNTIL THERE IS A MINIMUM OF 450mm OF COMPACTED MATERIAL ABOVE THE CROWN OF THE PIPE.
- ALL DRAIN CONNECTIONS BENEATH THE HIGHWAY ARE TO HAVE MINIMUM 150mm CONCRETE BED AND SURROUND, WHERE COVER IS LESS THAN 1.2m.
- REFER TO PRE-TENDER HEALTH & SAFETY PLAN & CONSTRUCTION PHASE HEALTH & SAFETY PLAN PRIOR TO THE COMMENCEMENT OF WORKS.

CDM NOTES:

- THE ATTENTION OF THE CLIENT AND THE PRINCIPAL CONTRACTOR IS DRAWN TO THE FOLLOWING POTENTIAL RISKS IN CONJUNCTION WITH THE PROPOSED ON-SITE AND OFF-SITE WORKS AS DESIGNED FOR THIS PROJECT:
- WORKS IN THE VICINITY OF LIVE SERVICES WILL BE NECESSARY AND THE ADVICE OF ALL STATUTORY SERVICE COMPANIES MUST BE SOUGHT BEFORE ANY WORKS COMMENCE.
- WORKS WITHIN AND ADJUTING THE EXISTING HIGHWAY WILL ENTAIL TRAFFIC HAZARDS AND ALL APPROPRIATE SAFETY MEASURES INCLUDING BARRIERS, SIGNS AND LIGHTING MUST BE UNDERTAKEN TO THE APPROVAL OF THE LOCAL AUTHORITY, THE HIGHWAY AUTHORITY AND THE POLICE.
- HAZARDOUS MATERIALS INCLUDING CEMENT AND BITUMINOUS MATERIALS ARE SPECIFIED AND THE MANUFACTURER'S ADVICE ON SAFE HANDLING PROCEDURES MUST BE OBTAINED AND MADE CLEAR TO ALL OPERATIVES.
- THE CONTRACTOR WILL BE RESPONSIBLE FOR LOCATING ALL EXISTING SERVICES WITHIN THE VICINITY OF THE WORKS AND ENSURE THESE ARE PROTECTED THROUGHOUT THE DURATION OF THE WORKS. ALL UTILITY PLANT SHOULD BE CLEARLY MARKED ON THE GROUND PRIOR TO COMMENCEMENT OF THE WORKS.
- THE CONTRACTOR MUST ENSURE ALL WORKING AREAS ARE FULLY SECURE.

Rev	Description	Drn	Chk	App	Date
C7	DRAINAGE LATERAL UPDATED TO SUIT RFI	JM	JM	GH	01.07.20
C6	UPDATED AS PER REV CLOUDS TO SUIT RFI'S	JM	JM	GH	16.06.20
C5	SWALES UPDATED SEE REV CLOUD	UN	JM	GH	28.11.19
C4	COVER LEVELS TO FW4.5, 4.6 & 5.4 UPDATED	JM	JM	GH	15.11.19
C3	MANHOLE ADDED TO EXISTING DRAINAGE SYSTEM	JM	JM	GH	21.10.19
C2	ROAD GULLY LOCATION REVISED AS CLOUDED	MJR	JM	GH	12.08.19
C1	ISSUED FOR CONSTRUCTION	MJR	JM	GH	09.08.19
T2	CATCHPIT ADDED, ROAD GULLY LATERAL REVISED.	JM	JM	GH	01.08.19

ARDENT

CONSULTING ENGINEERS

Third Floor
The Hallmark Building
52-56 Leadenhall Street
London
EC3M 5SE

Tel: 020 7680 4088
Web: www.ardent-ce.co.uk
E-mail: enquiries@ardent-ce.co.uk

worksafe
consultant

www.ardent.co.uk

SSIP

ASSISTED
DISABILITY
CONTRIBUTOR

Client: **LINDEN HOMES SOUTH**

Project Title: **LAND EAST OF TYE LANE, WALBERTON**

Drawing Title: **MAIN DRAINAGE PLAN (SHEET 1 OF 2)**

A1 Scale	Date	Designed by
1:500	18.04.2019	JM



Drawn by	Checked by	Approved by
JM	JM	GH

Drawing Number	Rev
LHS240-1201	C7

File Location: p:\ardent\project\183304 - land east of tye lane, detailed\output\technical\accd\drawings\lsh240-1201-002-main drainage layout.dwg

APPENDIX B

Plot Drainage General Arrangement (Drawing numbers LHS240-1212-1214)

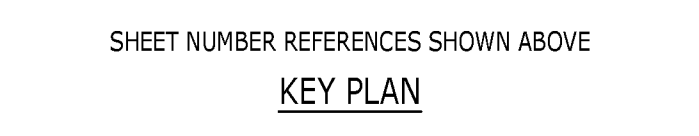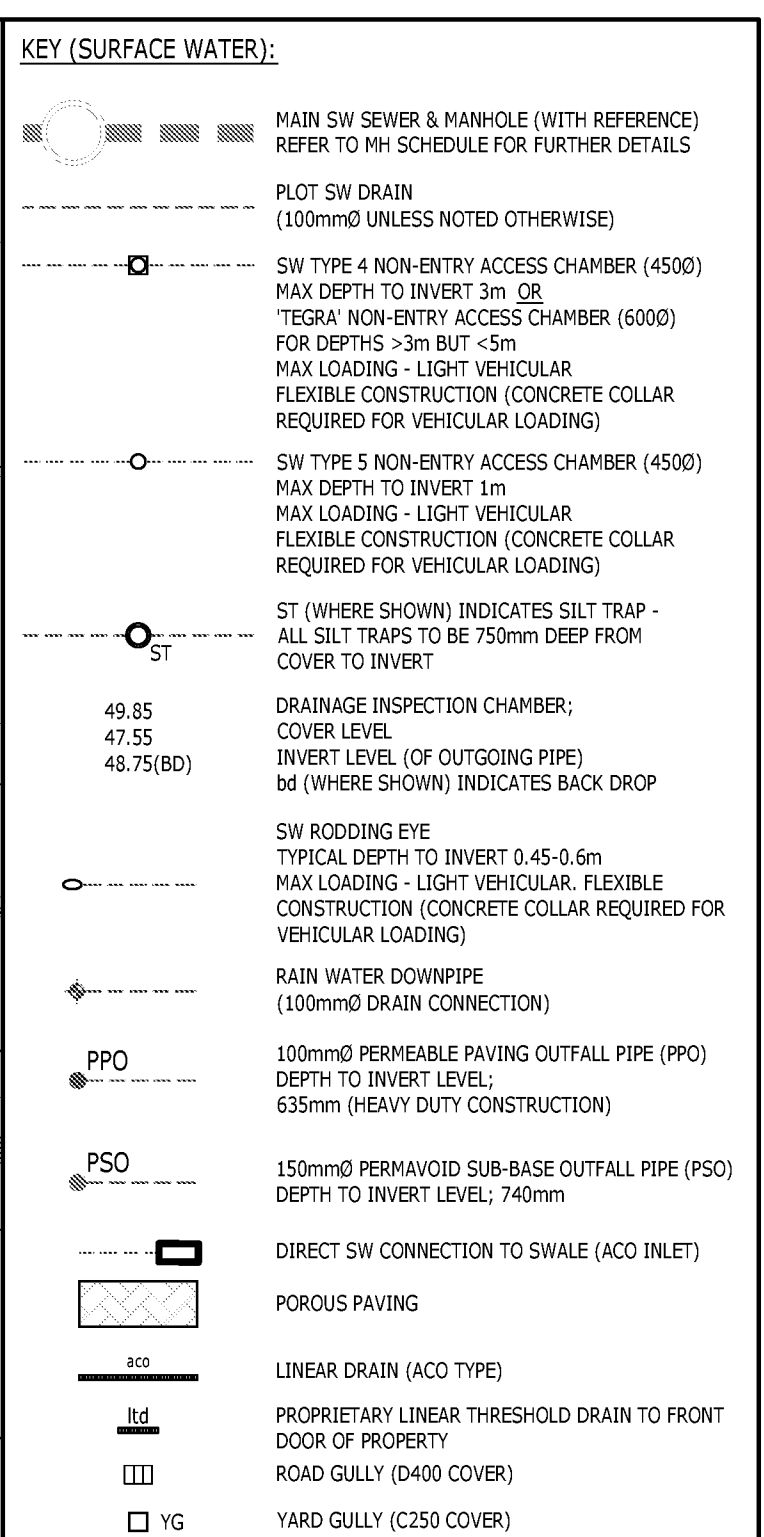

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION, RISK ASSESSMENTS (SEE COM NOTES) AND ALL OTHER RELATED DRAWINGS ISSUED BY THE ENGINEER.
2. DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
3. ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES UNLESS OTHERWISE STATED.
4. ALL DIMENSIONS, LEVELS AND SURVEY GRID CO-ORDINATES ARE TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF THE WORKS.
5. NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PRIOR PERMISSION FROM THE ENGINEER.
6. ALL PRIVATE DRAINAGE IS TO COMPLY AND BE LAID IN ACCORDANCE WITH CURRENT PART H OF BUILDING REGULATIONS, BS 8301 AND BS 8955.
7. REFER TO ARCHITECT'S HOUSE TYPE (WORKING) DRAWINGS FOR EXACT POSITION OF DRAINAGE POINTS.
8. POSITION & INVERT LEVELS OF ALL EXISTING MANHOLES, SEWERS AND LATERALS TO BE CONFIRMED PRIOR TO CONSTRUCTION & ANY DISCREPANCIES REPORTED TO THE ENGINEER.
9. ALL DRAIN AND SEWER PIPES ARE TO BE LAID SLOTT TO SLOTT, UNLESS SHOWN OTHERWISE (SEE ALSO MANHOLE SCHEDULE DRAWINGS).
10. ALL MATERIALS SHALL COMPLY TO THE BS1 KITE MARK CERTIFICATION SCHEME AND BE MARKED ACCORDINGLY.
11. COVER AND FRAMES TO MANHOLES/INSPECTION CHAMBERS TO COMPLY WITH BS EN124. REFER TO PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWING.
12. WHERE FINISHED GROUND LEVEL FALL TOWARDS BUILDING, AN OPEN GULLY IS TO BE PROVIDED AT THE FOOT OF ALL RAINWATER PIPES. ALL RAINWATER PIPES TO HAVE ROOFING ACCESS.
13. FINAL POSITIONS OF INSPECTION CHAMBERS WITHIN PRIVATE AREAS ARE SUBJECT TO CONFIRMATION ON SITE TO SUIT PIPE CONFIGURATIONS AND CHAMBER INLET POSITIONS.
14. WHERE A DRAIN RUN PASSES THROUGH A WALL OR FOUNDATION IT IS NECESSARY TO:
 - a) FORM AN OPENING USING A CONCRETE LINTEL WITH AT LEAST 50mm CLEARANCE AROUND THE PIPE AND THE OPENINGS MARKED WITH RIGID SHEET MATERIAL TO PREVENT ENTRY OF FILL OR VERMIN, OR
 - b) BUILD IN A LENGTH OF PIPE WITH ITS JOINTS AS CLOSE AS POSSIBLE TO THE WALL FACES (150mm MAXIMUM) AND CONNECT ON EACH SIDE TO 600mm LONG ROOFER PIPES WITH FLEXIBLE JOINTS.
15. PLOT DRAINAGE TO BE BEDDED ON GRANULAR MATERIAL AND BACKFILLED WITH SUITABLE CLEAN MATERIAL, AS DESCRIBED ON THE PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWINGS. SEE ALSO SHALLOW DRAINAGE TRENCH DETAIL AND PIPE RUNS NEAR BUILDINGS DETAIL FOR CONCRETE BED AND SURROUNDING PIPE PROTECTION MEASURES WHERE APPLICABLE.
16. BACKFILL SHOULD BE PLACED IN LAYERS NOT EXCEEDING 300mm (UNCOMPACTED THICKNESS), EACH LAYER BEING WELL COMPACTED. MECHANICAL COMPACTION EQUIPMENT SHOULD NOT BE USED UNTIL THERE IS A MINIMUM OF 450mm OF COMPACTED MATERIAL ABOVE THE CROWN OF THE PIPE.
17. ALL DRAIN CONNECTIONS BENEATH THE HIGHWAY ARE TO HAVE MINIMUM 150mm CONCRETE BED AND SURROUND, WHERE COVER IS LESS THAN 1.2m.
18. REFER TO PRE-TENDER HEALTH & SAFETY PLAN & CONSTRUCTION PHASE HEALTH & SAFETY PLAN PRIOR TO THE COMMENCEMENT OF WORKS.

ALL DRAINAGE WORKS TO BE IN
ACCORDANCE WITH NHBC
GUIDELINE DOCUMENTS

KEY (FOUL WATER):	
	MAIN FW SEWER & MAN-HOLE (WITH REFERENCE) REFER TO MH SCHEDULE FOR FURTHER DETAILS
	INDICATIVE EXISTING SOUTHERN WATER PUBLIC FOUL SEWER
	PLOT FW DRAIN (100mm) UNLESS NOTED OTHERWISE
	FW TYPE 4 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 3m OR "TEGRA" NON-ENTRY ACCESS CHAMBER (6000)
	MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
	FW TYPE 5 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 1m
	MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
	FW TYPE 6a MINI INSPECTION CHAMBER (<3000) MAX DEPTH TO INVERT 0.6m
	MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
49.65 47.55 48.75(BD)	DRAINAGE INSPECTION CHAMBER; COVER LEVEL INVERT LEVEL (OF OUTGOING PIPE) bd (WHERE SHOWN) INDICATES BACK DROP
	DOMESTIC FOUL WASTE OUTLET POSITION
IMPORTANT WHERE MORE THAN 90 PROPERTIES ARE CONNECTED TO A FW DRAIN, THE PIPE DIAMETER SHALL BE INCREASED TO 150mm.	

CONSTRUCTION
ISSUE


C3	UPDATED TO SUIT RFI RESPONSES	MJR	MJR	JEC	24.01.22
C2	REVISED AS CLOUDED TO SUIT RFI RESPONSES	JM	JM	GH	16.06.20
C1	CONSTRUCTION ISSUE	JS	JM	GH	09.08.19
T2	KEY UPDATED	MJR	JM	GH	08.05.19
Rev	Description	Drn	Chk	App	Date

ARDENT

Third Floor
The Hallmark Building
52-56 Leadenhall Street
London
EC3M 5JE

Tel: 020 7680 4088
Web: www.ardent-ce.co.uk
E-mail: enquiries@ardent-ce.co.uk

CONSULTING ENGINEERS



www.ardent.co.uk
as a member of
SSIP
UK ASSOCIATION
OF SPECIALIST
INSPECTION
PRACTICES

Client	
--------	--

LINDEN HOMES SOUTH

Project Title:	


Project title:

**LAND EAST OF TYE LANE,
WALBERTON**

Drawing Title: PLOT DRAINAGE CA


PLOT DRAINAGE GA (SHEET 2 OF 9)		
A1 Scale 1:250	Date APRIL 2019	Designed by JM
Drawn by MSL	Checked by JM	Approved by GH

Drawing Number	LHS240-1212	Rev C3
----------------	-------------	-----------

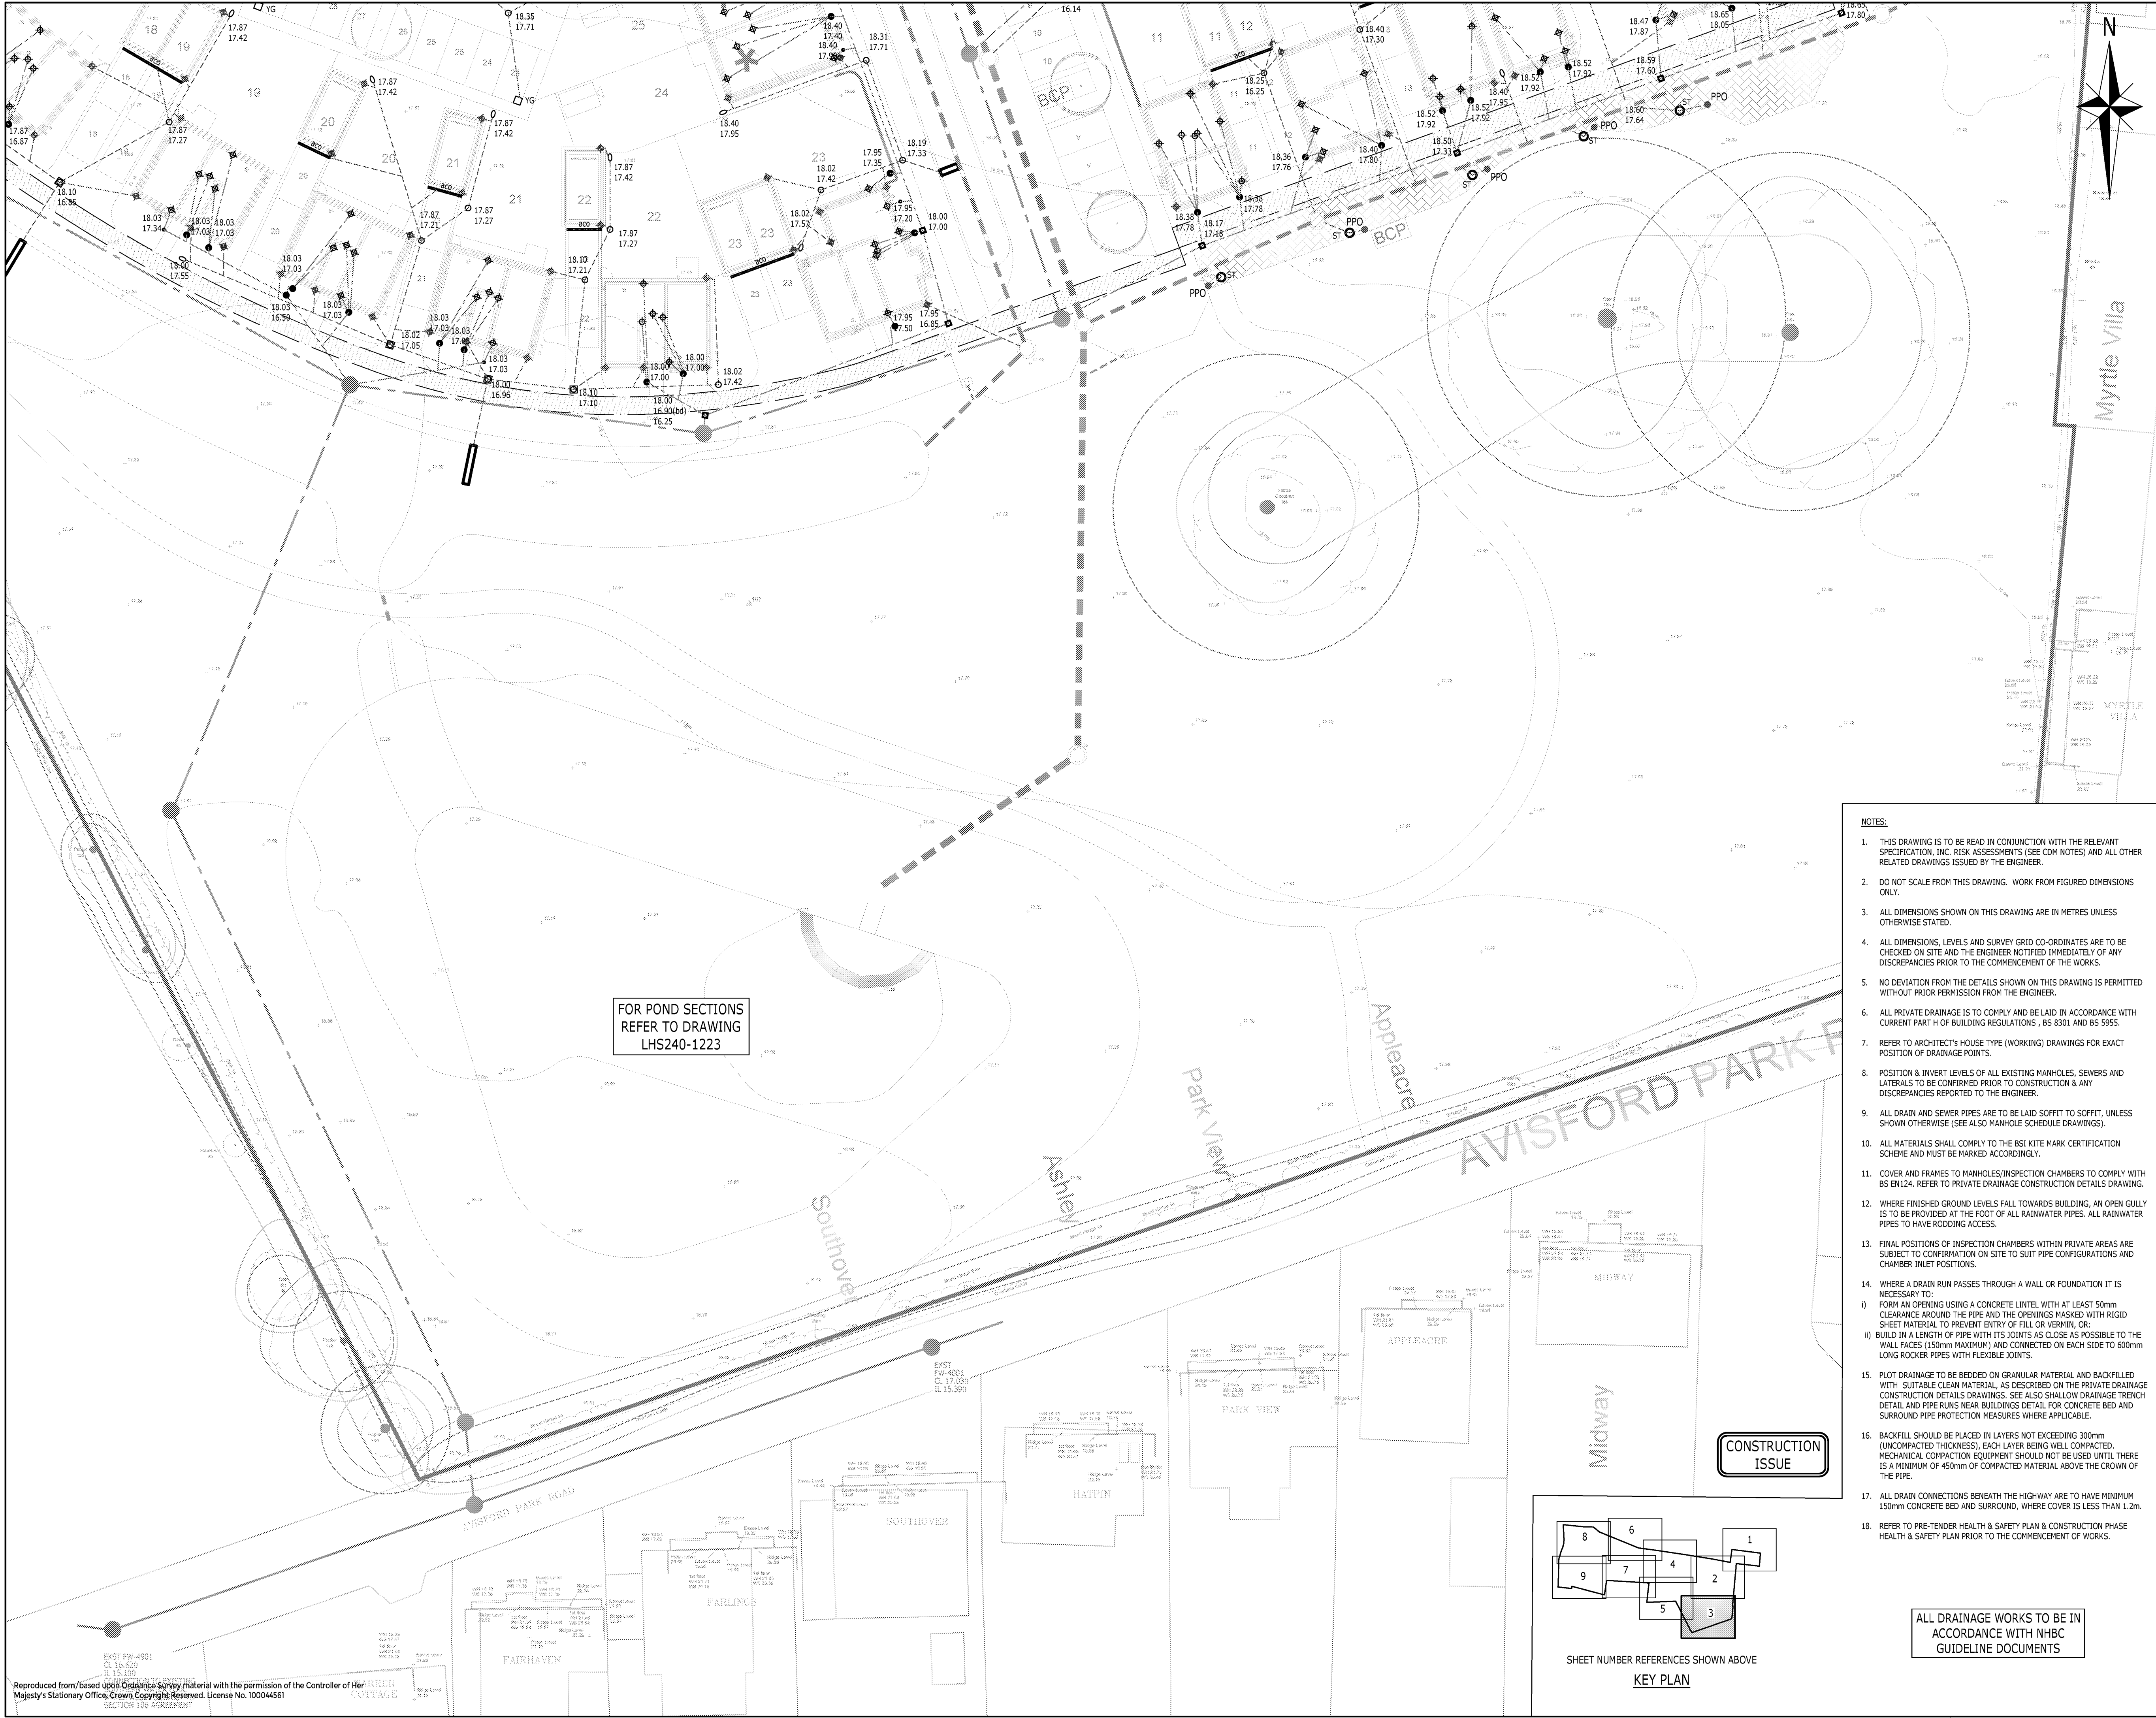

FOR POND SECTIONS
REFER TO DRAWING
LHS240-1223

CONSTRUCTION
ISSUE

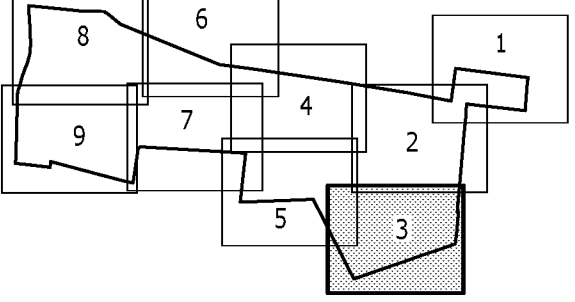

SHEET NUMBER REFERENCES SHOWN ABOVE
KEY PLAN

ALL DRAINAGE WORKS TO BE IN
ACCORDANCE WITH NHBC
GUIDELINE DOCUMENTS

NOTES:

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION, INC. RISK ASSESSMENTS (SEE CDM NOTES) AND ALL OTHER RELATED DRAWINGS ISSUED BY THE ENGINEER.
- DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
- ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES UNLESS OTHERWISE STATED.
- ALL DIMENSIONS, LEVELS AND SURVEY GRID CO-ORDINATES ARE TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF THE WORKS.
- NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PRIOR PERMISSION FROM THE ENGINEER.
- ALL PRIVATE DRAINAGE IS TO COMPLY AND BE LAID IN ACCORDANCE WITH CURRENT PART H OF BUILDING REGULATIONS, BS 8301 AND BS 5955.
- REFER TO ARCHITECT'S HOUSE TYPE (WORKING) DRAWINGS FOR EXACT POSITION OF DRAINAGE POINTS.
- POSITION & INVERT LEVELS OF ALL EXISTING MANHOLES, SEWERS AND LATERALS TO BE CONFIRMED PRIOR TO CONSTRUCTION & ANY DISCREPANCIES REPORTED TO THE ENGINEER.
- ALL DRAIN AND SEWER PIPES ARE TO BE LAID SOFFIT TO SOFFIT, UNLESS SHOWN OTHERWISE (SEE ALSO MANHOLE SCHEDULE DRAWINGS).
- ALL MATERIALS SHALL COMPLY TO THE BSI KITE MARK CERTIFICATION SCHEME AND MUST BE MARKED ACCORDINGLY.
- COVER AND FRAMES TO MANHOLES/INSPECTION CHAMBERS TO COMPLY WITH BS EN124. REFER TO PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWING.
- WHERE FINISHED GROUND LEVELS FALL TOWARDS BUILDING, AN OPEN GULLY IS TO BE PROVIDED AT THE FOOT OF ALL RAINWATER PIPES. ALL RAINWATER PIPES TO HAVE RODDING ACCESS.
- FINAL POSITIONS OF INSPECTION CHAMBERS WITHIN PRIVATE AREAS ARE SUBJECT TO CONFIRMATION ON SITE TO SUIT PIPE CONFIGURATIONS AND CHAMBER INLET POSITIONS.
- WHERE A DRAIN RUN PASSES THROUGH A WALL OR FOUNDATION IT IS NECESSARY TO:
i) FORM AN OPENING USING A CONCRETE LINTEL WITH AT LEAST 50mm CLEARANCE AROUND THE PIPE AND THE OPENINGS MASKED WITH RIGID SHEET MATERIAL TO PREVENT ENTRY OF FILL OR VERMIN, OR;
ii) BUILD IN A LENGTH OF PIPE WITH ITS JOINTS AS CLOSE AS POSSIBLE TO THE WALL FACES (150mm MAXIMUM) AND CONNECTED ON EACH SIDE TO 600mm LONG ROCKER PIPES WITH FLEXIBLE JOINTS.
- PLOT DRAINAGE TO BE BEDDED ON GRANULAR MATERIAL AND BACKFILLED WITH SUITABLE CLEAN MATERIAL, AS DESCRIBED ON THE PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWINGS. SEE ALSO SHALLOW DRAINAGE TRENCH DETAIL AND PIPE RUNS NEAR BUILDINGS DETAIL FOR CONCRETE BED AND SURROUND PIPE PROTECTION MEASURES WHERE APPLICABLE.
- BACKFILL SHOULD BE PLACED IN LAYERS NOT EXCEEDING 300mm (UNCOMPACTED THICKNESS), EACH LAYER BEING WELL COMPACTED. MECHANICAL COMPACTION EQUIPMENT SHOULD NOT BE USED UNTIL THERE IS A MINIMUM OF 450mm OF COMPACTED MATERIAL ABOVE THE CROWN OF THE PIPE.
- ALL DRAIN CONNECTIONS BENEATH THE HIGHWAY ARE TO HAVE MINIMUM 150mm CONCRETE BED AND SURROUND, WHERE COVER IS LESS THAN 1.2m.
- REFER TO PRE-TENDER HEALTH & SAFETY PLAN & CONSTRUCTION PHASE HEALTH & SAFETY PLAN PRIOR TO THE COMMENCEMENT OF WORKS.

KEY (SURFACE WATER):

- MAIN SW SEWER & MANHOLE (WITH REFERENCE) REFER TO MH SCHEDULE FOR FURTHER DETAILS
- PLOT SW DRAIN (100mmD UNLESS NOTED OTHERWISE)
- SW TYPE 4 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 3m OR TEGRA NON-ENTRY ACCESS CHAMBER (6000) FOR DEPTHS >3m BUT <5m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- SW TYPE 5 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 1m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- ST (WHERE SHOWN) INDICATES SILT TRAP - ALL SILT TRAPS TO BE 750mm DEEP FROM COVER TO INVERT
- 49.85
47.55
48.75(BD) DRAINAGE INSPECTION CHAMBER; COVER LEVEL INVERT LEVEL (OF OUTGOING PIPE) bd (WHERE SHOWN) INDICATES BACK DROP
- SW RODDING EYE TYPICAL DEPTH TO INVERT 0.45-0.6m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- RAIN WATER DOWNPIPE (100mmD DRAIN CONNECTION)
- 100mmD PERMEABLE PAVING OUTFALL PIPE (PPO) DEPTH TO INVERT LEVEL; 635mm (HEAVY DUTY CONSTRUCTION)
- 150mmD PERMAVOID SUB-BASE OUTFALL PIPE (PSO) DEPTH TO INVERT LEVEL; 740mm
- DIRECT SW CONNECTION TO SWALE (ACO INLET)
- POROUS PAVING
- 800 LINEAR DRAIN (ACO TYPE)
- 100 PROPRIETARY LINEAR THRESHOLD DRAIN TO FRONT DOOR OF PROPERTY
- ROAD GULLY (D400 COVER)
- YG YARD GULLY (C250 COVER)

IMPORTANT
WHERE MORE THAN 1 PROPERTY IS CONNECTED TO A SW DRAIN, THE PIPE DIAMETER SHALL BE INCREASED TO 150mm.

KEY (FOUL WATER):

- MAIN FW SEWER & MANHOLE (WITH REFERENCE) REFER TO MH SCHEDULE FOR FURTHER DETAILS
- INDICATIVE EXISTING SOUTHERN WATER PUBLIC FOUL SEWER
- PLOT FW DRAIN (100mmD UNLESS NOTED OTHERWISE)
- FW TYPE 4 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 3m OR TEGRA NON-ENTRY ACCESS CHAMBER (6000) FOR DEPTHS >3m BUT <5m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- FW TYPE 5 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 1m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- FW TYPE 6A MINI INSPECTION CHAMBER (<3000) MAX DEPTH TO INVERT 0.6m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- 49.85
47.55
48.75(BD) DRAINAGE INSPECTION CHAMBER; COVER LEVEL INVERT LEVEL (OF OUTGOING PIPE) bd (WHERE SHOWN) INDICATES BACK DROP
- DOMESTIC FOUL WASTE OUTLET POSITION

IMPORTANT
WHERE MORE THAN 9 PROPERTIES ARE CONNECTED TO A FW DRAIN, THE PIPE DIAMETER SHALL BE INCREASED TO 150mm.

C2	RPI 26 - PIPE SIZE NOTE UPDATED	MJR	MJR	JEC	24.01.22
C1	CONSTRUCTION ISSUE	JS	JM	GH	09.08.19
T3	SERVICE STRIP MOVED	JS	JM	GH	19.07.19
T2	KEY UPDATED	MJR	JM	GH	08.05.19
Rev	Description	Drn	Chk	App	Date

ARDENT CONSULTING ENGINEERS


Third Floor,
The Haimark Building
52-56 Leadenhall Street
London
EC3M 5JE

Tel: 020 7680 4088
Web: www.ardent-ce.co.uk
E-mail: enquiries@ardent-ce.co.uk

worksafe consultant
www.worksafeconsultant.co.uk

SSIP
SPECIALIST INSTITUTE FOR THE SURVEILLANCE OF THE CONSTRUCTION INDUSTRY

Client					
LINDEN HOMES SOUTH					
Project Title:					
LAND EAST OF TYE LANE, WALBERTON					
Drawing Title:					
PLOT DRAINAGE GA (SHEET 3 OF 9)					
A1 Scale	Date	Designed by			
1:250	APRIL 2019	JM			
Drawn by	Checked by	Approved by			
MSL	JM	GH			
Drawing Number					Rev
LHS240-1213					C2

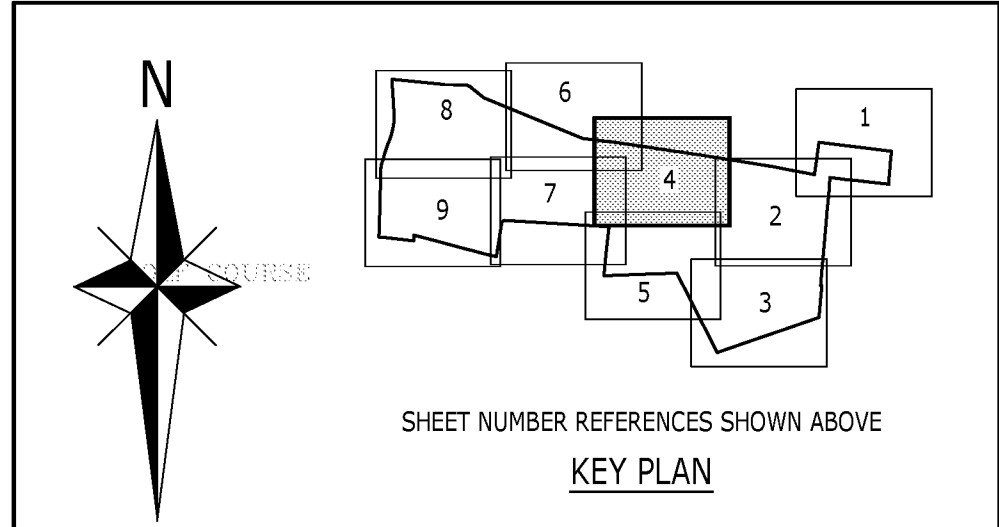

SHEET NUMBER REFERENCES SHOWN ABOVE
KEY PLAN

CONSTRUCTION
ISSUE

NOTES:

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION, INC. RISK ASSESSMENTS (SEE CDM NOTES) AND ALL OTHER RELATED DRAWINGS ISSUED BY THE ENGINEER.
- DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
- ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES UNLESS OTHERWISE STATED.
- ALL DIMENSIONS, LEVELS AND SURVEY GRID CO-ORDINATES ARE TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF THE WORKS.
- NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PRIOR PERMISSION FROM THE ENGINEER.
- ALL PRIVATE DRAINAGE IS TO COMPLY AND BE LAID IN ACCORDANCE WITH CURRENT PART H OF BUILDING REGULATIONS, BS 8301 AND BS 5955.
- REFER TO ARCHITECT'S HOUSE TYPE (WORKING) DRAWINGS FOR EXACT POSITION OF DRAINAGE POINTS.
- POSITION & INVERT LEVELS OF ALL EXISTING MANHOLES, SEWERS AND LATERALS TO BE CONFIRMED PRIOR TO CONSTRUCTION & ANY DISCREPANCIES REPORTED TO THE ENGINEER.
- ALL DRAIN AND SEWER PIPES ARE TO BE LAID SOFFIT TO SOFFIT, UNLESS SHOWN OTHERWISE (SEE ALSO MANHOLE SCHEDULE DRAWINGS).
- ALL MATERIALS SHALL COMPLY TO THE BSI KITE MARK CERTIFICATION SCHEME AND MUST BE MARKED ACCORDINGLY.
- COVER AND FRAMES TO MANHOLES/INSPECTION CHAMBERS TO COMPLY WITH BS EN124. REFER TO PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWING.
- WHERE FINISHED GROUND LEVELS FALL TOWARDS BUILDING, AN OPEN GULLY IS TO BE PROVIDED AT THE FOOT OF ALL RAINWATER PIPES. ALL RAINWATER PIPES TO HAVE RODDING ACCESS.
- FINAL POSITIONS OF INSPECTION CHAMBERS WITHIN PRIVATE AREAS ARE SUBJECT TO CONFIRMATION ON SITE TO SUIT PIPE CONFIGURATIONS AND CHAMBER INLET POSITIONS.
- WHERE A DRAIN RUN PASSES THROUGH A WALL OR FOUNDATION IT IS NECESSARY TO:
i) FORM AN OPENING USING A CONCRETE LINTEL WITH AT LEAST 50mm CLEARANCE AROUND THE PIPE AND THE OPENINGS MASKED WITH RIGID SHEET MATERIAL TO PREVENT ENTRY OF FILL OR VERMIN, OR;
ii) BUILD IN A LENGTH OF PIPE WITH ITS JOINTS AS CLOSE AS POSSIBLE TO THE WALL FACES (150mm MAXIMUM) AND CONNECTED ON EACH SIDE TO 600mm LONG ROCKER PIPES WITH FLEXIBLE JOINTS.
- PLOT DRAINAGE TO BE BEDDED ON GRANULAR MATERIAL AND BACKFILLED WITH SUITABLE CLEAN MATERIAL, AS DESCRIBED ON THE PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWINGS. SEE ALSO SHALLOW DRAINAGE TRENCH DETAIL AND PIPE RUNS NEAR BUILDINGS DETAIL FOR CONCRETE BED AND SURROUND PIPE PROTECTION MEASURES WHERE APPLICABLE.
- BACKFILL SHOULD BE PLACED IN LAYERS NOT EXCEEDING 300mm (UNCOMPACTED THICKNESS), EACH LAYER BEING WELL COMPACTED. MECHANICAL COMPACTION EQUIPMENT SHOULD NOT BE USED UNTIL THERE IS A MINIMUM OF 450mm OF COMPACTED MATERIAL ABOVE THE CROWN OF THE PIPE.
- ALL DRAIN CONNECTIONS BENEATH THE HIGHWAY ARE TO HAVE MINIMUM 150mm CONCRETE BED AND SURROUND, WHERE COVER IS LESS THAN 1.2m.
- REFER TO PRE-TENDER HEALTH & SAFETY PLAN & CONSTRUCTION PHASE HEALTH & SAFETY PLAN PRIOR TO THE COMMENCEMENT OF WORKS.

ALL DRAINAGE WORKS TO BE IN
ACCORDANCE WITH NHC
GUIDELINE DOCUMENTS

KEY (SURFACE WATER):

- MAIN SW SEWER & MANHOLE (WITH REFERENCE) REFER TO MH SCHEDULE FOR FURTHER DETAILS
- PLOT SW DRAIN (100mmØ UNLESS NOTED OTHERWISE)
- SW TYPE 4 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 3m ØR TEGRA NON-ENTRY ACCESS CHAMBER (6000) FOR DEPTHS >3m BUT <5m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- SW TYPE 5 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 1m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- ST (WHERE SHOWN) INDICATES SILT TRAP - ALL SILT TRAPS TO BE 750mm DEEP FROM COVER TO INVERT
- 49.85
47.55
48.75(BD) DRAINAGE INSPECTION CHAMBER; COVER LEVEL INVERT LEVEL (OF OUTGOING PIPE) bd (WHERE SHOWN) INDICATES BACK DROP
- SW RODDING EYE TYPICAL DEPTH TO INVERT 0.45-0.6m MAX LOADING - LIGHT VEHICULAR, FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- RAIN WATER DOWNPIPE (100mmØ DRAIN CONNECTION)
- PPO 100mmØ PERMEABLE PAVING OUTFALL PIPE (PPO) DEPTH TO INVERT LEVEL: 635mm (HEAVY DUTY CONSTRUCTION)
- PSO 150mmØ PERMAVOID SUB-BASE OUTFALL PIPE (PSO) DEPTH TO INVERT LEVEL: 740mm
- DIRECT SW CONNECTION TO SWALE (ACO INLET)
- 150mmØ PERFORATED PIPE
- POROUS PAVING
- ROD LINEAR DRAIN (ACO TYPE)
- Proprietary Linear Threshold Drain to Front Door of Property
- ROAD GULLY (D400 COVER)
- YARD GULLY (C250 COVER)

IMPORTANT
WHERE MORE THAN 1 PROPERTY IS CONNECTED TO A SW DRAIN, THE PIPE DIAMETER SHALL BE INCREASED TO 150mm.

KEY (FOUL WATER):

- MAIN FW SEWER & MANHOLE (WITH REFERENCE) REFER TO MH SCHEDULE FOR FURTHER DETAILS
- INDICATIVE EXISTING SOUTHERN WATER PUBLIC FOUL SEWER
- PLOT FW DRAIN (100mmØ UNLESS NOTED OTHERWISE)
- FW TYPE 4 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 3m ØR TEGRA NON-ENTRY ACCESS CHAMBER (6000) FOR DEPTHS >3m BUT <5m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- FW TYPE 5 NON-ENTRY ACCESS CHAMBER (4500) MAX DEPTH TO INVERT 1m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- FW TYPE 6A MINI INSPECTION CHAMBER (<3000) MAX DEPTH TO INVERT 0.6m MAX LOADING - LIGHT VEHICULAR FLEXIBLE CONSTRUCTION (CONCRETE COLLAR REQUIRED FOR VEHICULAR LOADING)
- DRAINAGE INSPECTION CHAMBER; COVER LEVEL INVERT LEVEL (OF OUTGOING PIPE) bd (WHERE SHOWN) INDICATES BACK DROP
- DOMESTIC FOUL WASTE OUTLET POSITION

IMPORTANT
WHERE MORE THAN 9 PROPERTIES ARE CONNECTED TO A FW DRAIN, THE PIPE DIAMETER SHALL BE INCREASED TO 150mm.

C4	PLOT 47 SURFACE WATER DRAINAGE AMENDED FOLLOWING COMMENTS FROM SITE	MJR	MJR	JEC	30.09.22
C3	RPI 26 - PIPE SIZE NOTE UPDATED	MJR	MJR	JEC	24.01.22
C2	REVISED AS CLOUDED TO SUIT RPI RESPONSES	JM	JM	GH	16.06.20
C1	CONSTRUCTION ISSUE	JS	JM	GH	09.08.19
T2	KEY UPDATED	MJR	JM	GH	08.05.19
Rev	Description	Drn	Chk	App	Date

ARDENT CONSULTING ENGINEERS

Third Floor,
The Hallmark Building
52-56 Leadenhall Street
London
EC3M 5JE

Tel: 020 7680 4088
Web: www.ardent-ce.co.uk
E-mail: enquiries@ardent-ce.co.uk


worksafe
consultant
www.smauid.co.uk

SSIP
SPECIALIST
MEMBER

Client				
LINDEN HOMES SOUTH				
Project Title:				
LAND EAST OF TYE LANE, WALBERTON				
Drawing Title:				
PLOT DRAINAGE GA (SHEET 4 OF 9)				
A1 Scale	Date	Designed by		
1:250	APRIL 2019	JM		
Drawn by	Checked by	Approved by		
MSL	JM	GH		
Drawing Number	LHS240-1214			Rev C

APPENDIX C

Surface Water Drainage Phasing Plan (Drawing number LHS240-1240)

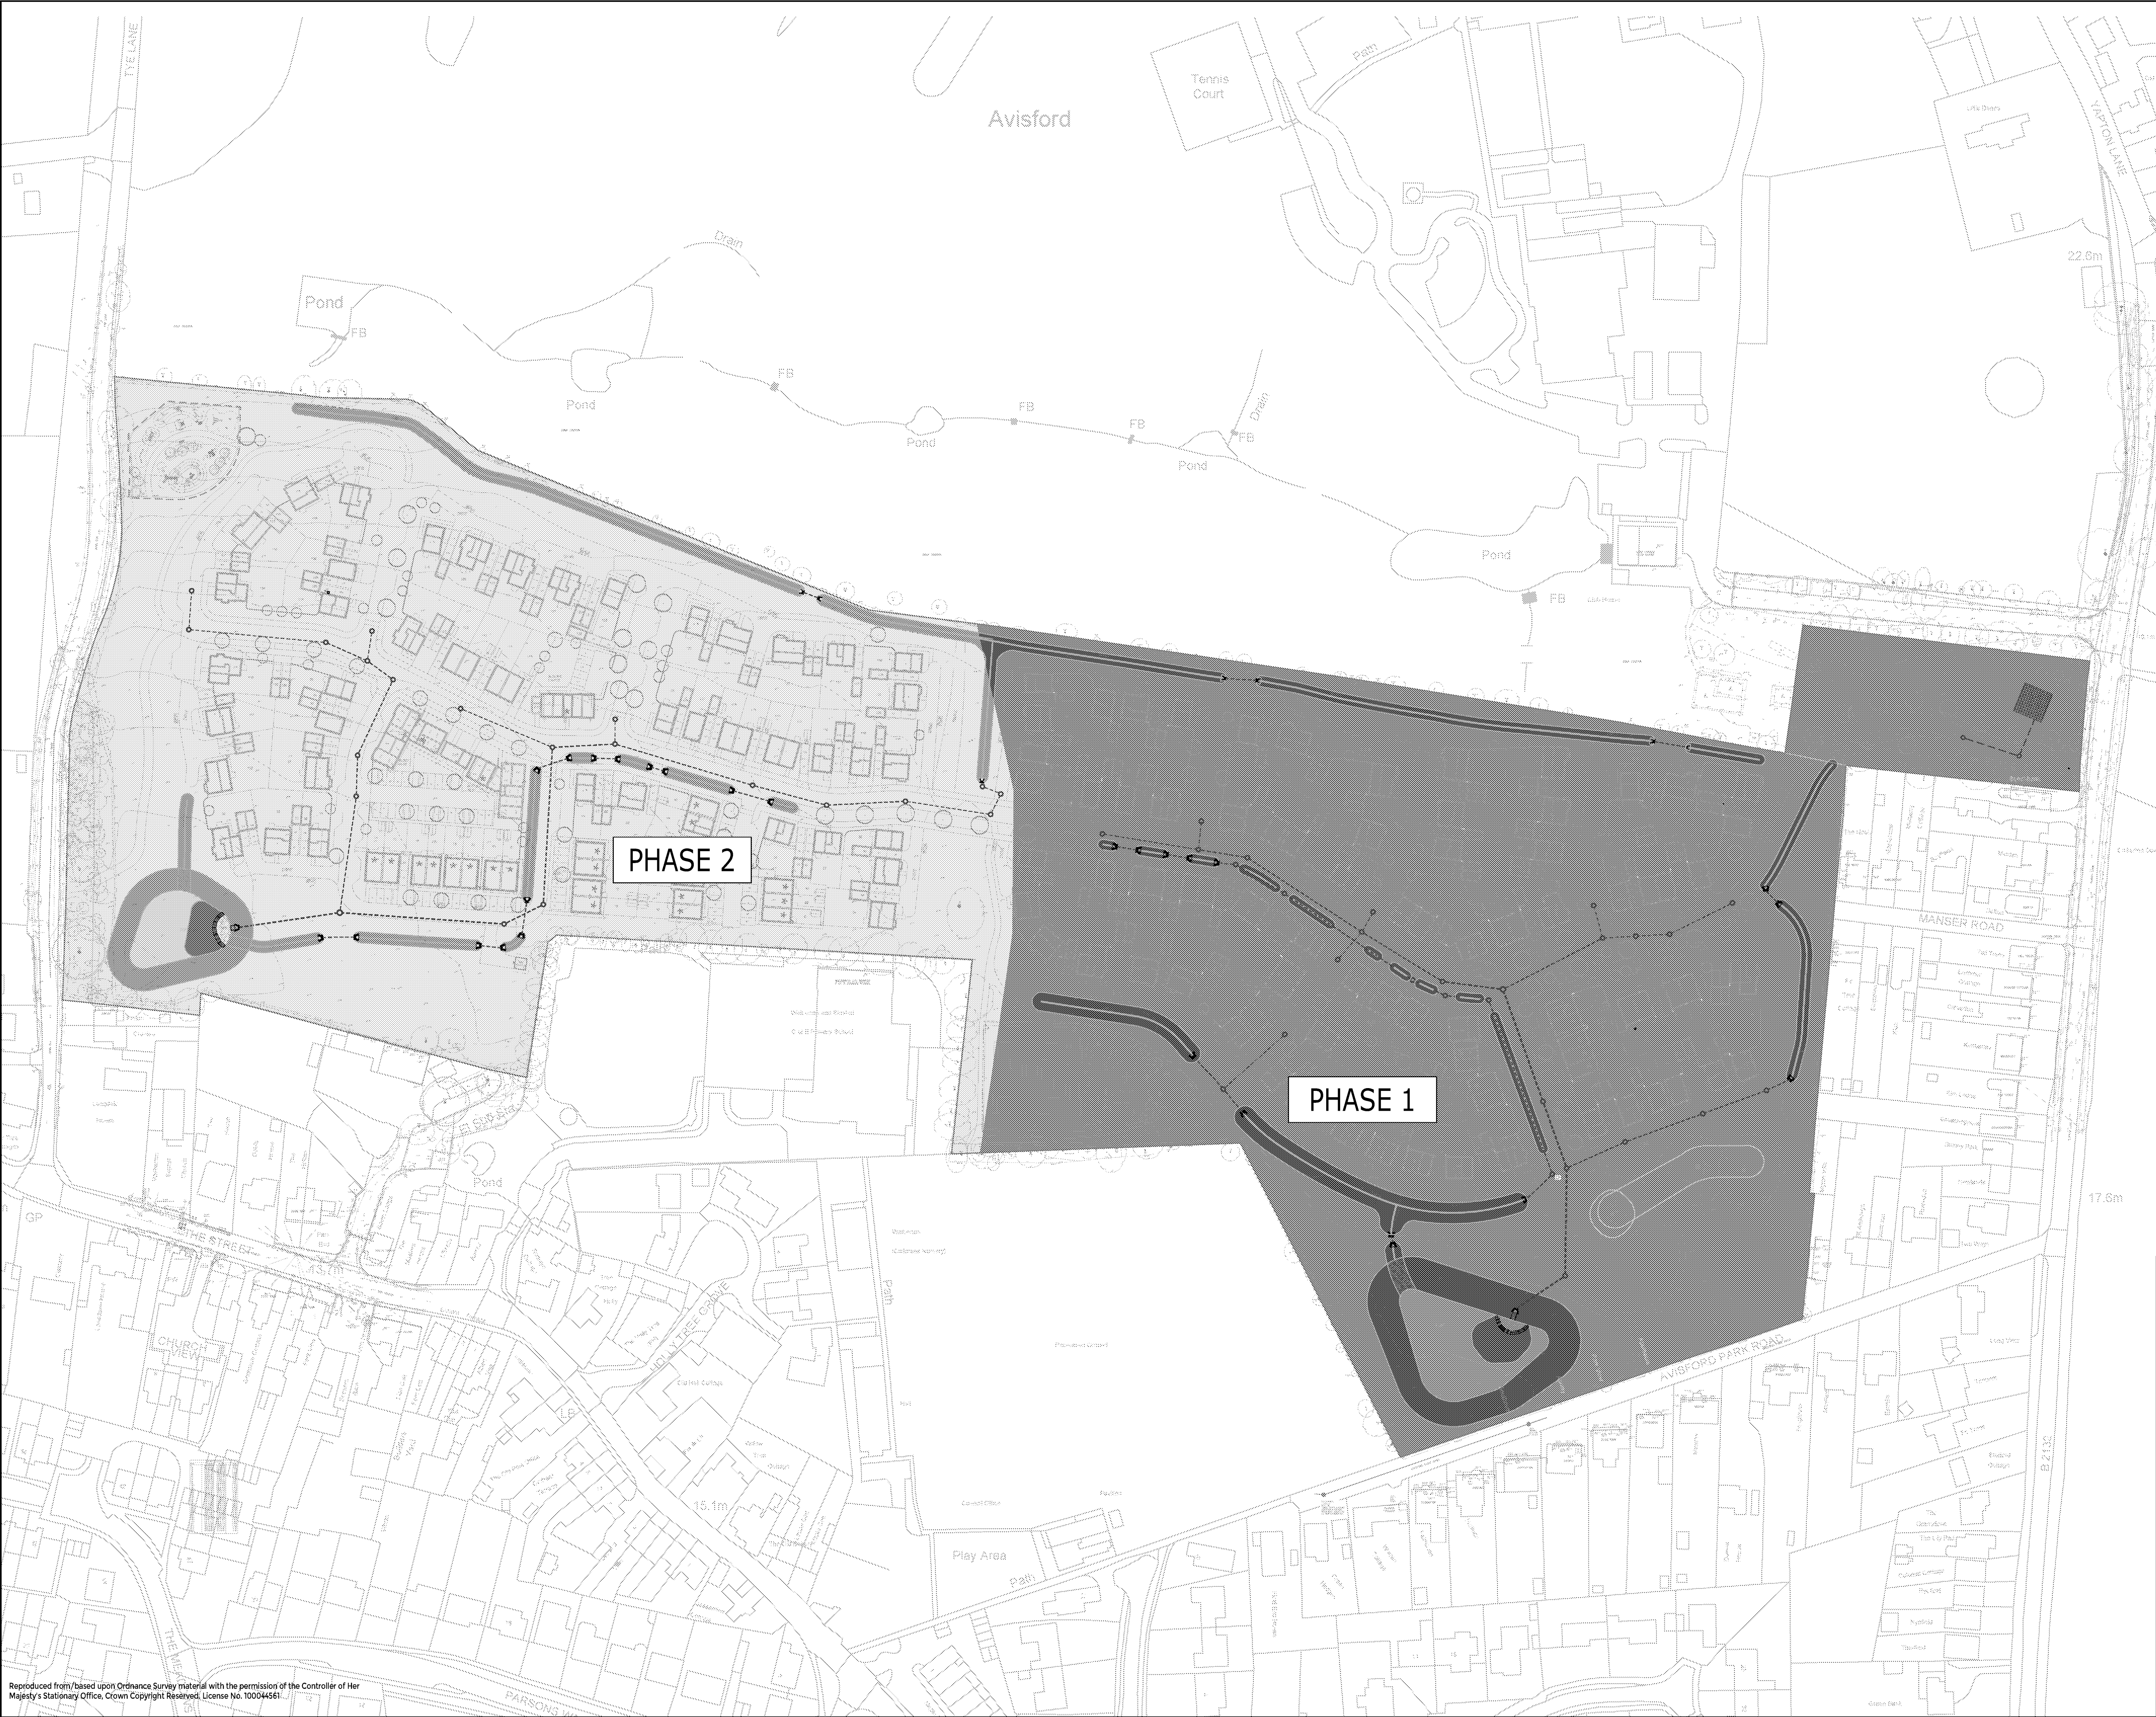


- NOTES:**
- THIS DRAWING IS BASED ON THE TOPOGRAPHIC SURVEY UNDERTAKEN BY GEOMATIC SURVEYORS DRAWING NUMBER 258WT01, DATED NOVEMBER 2019.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ARDENT CONSULTING ENGINEERS' DRAWING NUMBER LHS240-1201, TITLED MAIN DRAINAGE PLAN DATED APRIL 2019.

LEGEND

- SW1.6
CL 13.000
IL 14.983
- PROPOSED SURFACE WATER SEWER
& MANHOLE WITH REFERENCE AND
LEVEL INFORMATION
- ATTENUATION BASIN

FOR INFORMATION
ONLY

Rev	Description	Dn	Chk	App	Date
ARDENT CONSULTING ENGINEERS					
Third Floor The Hailmark Building 52-56 Leadenhall Street London EC3M 5JE					
Tel: 020 7680 4088 Web: www.ardent-ce.co.uk E-mail: enquiries@ardent-ce.co.uk					
 					

Client					
LINDEN HOMES SOUTH					
Project Title					
LAND EAST OF TYE LANE, WALBERTON					
Drawing Title					
SURFACE WATER DRAINAGE PHASING PLAN					
A1 Scale	Date	Designed by			
1:1000	21.12.23	IL			
Drawn by	Checked by	Approved by			
IL	MJR	-			
Drawing Number					Rev
LHS240-1240					-

APPENDIX D

Drainage Operation and Maintenance Log (pro-forma)

Site Maintenance Supervisor: _____ Date: _____


☐ Routine ☐ Response to rainfall event Other: ☐ _____

BMP	Frequency	Date Performed	Comments
Gullies and Manholes	Monthly inspections		
	Maintenance quarterly and as necessary		
Headwalls	Inspect and identify areas not operating properly every 3 months (for the first 3 months) and every 6 months after.		
	Monthly safety grille inspection and remove debris		
Pavement Areas (parking, driveways, service areas)	Monthly sweeping		
	Rubbish & litter removal as necessary		
Landscaped and Vegetated Areas	Maintenance as necessary		
Swale	Monthly grass cutting and litter removal		
Pipework	Sediment and litter removal monthly		
	Root ingress removed as necessary		

APPENDIX E

Phased SuDS Estate Key Plan (Sheet 1 of 2) (Drawing number LHS240-5400)

- NOTES:
- THIS DRAWING IS BASED ON THE TOPOGRAPHIC SURVEY UNDERTAKEN BY GEOMATIC SURVEYORS DRAWING NUMBER 258WTS, DATED NOVEMBER 2019.
 - THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ARDENT CONSULTING ENGINEERS' DRAWING NUMBER LHS240-1261, TITLED MAIN DRAINAGE PLAN DATED APRIL 2019.

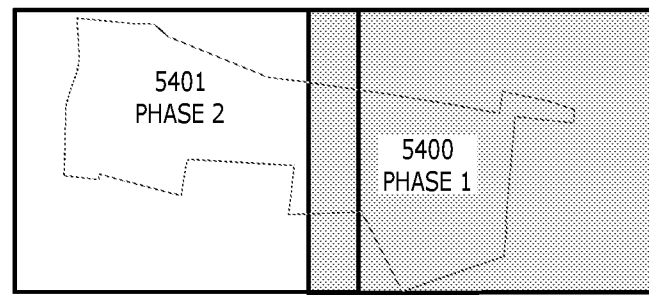

SHEET NUMBER REFERENCES SHOWN ABOVE
KEY PLAN

LEGEND

- SITE BOUNDARY
- PROPOSED PERMEABLE PAVING
- PROPOSED SWALE
- PROPOSED LINED SWALE
- PROPOSED CONVEYANCE SWALE
- PROPOSED HEADWALLS
- PROPOSED CATCHPIT MANHOLE
- PROPOSED INFILTRATION BASIN

FOR INFORMATION ONLY

Rev Description Dm Cks App Date

ARDENT CONSULTING ENGINEERS

Third Floor
The Helmark Building
52-56 Leadenhall Street
London
EC3M 5JE
Tel: 020 7680 4088
Web: www.ardent-ce.co.uk
E-mail: enquiries@ardent-ce.co.uk

Client

VISTRY SOUTH EAST

Project Title:

LAND EAST OF TYE LANE,
WALBERTON

Drawing Title:

PHASED SUDS ESTATE
KEY PLAN - PHASE 1

AO Scale Date Designed by

1:500 18.03.25 MJR

Drawn by MJC Checked by MJC Approved by JEC



Drawing Number LHS240-5400 Rev

File created: g:\projects\project1261\1261-land east of tye lane, vistry south east\ardent\drawings\1261-5400-5400-key plan.dwg


Reproduced from/based upon Ordnance Survey material with the permission of the Controller of Her Majesty's Stationery Office. Crown Copyright Reserved. License No. 10004561

APPENDIX F


Drainage Construction Details (Drawing numbers LHS240-1221-1223)

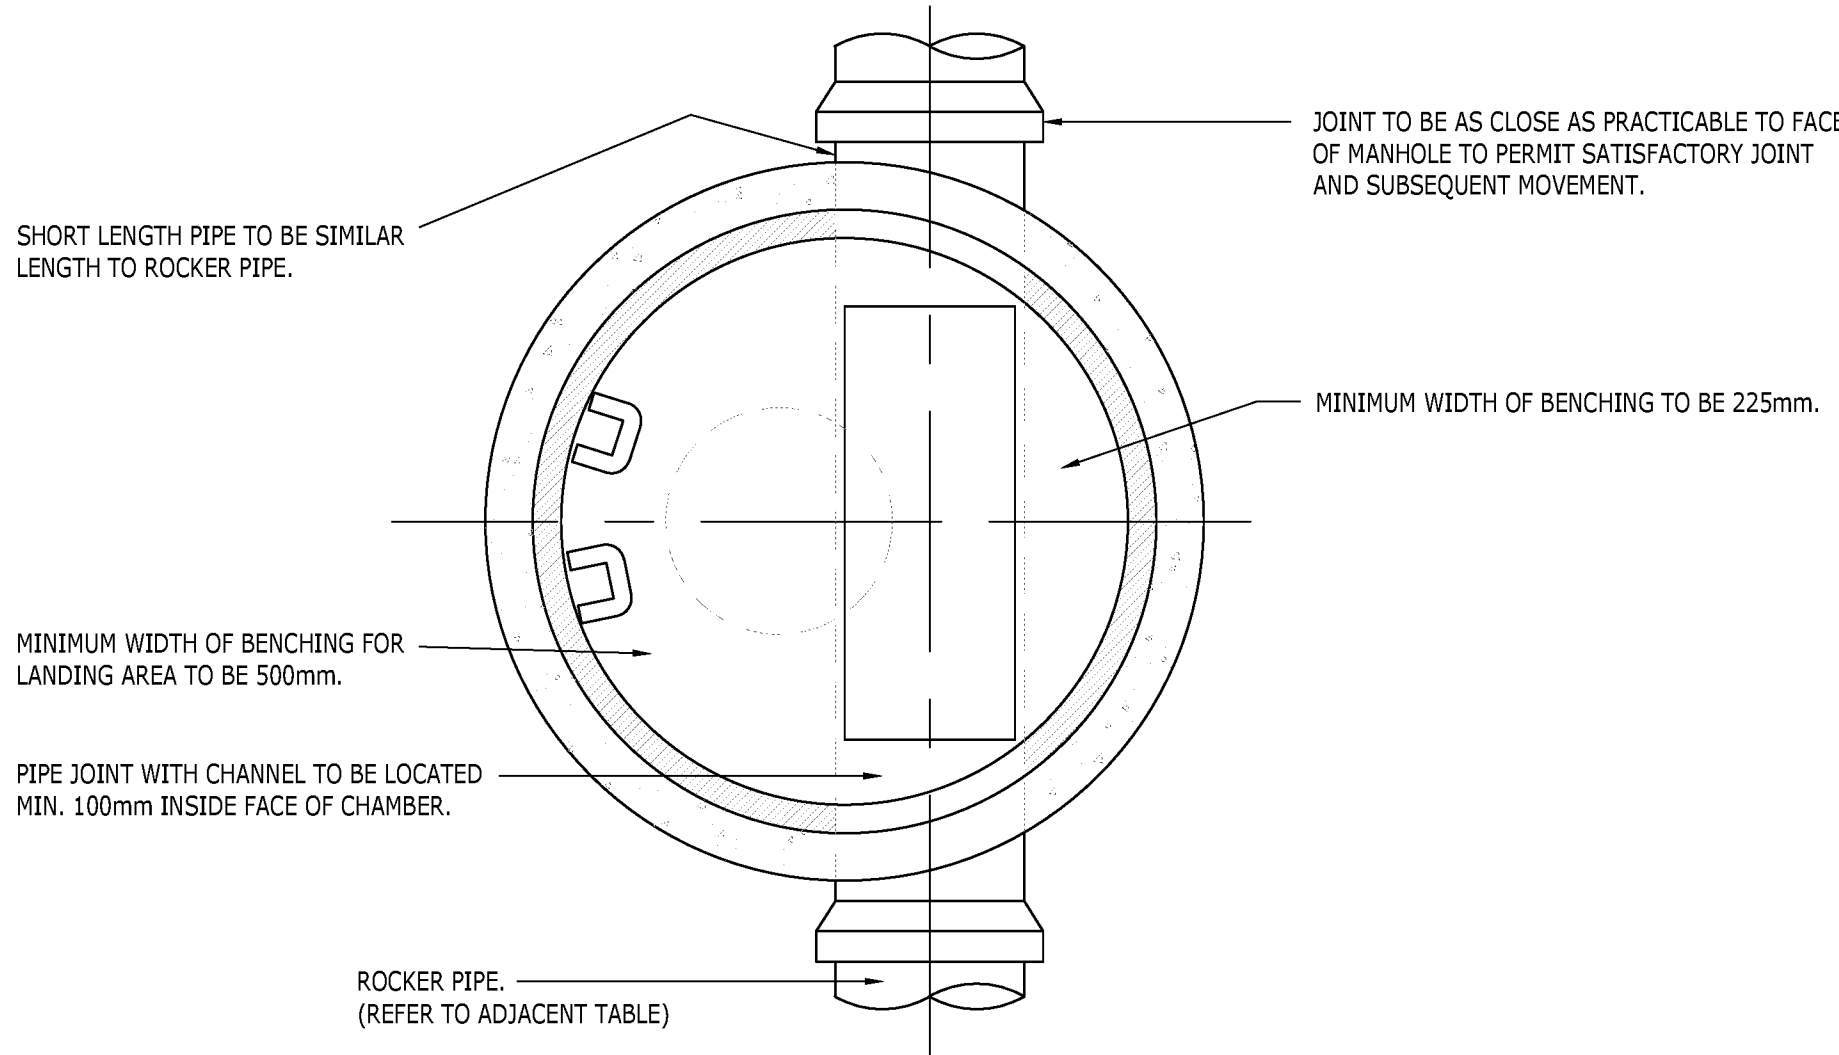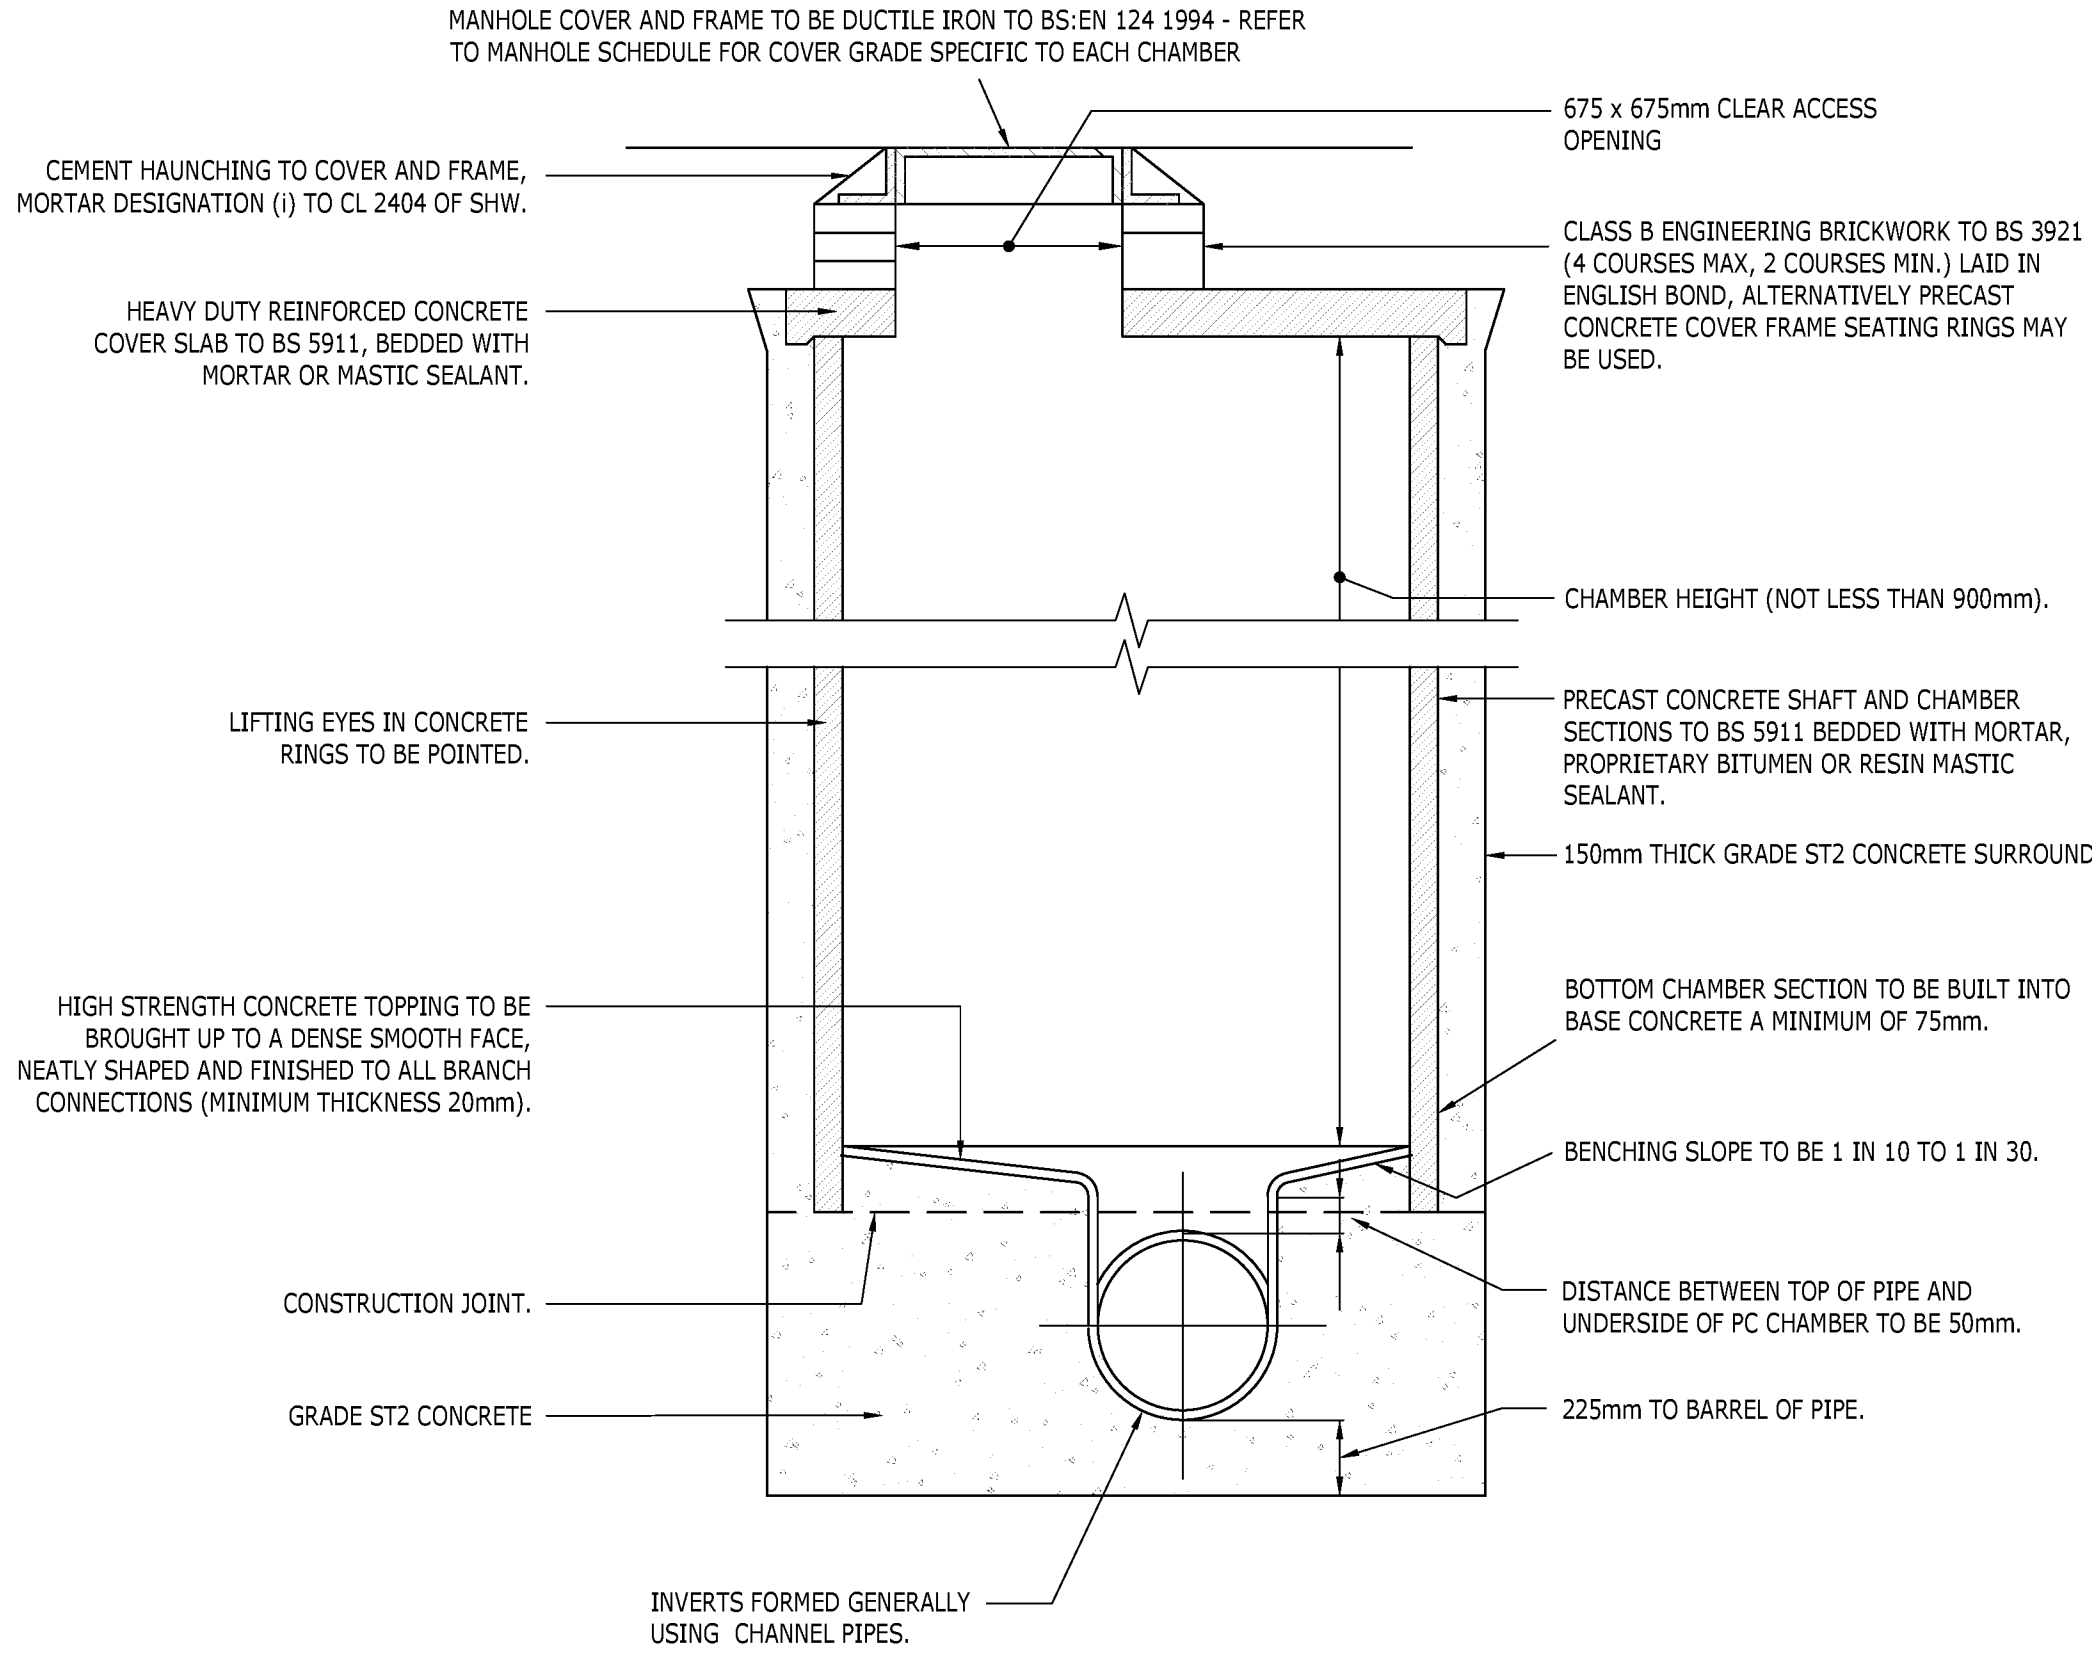

PRIVATE MANHOLE TYPE B
(MAX DEPTH FROM COVER LEVEL TO SOFFIT OF PIPE 3.0m)

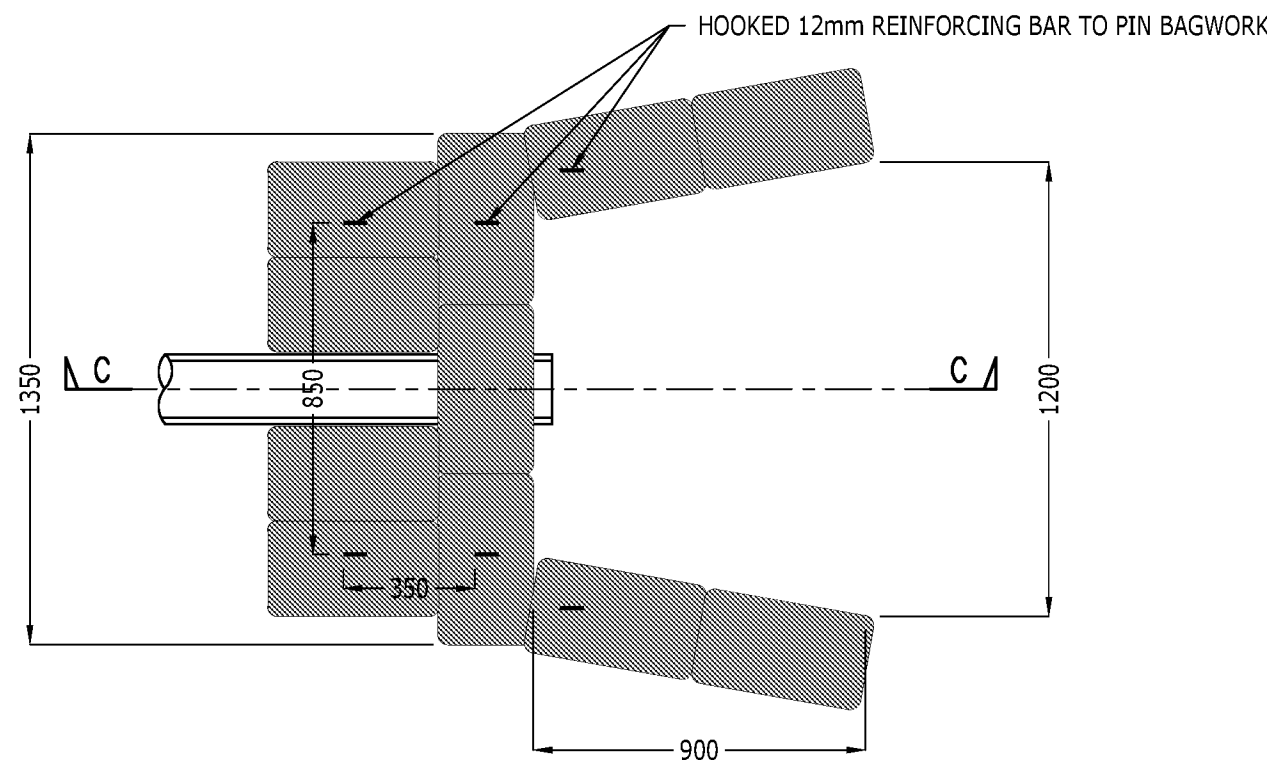

INLET/OUTLET SWALE HEADWALL PLAN

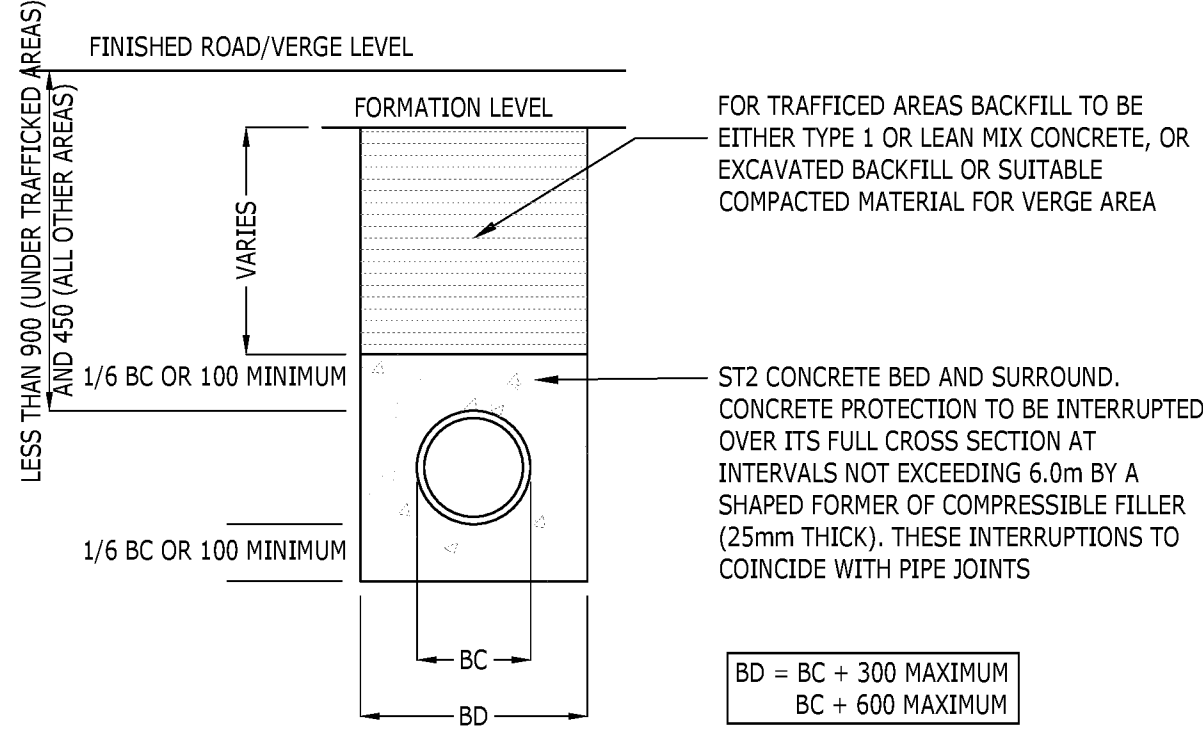


SHALLOW TRENCH DETAIL


1.0m x 0.5m x 0.4m(D) WAVIN AQUACELL PLUS GEO-CELLULAR PLASTIC STORAGE CRATES OR SIMILAR APPROVED TO SUIT DEPTH OF CRATE INVERT - INSTALLED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS

WRAPPED IN PERMEABLE GEOMEMBRANE - INSTALLED IN ACCORDANCE WITH MANUFACTURERS SPECIFICATIONS AND DETAILS

100mm MIN. WELL COMPACTED COARSE SAND CUSHION LAYER

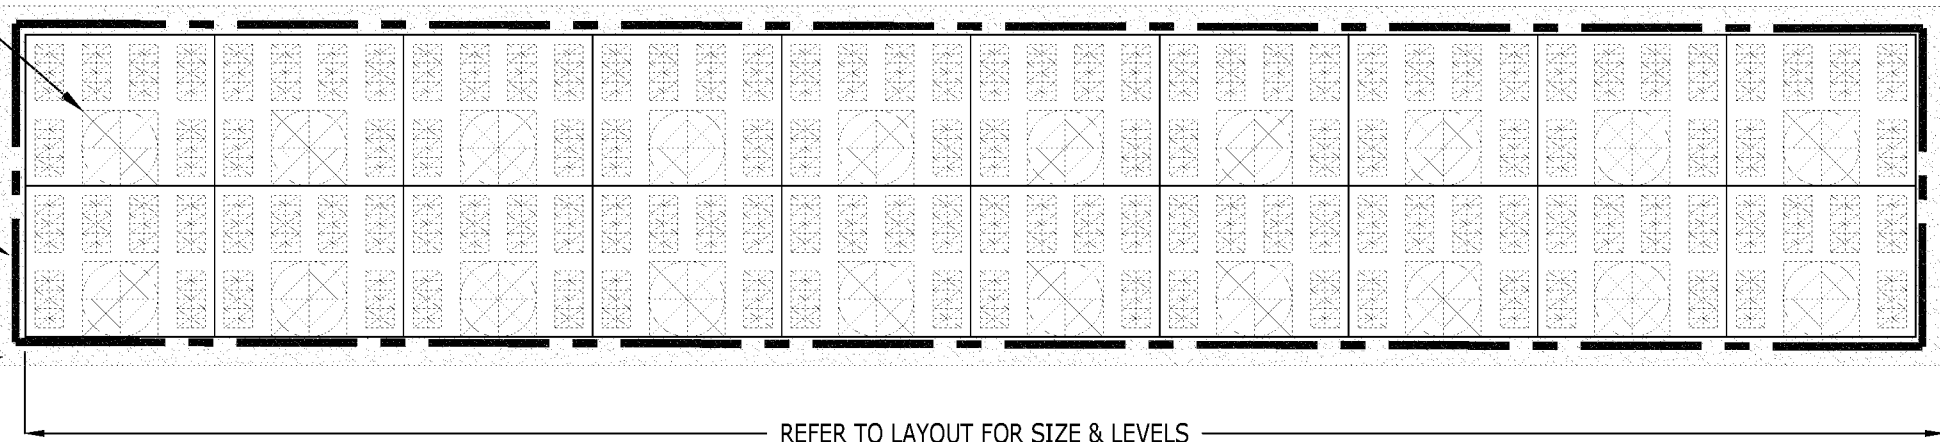

TYPICAL CELLULAR SOAKAWAY DETAIL
(1:20)

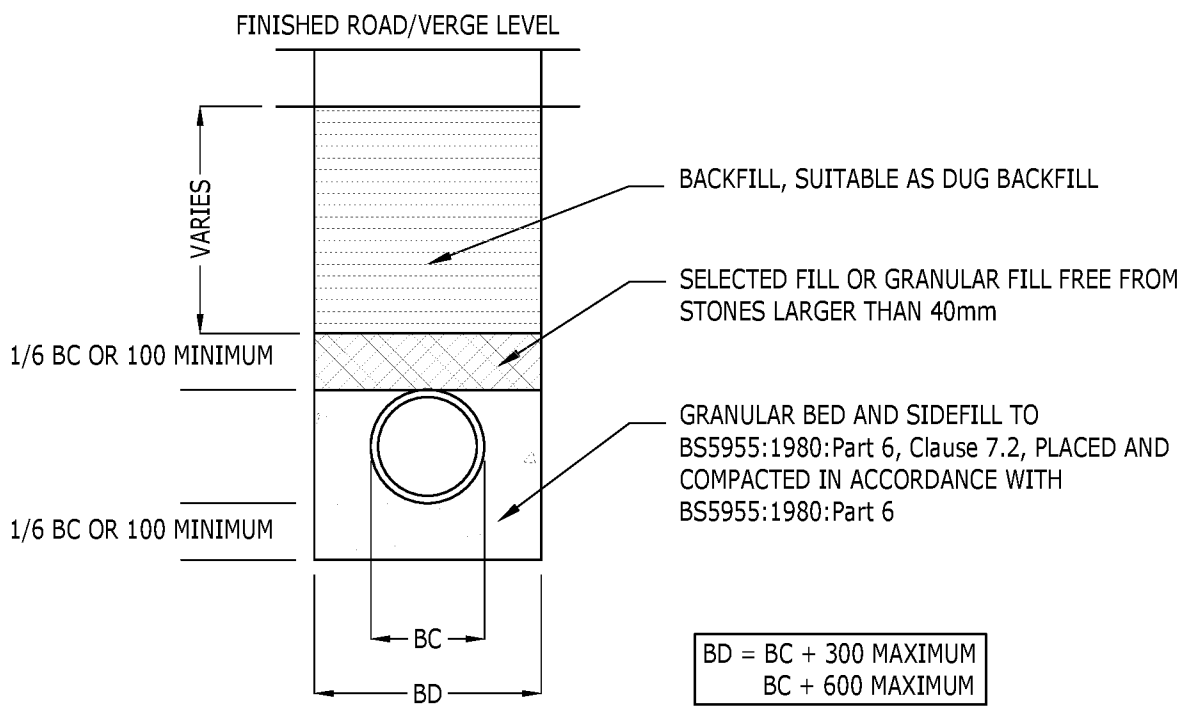

TYPICAL TRENCH DETAIL

ALL PIPES ENTERING OR LEAVING MANHOLES SHALL HAVE A FLEXIBLE JOINT WITHIN 600mm OF THE INSIDE FACE OF THE MANHOLE. THE NEXT PIPE SHALL BE A SHORT "ROCKER PIPE" WITH LENGTH AS TABLE BELOW.


ROCKER PIPES	
SEWER DIAMETER (mm)	EFFECTIVE LENGTH (mm)
150 TO 600	600
675 TO 750	1000
825 AND OVER	1250

TABLE 1


NOTES:

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION, INC. RISK ASSESSMENTS (SEE COM NOTES) AND ALL OTHER RELATED DRAWINGS ISSUED BY THE ENGINEER.
- DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
- ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES UNLESS OTHERWISE STATED.
- ALL DIMENSIONS, LEVELS AND SURVEY GRID CO-ORDINATES ARE TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF THE WORKS.
- NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PRIOR PERMISSION FROM THE ENGINEER.
- ALL PRIVATE DRAINAGE IS TO COMPLY AND BE LAID IN ACCORDANCE WITH CURRENT PART H OF BUILDING REGULATIONS, BS 8301 AND BS 5955.
- REFER TO ARCHITECT'S HOUSE TYPE (WORKING) DRAWINGS FOR EXACT POSITION OF DRAINAGE POINTS.
- POSITION & INVERT LEVELS OF ALL EXISTING MANHOLES, SEWERS AND LATERALS TO BE CONFIRMED PRIOR TO CONSTRUCTION & ANY DISCREPANCIES REPORTED TO THE ENGINEER.
- ALL DRAIN AND SEWER PIPES ARE TO BE LAID SOFFIT TO FIT, UNLESS SHOWN OTHERWISE (SEE ALSO MANHOLE SCHEDULE DRAWINGS).
- ALL PLOT DRAINAGE TO BE 100mm Ø UNLESS SHOWN OTHERWISE, LAID IN ACCORDANCE WITH BS 8301.
- ALL MATERIALS SHALL COMPLY TO THE BS1 KITE MARK CERTIFICATION SCHEME AND MUST BE MARKED ACCORDINGLY.
- COVER AND FRAMES TO MANHOLES/INSPECTION CHAMBERS TO COMPLY WITH BS EN124. REFER TO PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWING.
- WHERE FINISHED GROUND LEVELS FALL TOWARDS BUILDING, AN OPEN GILLY IS TO BE PROVIDED AT THE FOOT OF ALL RAINWATER PIPES. ALL RAINWATER PIPES TO HAVE RODDING ACCESS.
- FINAL POSITIONS OF INSPECTION CHAMBERS WITHIN PRIVATE AREAS ARE SUBJECT TO CONFIRMATION ON SITE TO SUIT PIPE CONFIGURATIONS AND CHAMBER INLET POSITIONS.
- WHERE A DRAIN RUN PASSES THROUGH A WALL OR FOUNDATION IT IS NECESSARY TO:
 - FORM AN OPENING USING A CONCRETE LINTEL WITH AT LEAST 50mm CLEARANCE AROUND THE PIPE AND THE OPENINGS MASKED WITH RIGID SHEET MATERIAL TO PREVENT ENTRY OF FILL OR VERMIN, OR;
 - BUILD IN A LENGTH OF PIPE WITH ITS JOINTS AS CLOSE AS POSSIBLE TO THE WALL FACES (150mm MAXIMUM) AND CONNECTED ON EACH SIDE TO 600mm LONG ROCKER PIPES WITH FLEXIBLE JOINTS.
- PLOT DRAINAGE TO BE BEDDED ON GRANULAR MATERIAL AND BACKFILLED WITH SUITABLE CLEAN MATERIAL, AS DESCRIBED ON THE PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWINGS. SEE ALSO SHALLOW DRAINAGE TRENCH DETAIL AND PIPE RUNS NEAR BUILDINGS DETAIL FOR CONCRETE BED AND SURROUND PIPE PROTECTION MEASURES WHERE APPLICABLE.
- BACKFILL SHOULD BE PLACED IN LAYERS NOT EXCEEDING 300mm (UNCOMPACTED THICKNESS), EACH LAYER BEING WELL COMPACTED. MECHANICAL COMPACTION EQUIPMENT SHOULD NOT BE USED UNTIL THERE IS A MINIMUM OF 450mm OF COMPACTED MATERIAL ABOVE THE CROWN OF THE PIPE.
- ALL DRAIN CONNECTIONS BENEATH THE HIGHWAY ARE TO HAVE MINIMUM 150mm CONCRETE BED AND SURROUND, WHERE COVER IS LESS THAN 1.2m.
- REFER TO PRE-TENDER HEALTH & SAFETY PLAN & CONSTRUCTION PHASE HEALTH & SAFETY PLAN PRIOR TO THE COMMENCEMENT OF WORKS.


CONSTRUCTION
ISSUE

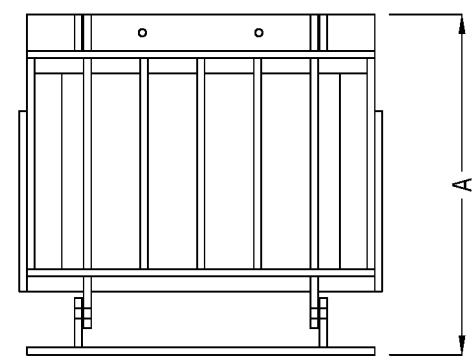


FRONT
ELEVATION

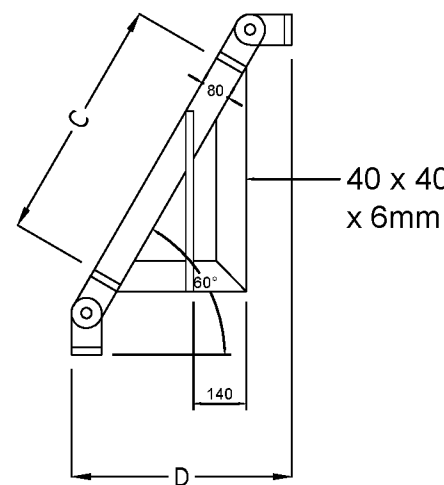


SIDE ELEVATION

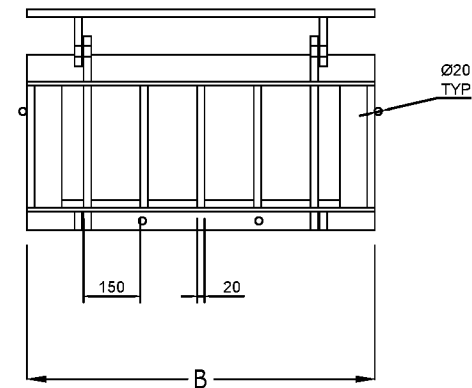

PLAN

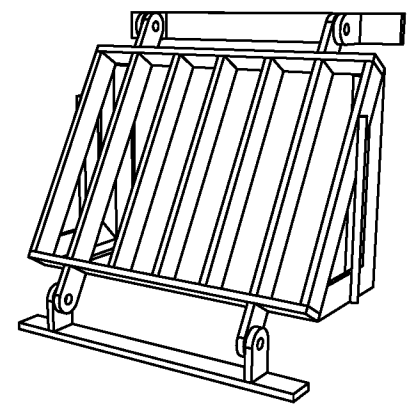


DEBRIS SCREEN DIMENSIONS						
HEADWALL	PIPE Ø	DIMENSION 'A'	DIMENSION 'B'	DIMENSION 'C'	DIMENSION 'D'	ALTHON LTD PRODUCT NAME
SWALE	300	600	610	496	378	300mm SLOPED TRASH SCREEN & SIDES (60° RAKE)

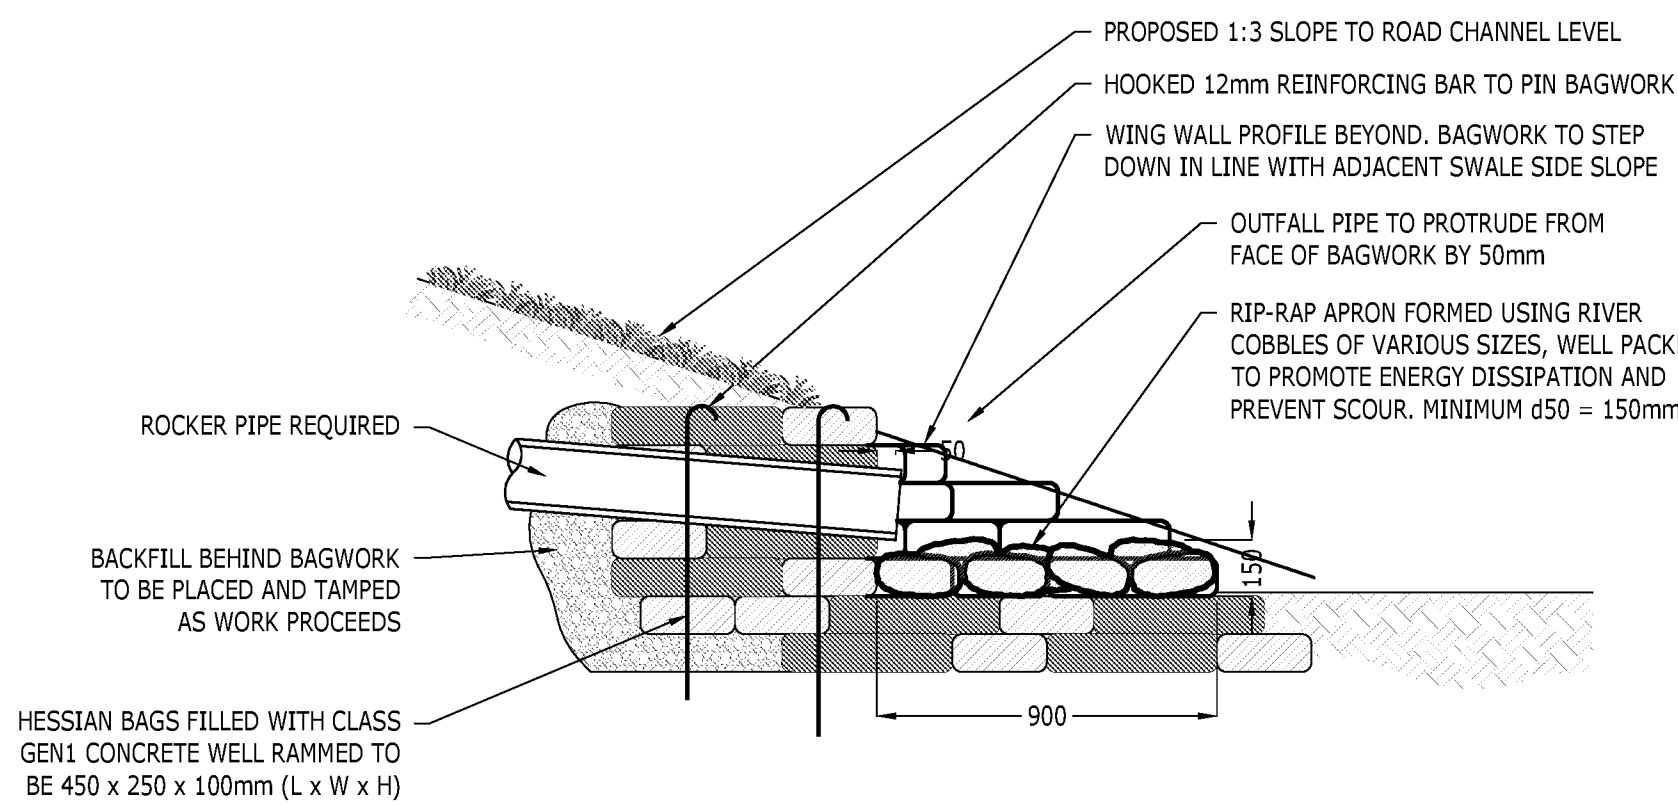


HEADWALL : SECTION C-C

SHAFT DIAMETERS	
DIA OF LARGEST PIPE IN MH (mm)	INTERNAL DIA. OF MH (mm)
LESS THAN 375	1200

NOTE:
IF PIPE DIAMETER IS 375mm OR ABOVE
USE 1500mm DIAMETER TYPE B.

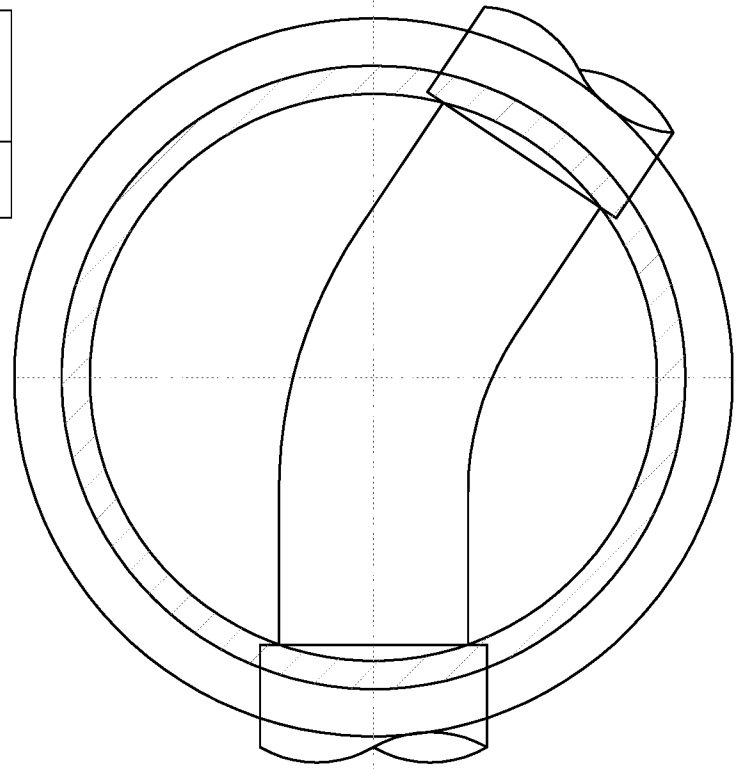


ALL PIPES ENTERING OR LEAVING
MANHOLES SHALL HAVE A FLEXIBLE
JOINT WITHIN 600mm OF THE INSIDE
FACE OF THE MANHOLE. THE NEXT
PIPE SHALL BE A SHORT 'ROCKER
PIPE' 600mm LONG.

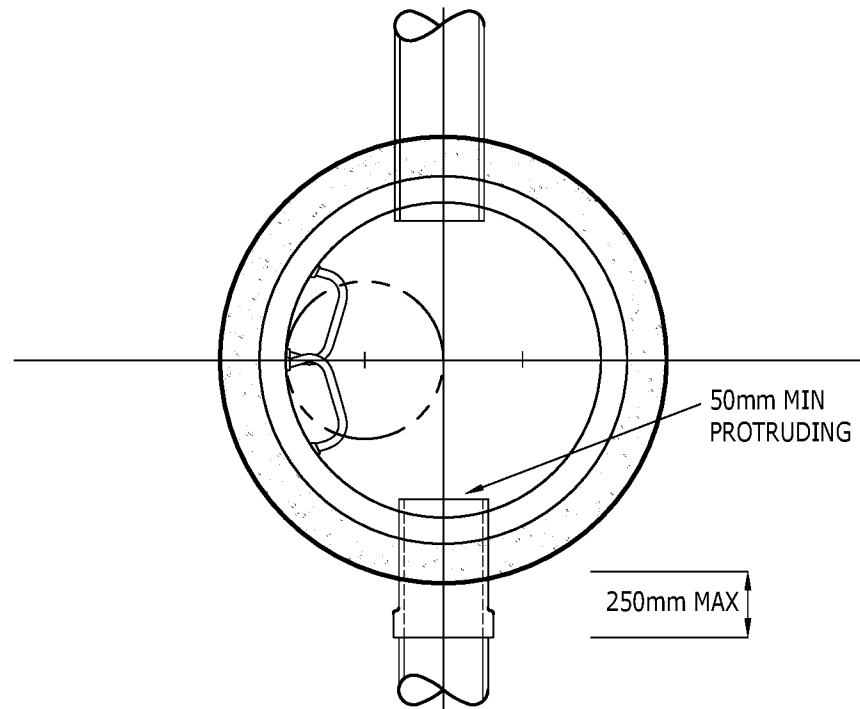


- NOTES:
- MANHOLE RINGS, SLAB AND ST 1 CONCRETE TO BE MADE USING SULPHATE RESISTING CONCRETE.
 - EXCESS EXCAVATION CONCRETE BACKFILL TO BE ST 1 CONCRETE REFER TO MANHOLE SCHEDULES FOR RING DIAMETER

PLAN

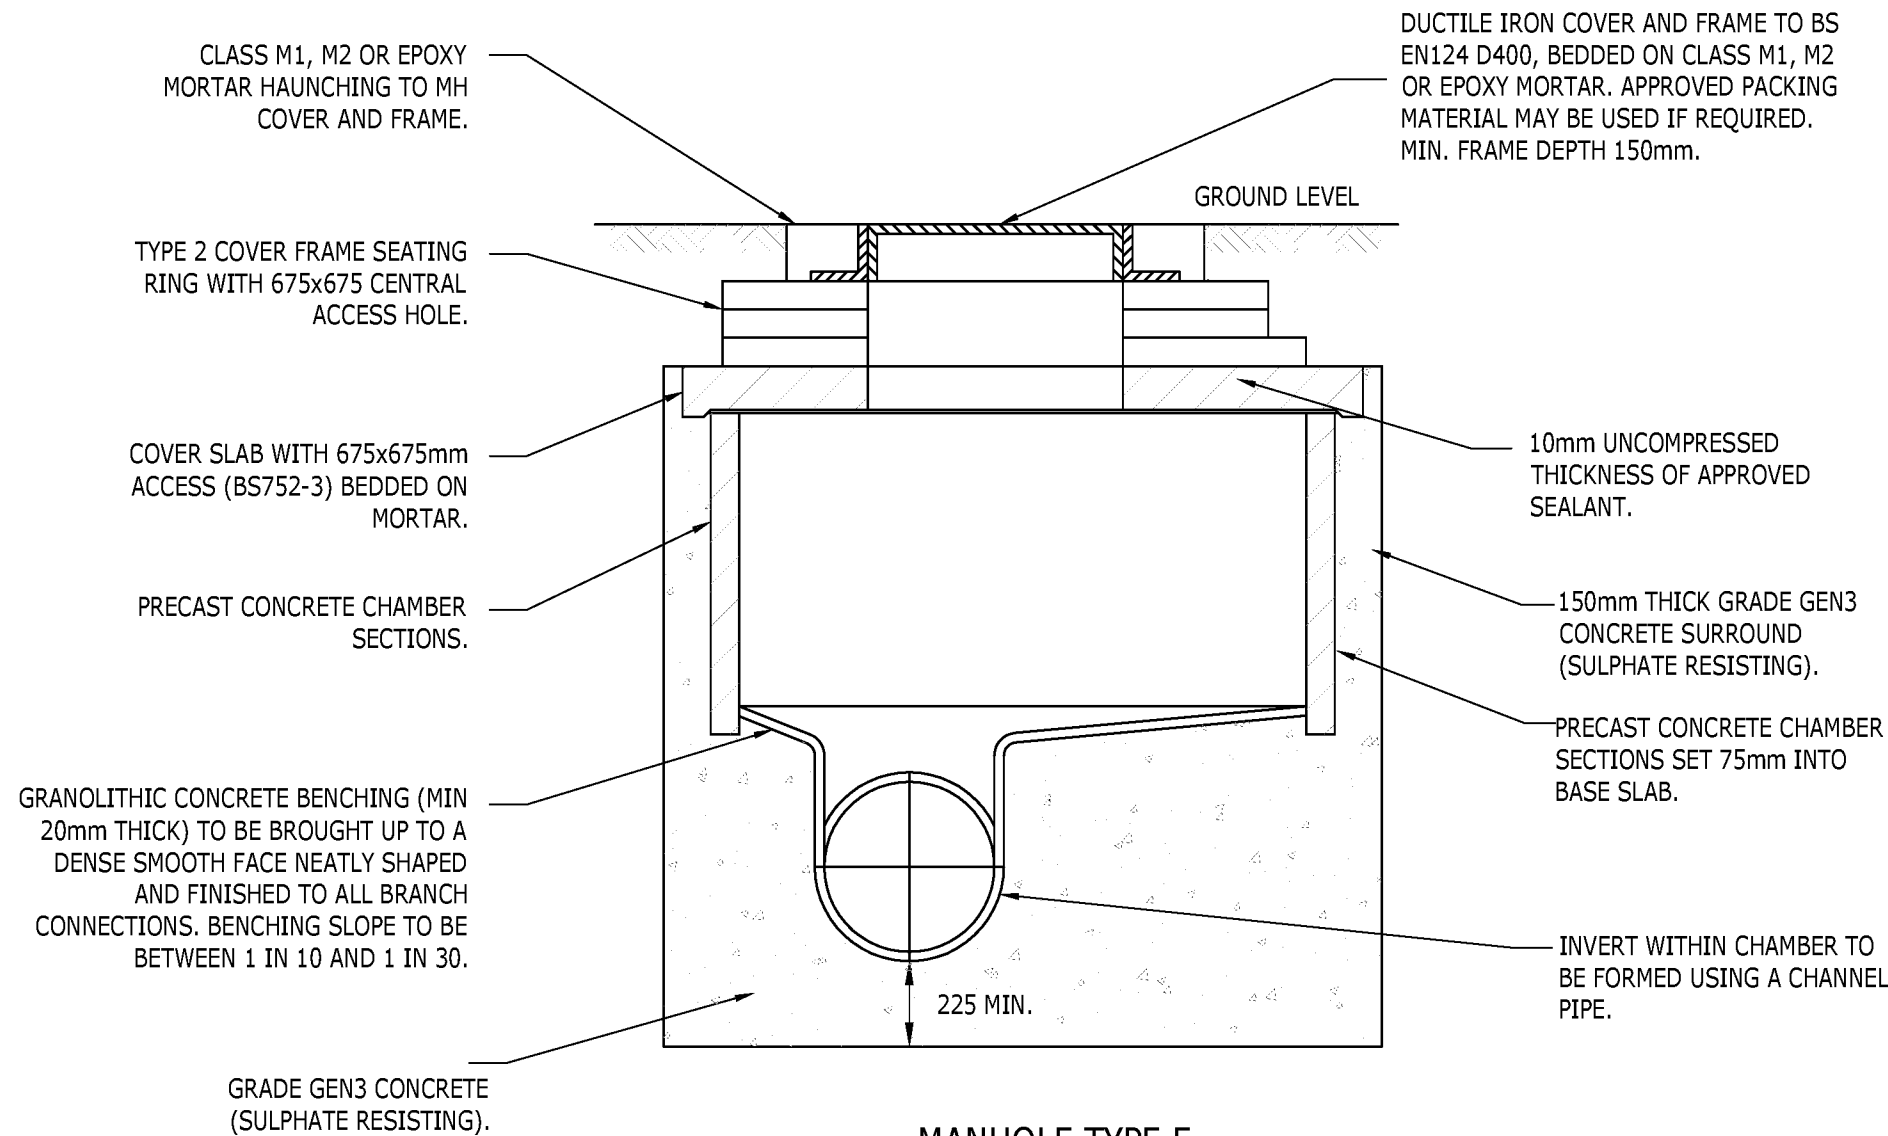


MANHOLE TYPE E
(DEPTH TO SOFFIT 1.00m TO 1.50m)
(1:20)

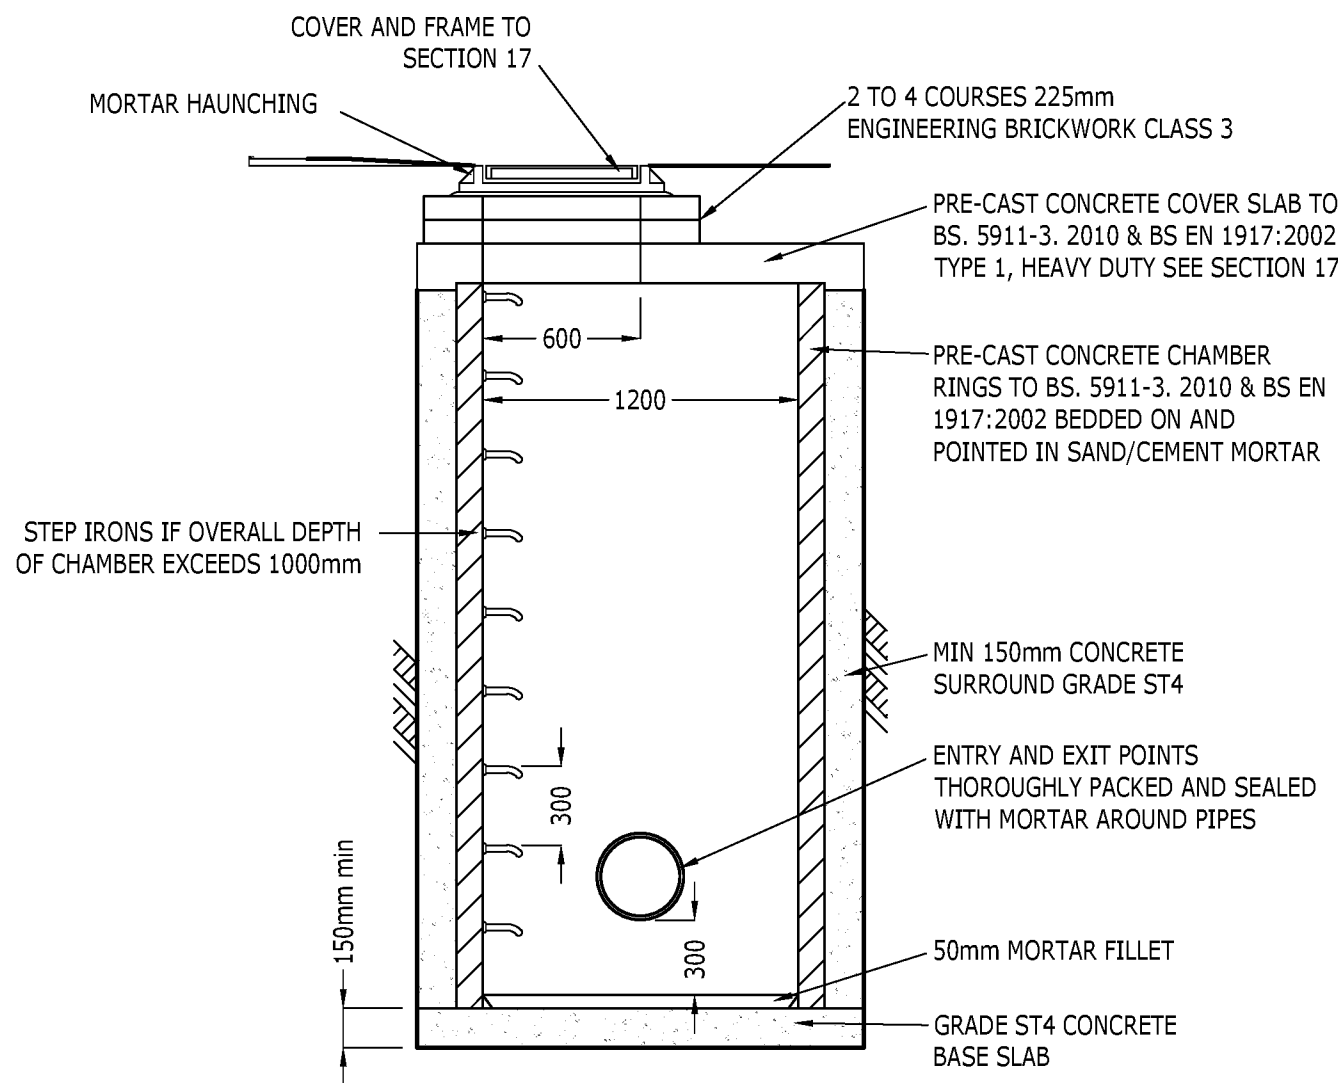


SECTION


TYPICAL CATCHPIT DETAIL
(1:10)

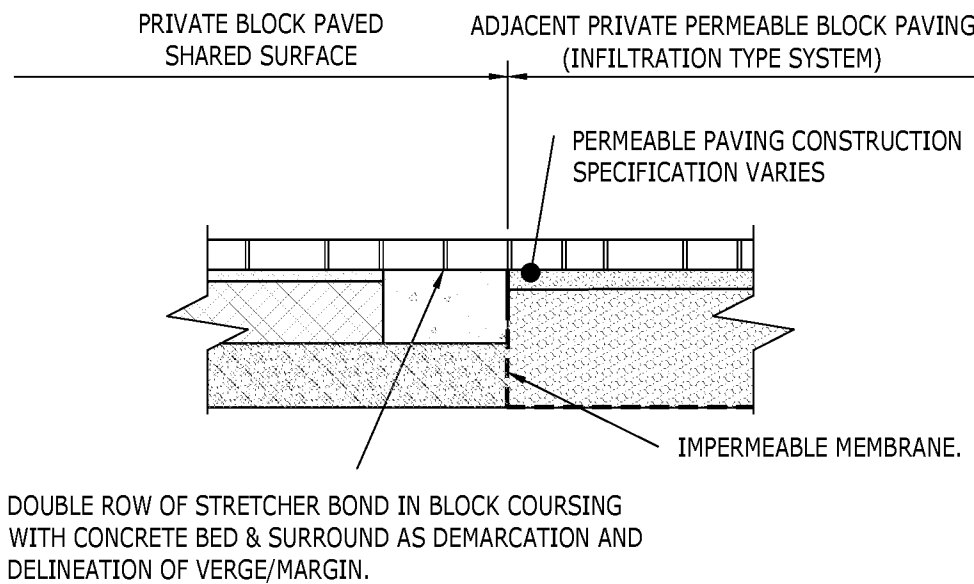

**TYPICAL FLUSH INTERFACE BETWEEN PRIVATE BLOCK PAVED
CARRIAGEWAY & PRIVATE PERMEABLE PAVED CONSTRUCTION**
(1:20)

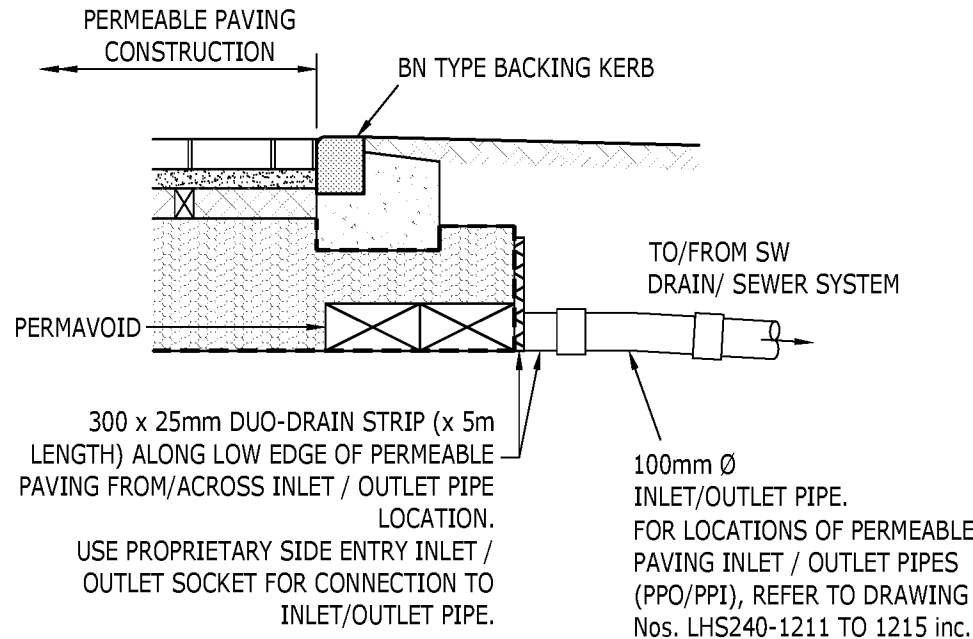


**TYPICAL PERMEABLE PAVING
INLET / OUTLET PIPE DETAIL**
(1:20)

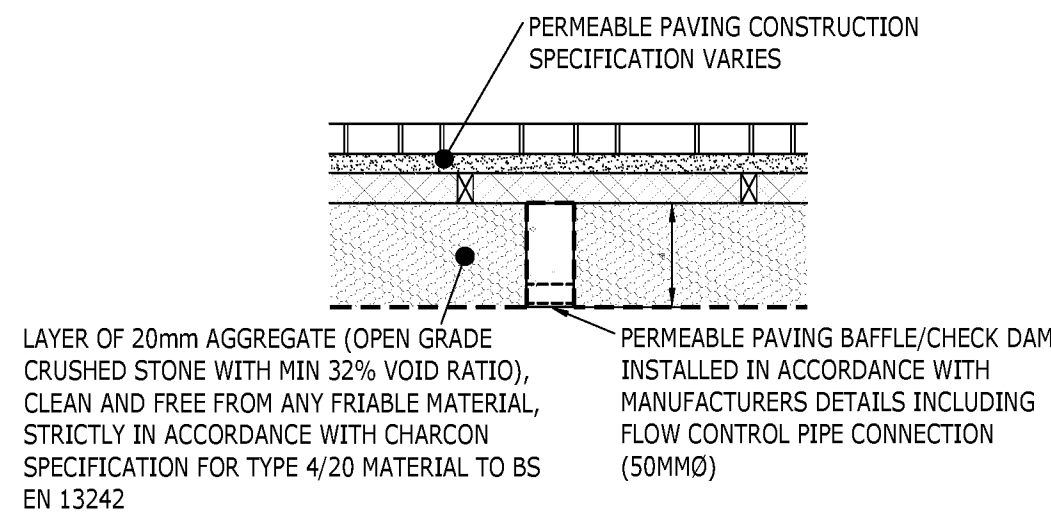


**TYPICAL PERMEABLE PAVING
BAFFLE / CHECK DAM DETAIL**
(1:20)


CONSTRUCTION
ISSUE

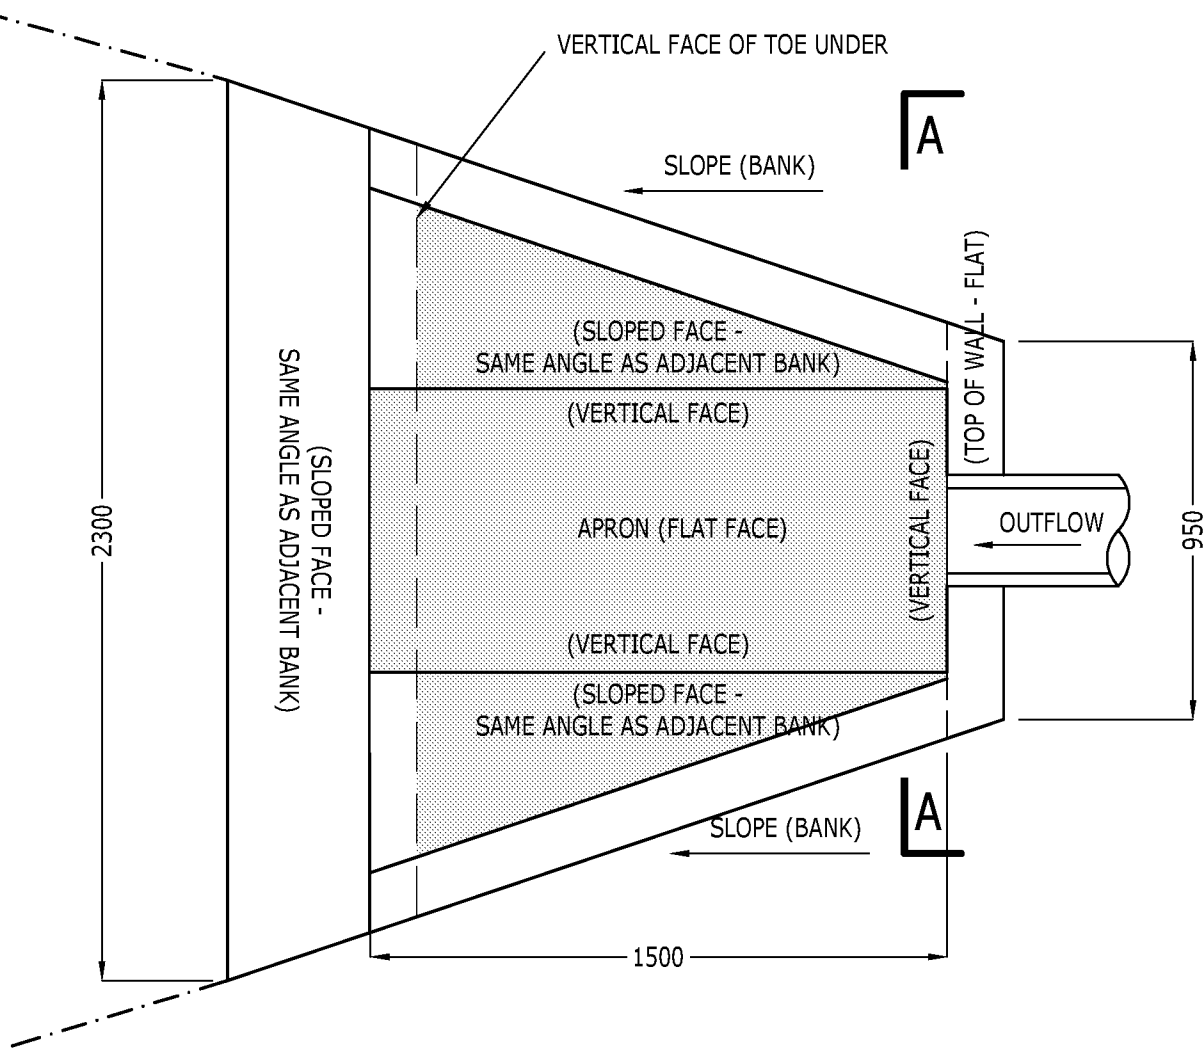


HEADWALL / OUTFALL TO POND

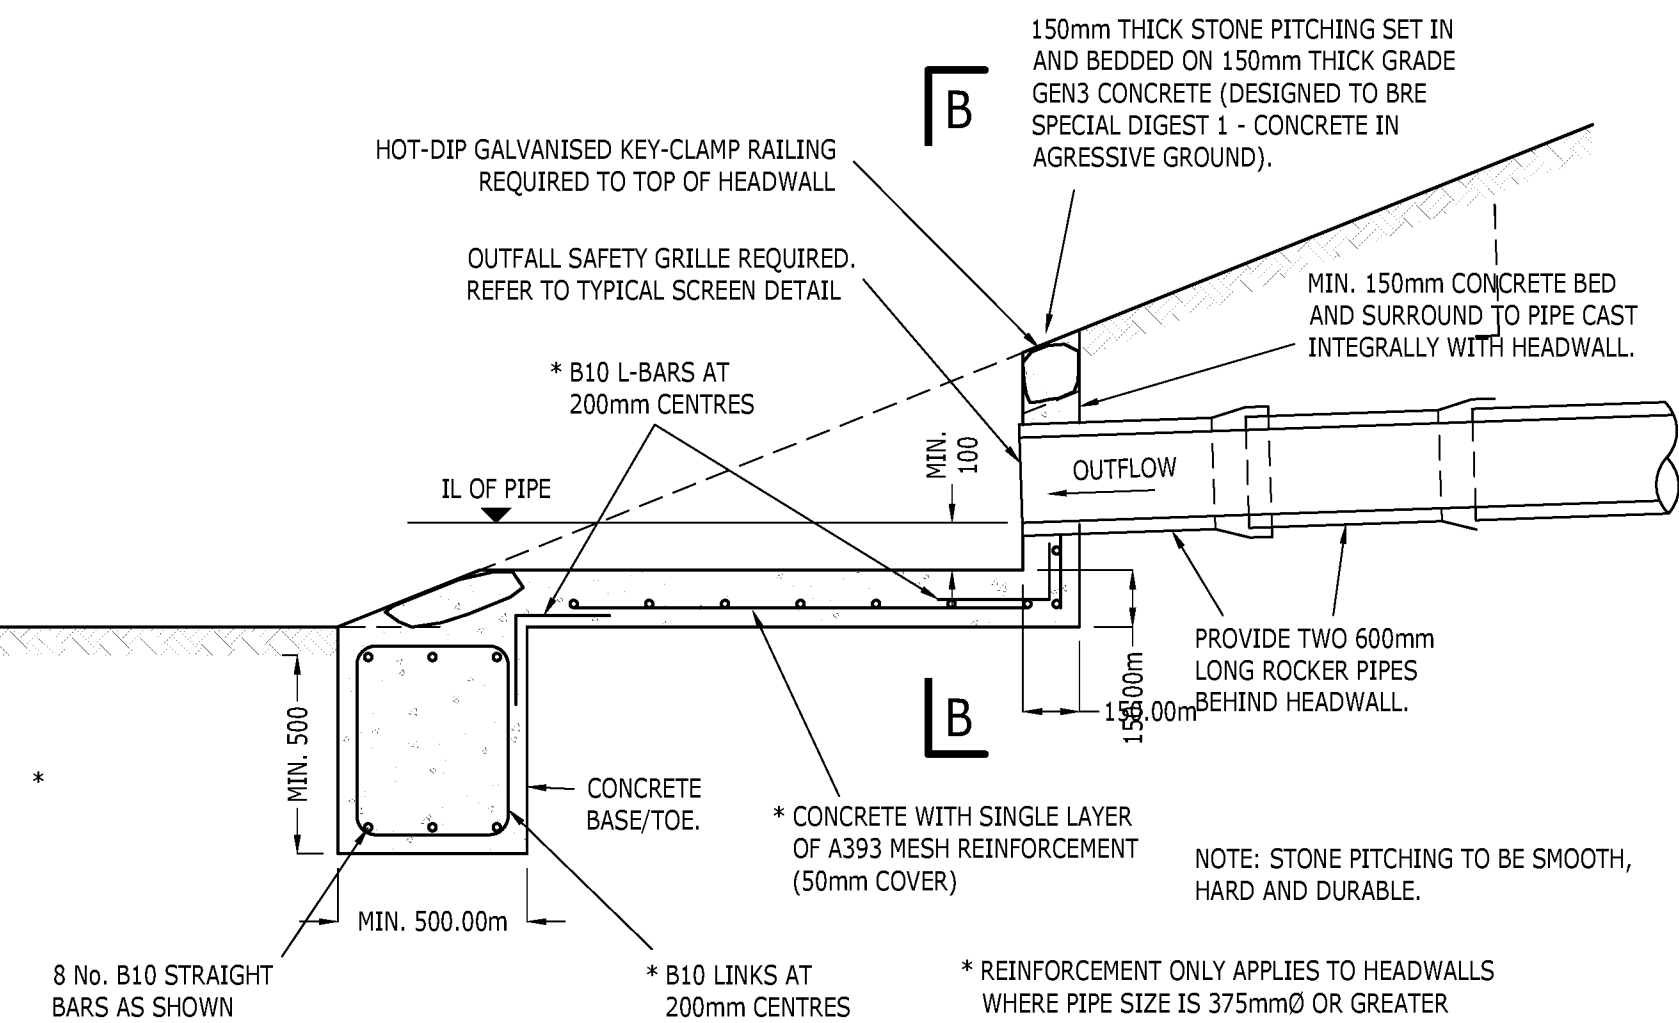

**TYPICAL SECTION A-A THROUGH
HEADWALL / PIPE OUTFALL TO POND**

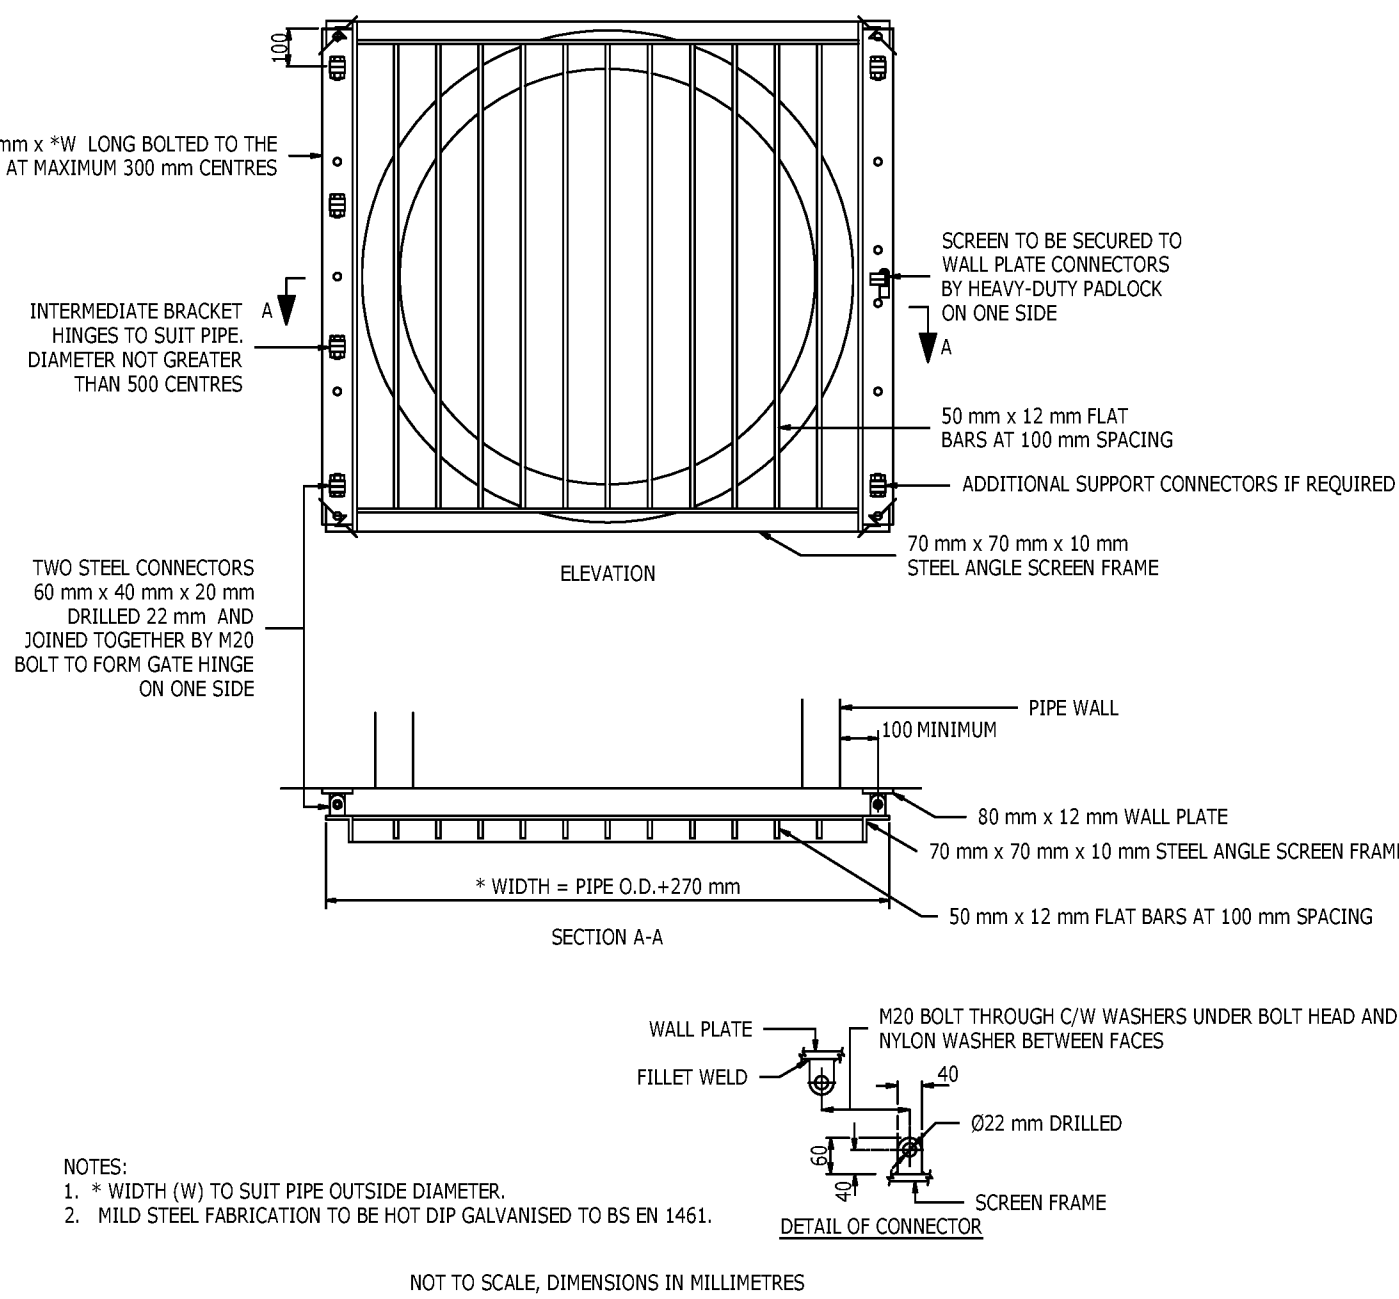

TYPICAL OUTFALL SAFETY GRILLE

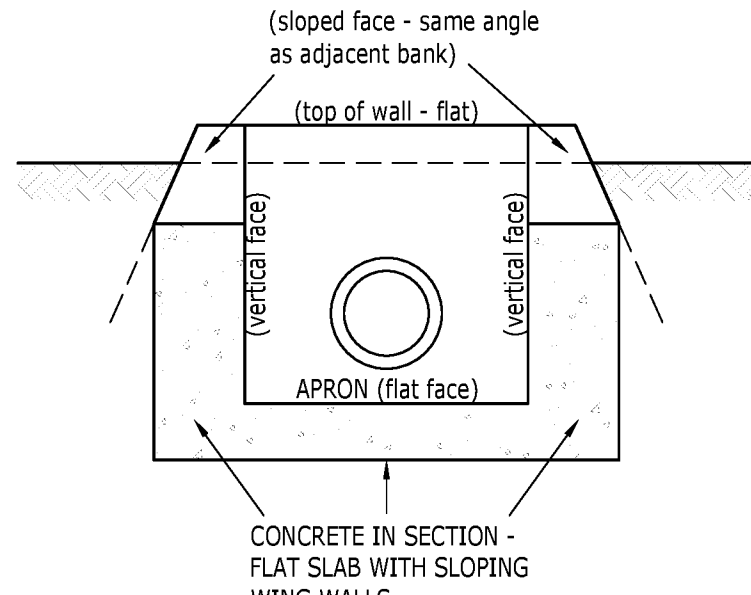

SECTION B-B

- NOTES:
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION, INC. RISK ASSESSMENTS (SEE COM NOTES) AND ALL OTHER RELATED DRAWINGS ISSUED BY THE ENGINEER.
 - DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
 - ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES UNLESS OTHERWISE STATED.
 - ALL DIMENSIONS, LEVELS AND SURVEY GRID CO-ORDINATES ARE TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF THE WORKS.
 - NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PRIOR PERMISSION FROM THE ENGINEER.
 - ALL PRIVATE DRAINAGE IS TO COMPLY AND BE LAID IN ACCORDANCE WITH CURRENT PART H OF BUILDING REGULATIONS, BS 8301 AND BS 5955.
 - REFER TO ARCHITECT'S HOUSE TYPE (WORKING) DRAWINGS FOR EXACT POSITION OF DRAINAGE POINTS.
 - POSITION & INVERT LEVELS OF ALL EXISTING MANHOLES, SEWERS AND LATERALS TO BE CONFIRMED PRIOR TO CONSTRUCTION & ANY DISCREPANCIES REPORTED TO THE ENGINEER.
 - ALL DRAIN AND SEWER PIPES ARE TO BE LAID SOFFIT TO SOFFIT, UNLESS SHOWN OTHERWISE (SEE ALSO MANHOLE SCHEDULE DRAWINGS).
 - ALL PLOT DRAINAGE TO BE 100mm Ø UNLESS SHOWN OTHERWISE, LAID IN ACCORDANCE WITH BS 8301.
 - ALL MATERIALS SHALL COMPLY TO THE BSI KITE MARK CERTIFICATION SCHEME AND MUST BE MARKED ACCORDINGLY.
 - COVER AND FRAMES TO MANHOLES/INSPECTION CHAMBERS TO COMPLY WITH BS EN124. REFER TO PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWING.
 - WHERE FINISHED GROUND LEVELS FALL TOWARDS BUILDING, AN OPEN GULLY IS TO BE PROVIDED AT THE FOOT OF ALL RAINWATER PIPES. ALL RAINWATER PIPES TO HAVE RODDING ACCESS.
 - FINAL POSITIONS OF INSPECTION CHAMBERS WITHIN PRIVATE AREAS ARE SUBJECT TO CONFIRMATION ON SITE TO SUIT PIPE CONFIGURATIONS AND CHAMBER INLET POSITIONS.
 - WHERE A DRAIN RUN PASSES THROUGH A WALL OR FOUNDATION IT IS NECESSARY TO:
 - FORM AN OPENING USING A CONCRETE LINTEL WITH AT LEAST 50mm CLEARANCE AROUND THE PIPE AND THE OPENINGS MASKED WITH RIGID SHEET MATERIAL TO PREVENT ENTRY OF FILL OR VERMIN, OR;
 - BUILD IN A LENGTH OF PIPE WITH ITS JOINTS AS CLOSE AS POSSIBLE TO THE WALL FACES (150mm MAXIMUM) AND CONNECTED ON EACH SIDE TO 600mm LONG ROCKER PIPES WITH FLEXIBLE JOINTS.
 - PLOT DRAINAGE TO BE BEDDED ON GRANULAR MATERIAL AND BACKFILLED WITH SUITABLE CLEAN MATERIAL, AS DESCRIBED ON THE PRIVATE DRAINAGE CONSTRUCTION DETAILS DRAWINGS. SEE ALSO SHALLOW DRAINAGE TRENCH DETAIL AND PIPE RUNS NEAR BUILDINGS DETAIL FOR CONCRETE BED AND SURROUND PIPE PROTECTION MEASURES WHERE APPLICABLE.
 - BACKFILL SHOULD BE PLACED IN LAYERS NOT EXCEEDING 300mm (UNCOMPACTED THICKNESS). EACH LAYER BEING WELL COMPACTED. MECHANICAL COMPACTION EQUIPMENT SHOULD NOT BE USED UNTIL THERE IS A MINIMUM OF 450mm OF COMPACTED MATERIAL ABOVE THE CROWN OF THE PIPE.
 - ALL DRAIN CONNECTIONS BENEATH THE HIGHWAY ARE TO HAVE MINIMUM 150mm CONCRETE BED AND SURROUND, WHERE COVER IS LESS THAN 1.2m.
 - REFER TO PRE-TENDER HEALTH & SAFETY PLAN & CONSTRUCTION PHASE HEALTH & SAFETY PLAN PRIOR TO THE COMMENCEMENT OF WORKS.

CI	ISSUED FOR CONSTRUCTION	MJR	JM	GH	09.08.19
Rev	Description	Dn	Chk	App	Date

ARDENT CONSULTING ENGINEERS

Third Floor
The Hallmark Building
52-56 Leadenhall Street
London
EC3M 5JE

Tel: 020 7680 4088
Web: www.ardent-ce.co.uk
E-mail: enquiries@ardent-ce.co.uk




Client
LINDEN HOMES SOUTH

Project Title:
LAND EAST OF TYE LANE, WALBERTON

Drawing Title:
**MAIN DRAINAGE CONSTRUCTION
DETAILS (SHEET 2 OF 3)**

A1 Scale	Date	Designed by
1:20	APRIL 2019	JM
Drawn by	Checked by	Approved by
MJR	JM	GH
Drawing Number	LHS240-1222	
		Rev C1

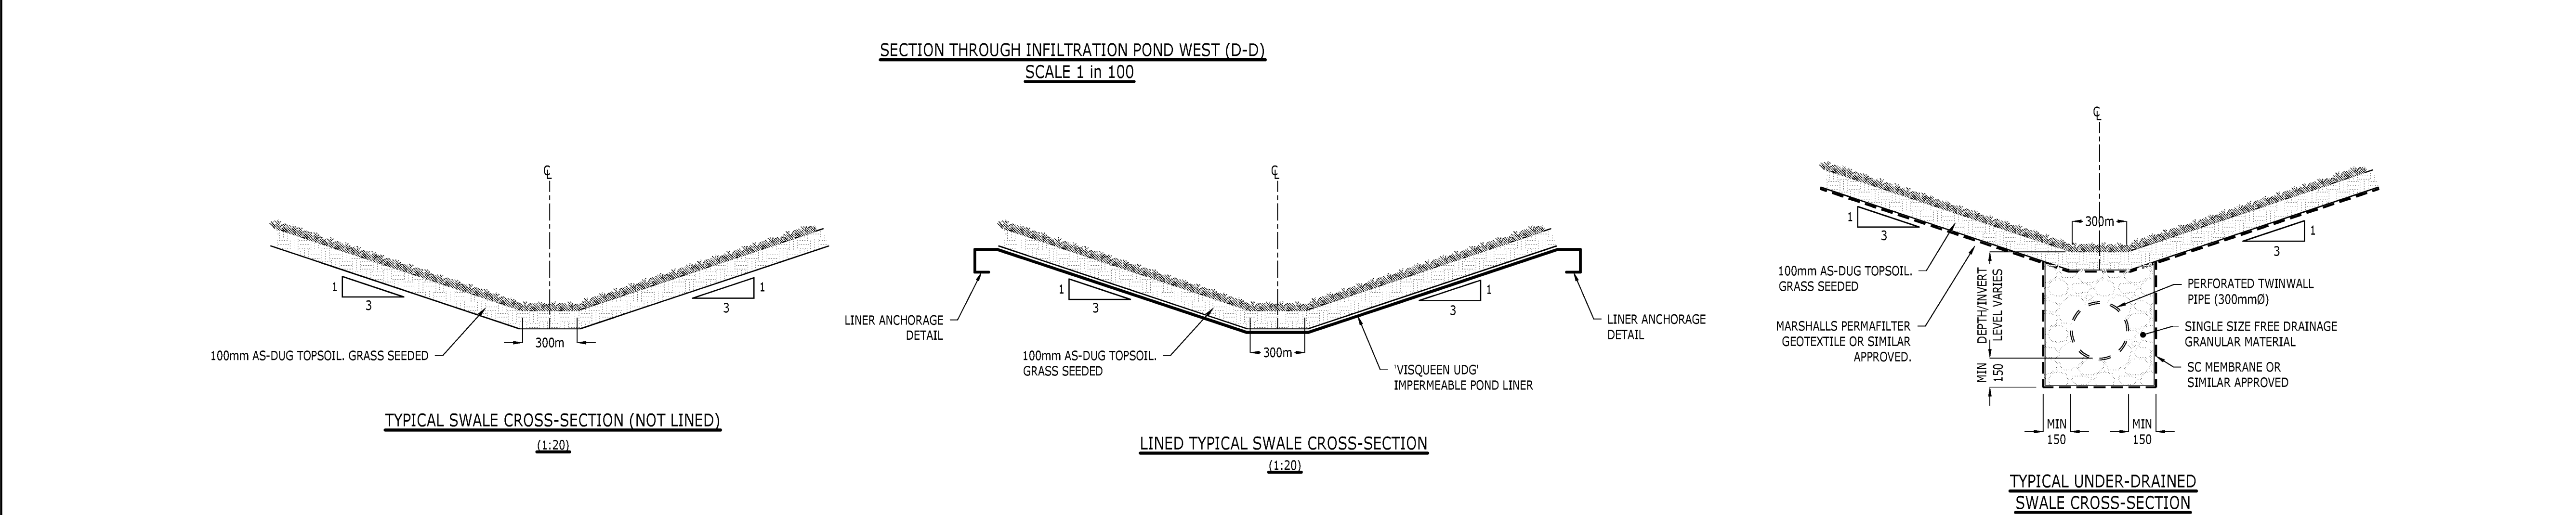

- CONSTRUCTION
ISSUE

C2	POND LINER UPDATED AND LIMESTONE BOULDERS CHANGED TO GABIONS FOLLOWING COMMENTS	MJR	MJR	JEC	13.01.21
C1	ISSUED FOR CONSTRUCTION	MJR	JM	GH	09.08.19
T2	WETLAND BENCHES ADDED TO SECTIONS	JS	JM	GH	19.07.19
Rev	Description	Drn	Chk	App	Date

ARDENT CONSULTING
ENGINEERS

Third Floor
The Hallmark Building
52-56 Leadenhall Street
London
EC3M 5JE

Tel: 020 7680 4088
Web: www.ardent-ce.co.uk
E-mail: enquiries@ardent-ce.co.uk

Client

LINDEN HOMES SOUTH

Project Title: **LAND EAST OF TYE LANE,
WALBERTON**

Drawing Title: **MAIN DRAINAGE CONSTRUCTION
DETAILS (SHEET 3 OF 3)**


A1 Scale 1:20	Date APRIL 2019	Designed by JM
Drawn by JS	Checked by JM	Approved by GH

LHS240-1223

C2

APPENDIX G

Surface Water Drainage Action Plan (Sheet 1 of 2) (Drawing number
LHS240-1250)

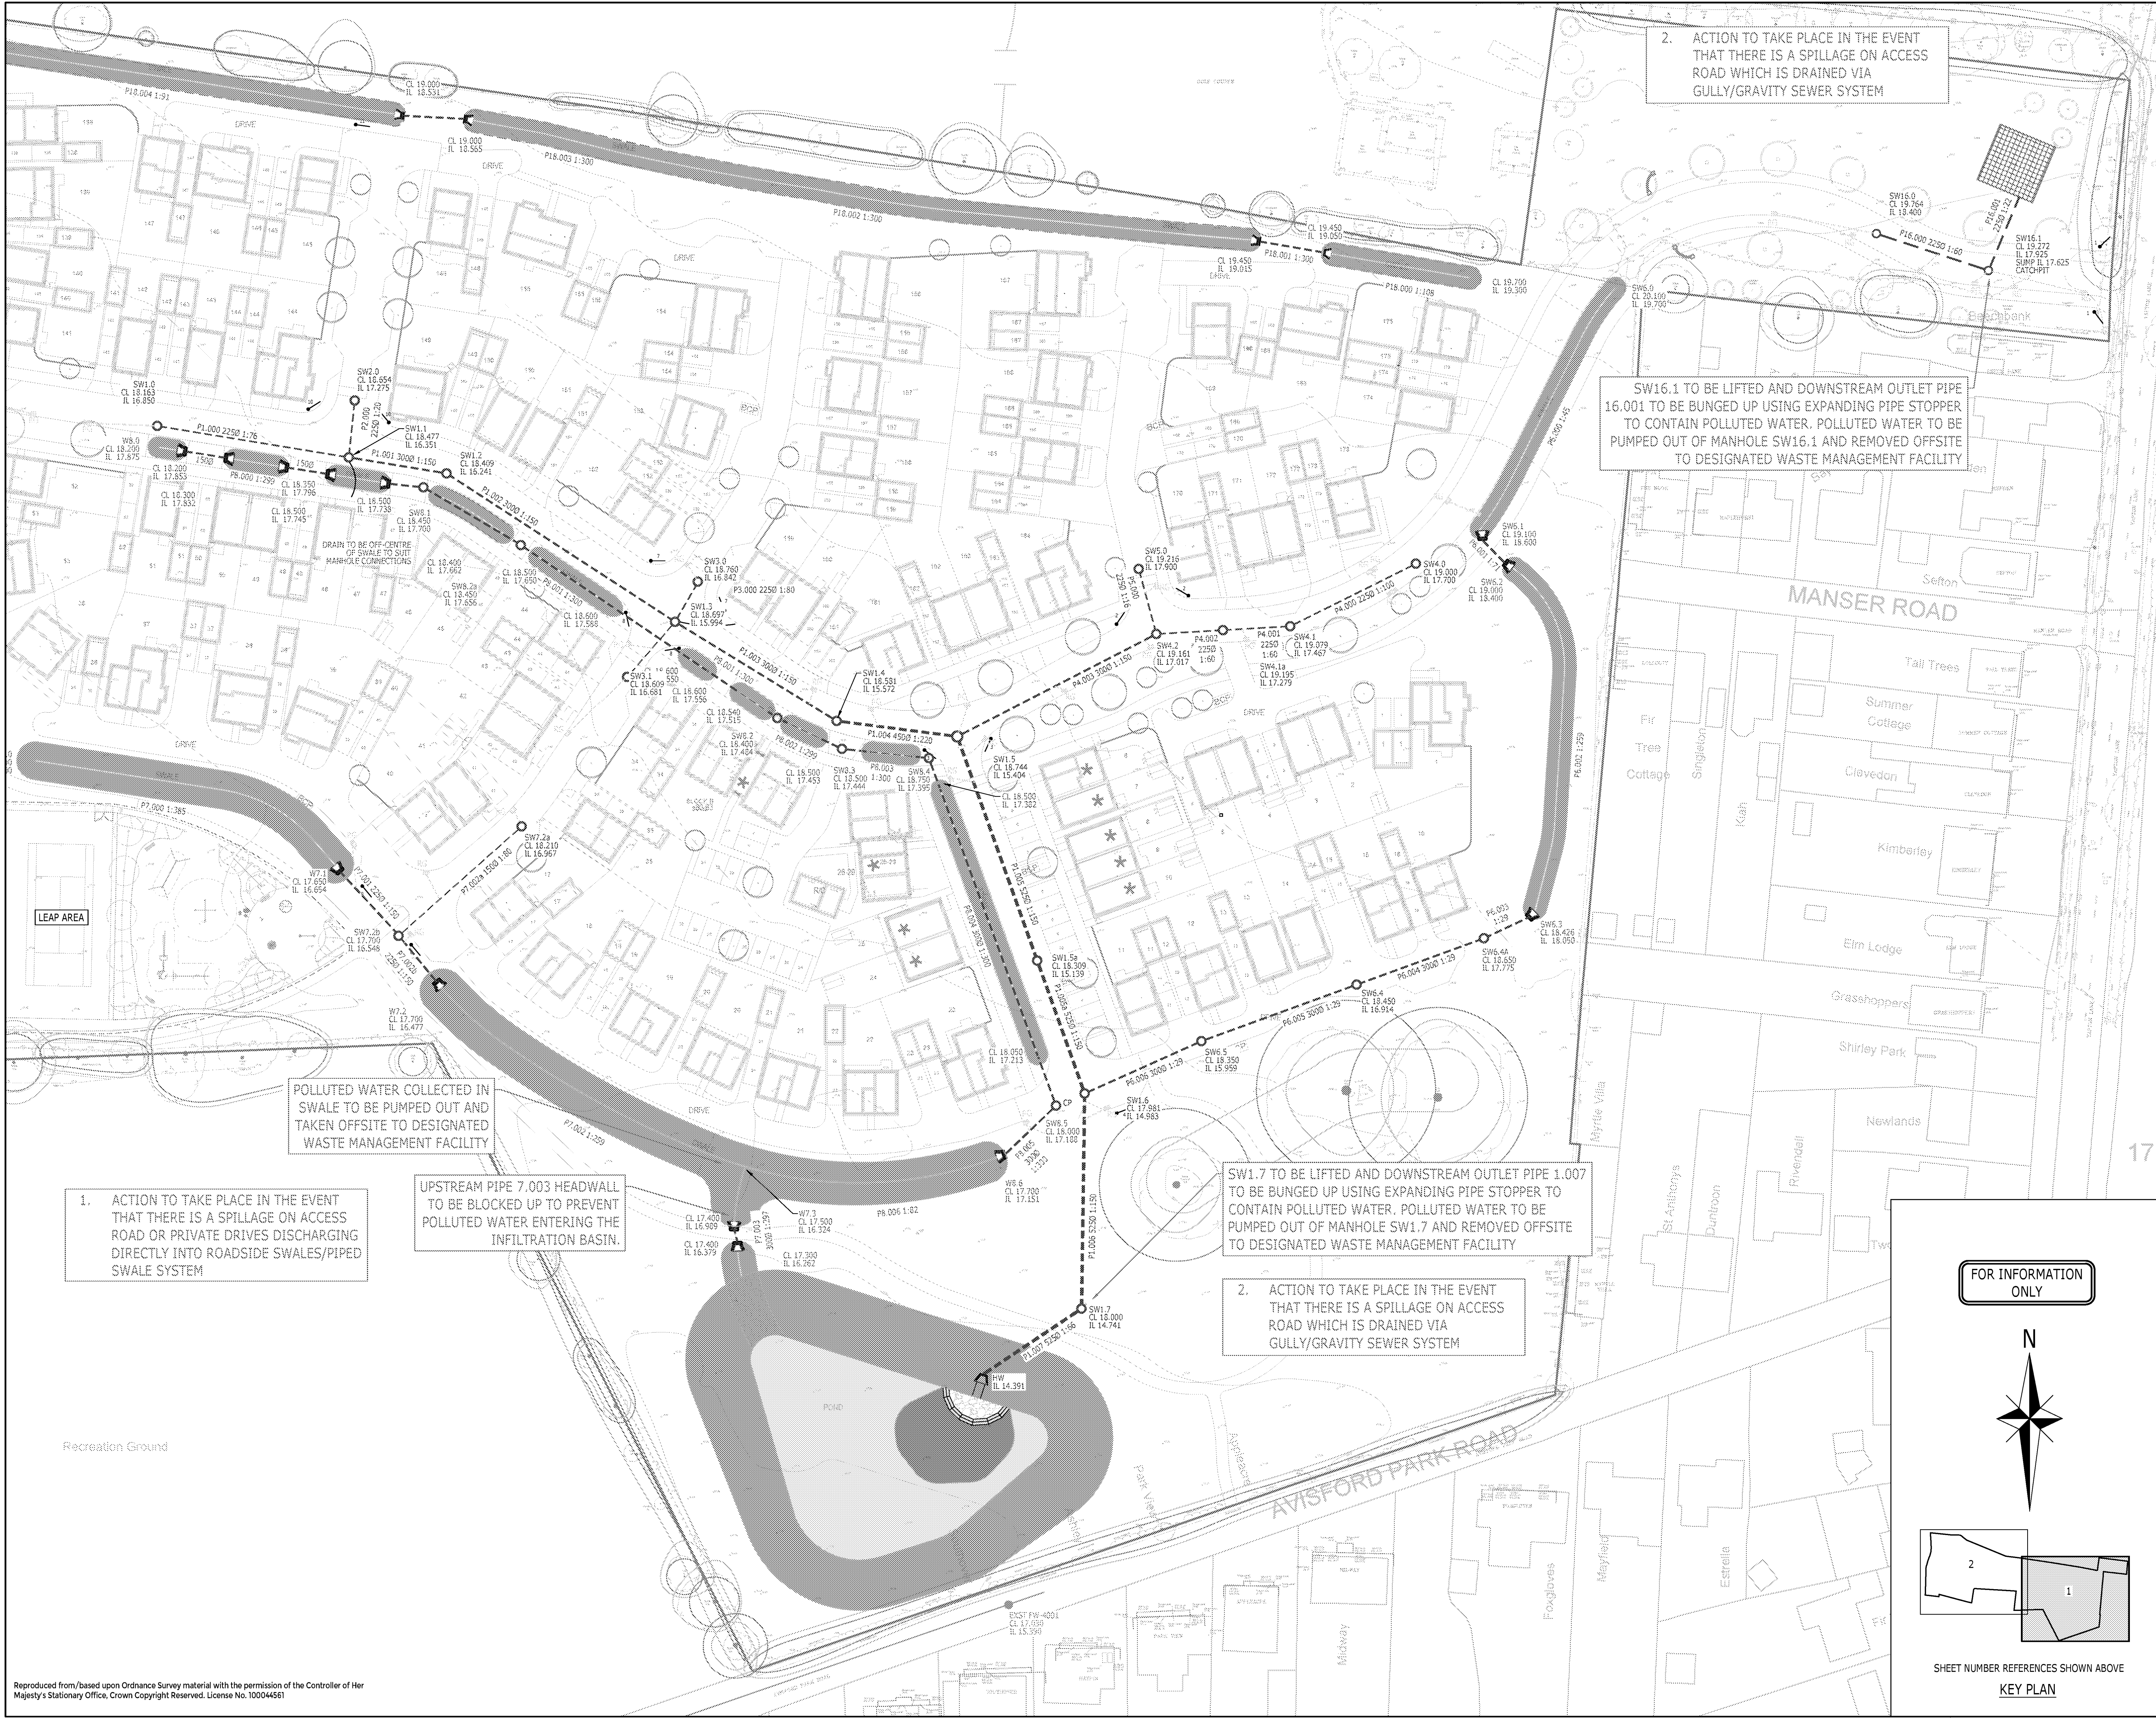

- NOTES:
1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT SPECIFICATION, INC. RISK ASSESSMENTS (SEE CDM NOTES) AND ALL OTHER RELATED DRAWINGS ISSUED BY THE ENGINEER.
 2. DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
 3. ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES UNLESS OTHERWISE STATED.
 4. ALL DIMENSIONS, LEVELS AND SURVEY GRID CO-ORDINATES ARE TO BE CHECKED ON SITE AND THE ENGINEER NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES PRIOR TO THE COMMENCEMENT OF THE WORKS.
 5. NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PRIOR PERMISSION FROM THE ENGINEER.

- CDM NOTES:
1. THE ATTENTION OF THE CLIENT AND THE PRINCIPAL CONTRACTOR IS DRAWN TO THE FOLLOWING POTENTIAL RISKS IN CONJUNCTION WITH THE PROPOSED ON-SITE AND OFF-SITE WORKS AS DESIGNED FOR THIS PROJECT:
 2. WORKS IN THE VICINITY OF LIVE SERVICES WILL BE NECESSARY AND THE ADVICE OF ALL STATUTORY SERVICE COMPANIES MUST BE SOUGHT BEFORE ANY WORKS COMMENCE.
 3. WORKS WITHIN AND ADJUTING THE EXISTING HIGHWAY WILL ENTAIL TRAFFIC HAZARDS AND ALL APPROPRIATE SAFETY MEASURES INCLUDING BARRIERS, SIGNS AND LIGHTING MUST BE UNDERTAKEN TO THE APPROVAL OF THE LOCAL AUTHORITY, THE HIGHWAY AUTHORITY AND THE POLICE.
 4. HAZARDOUS MATERIALS INCLUDING CEMENT AND BITUMINOUS MATERIALS ARE SPECIFIED AND THE MANUFACTURER'S ADVICE ON SAFE HANDLING PROCEDURES MUST BE OBTAINED AND MADE CLEAR TO ALL OPERATIVES.
 5. THE CONTRACTOR WILL BE RESPONSIBLE FOR LOCATING ALL EXISTING SERVICES WITHIN THE VICINITY OF THE WORKS AND ENSURE THESE ARE PROTECTED THROUGHOUT THE DURATION OF THE WORKS. ALL UTILITY PLANT SHOULD BE CLEARLY MARKED ON THE GROUND PRIOR TO COMMENCEMENT OF THE WORKS.
 6. THE CONTRACTOR MUST ENSURE ALL WORKING AREAS ARE FULLY SECURE.

Rev	Description	Dn	Chk	App	Date
ARDENT CONSULTING ENGINEERS Third Floor The Hailmark Building 52-56 Leadenhall Street London EC3M 5JE Tel: 020 7680 4088 Web: www.ardent-ce.co.uk E-mail: enquiries@ardent-ce.co.uk					
Client LINDEN HOMES SOUTH					
Project Title LAND EAST OF TYE LANE, WALBERTON					
Drawing Title SURFACE WATER DRAINAGE ACTION PLAN (SHEET 1 OF 2)					
A1 Scale 1:500		Date 29.11.24		Designed by MJR	
Drawn by MJR		Checked by MJR		Approved by JEC	
Drawing Number LHS240-1250					Rev -