



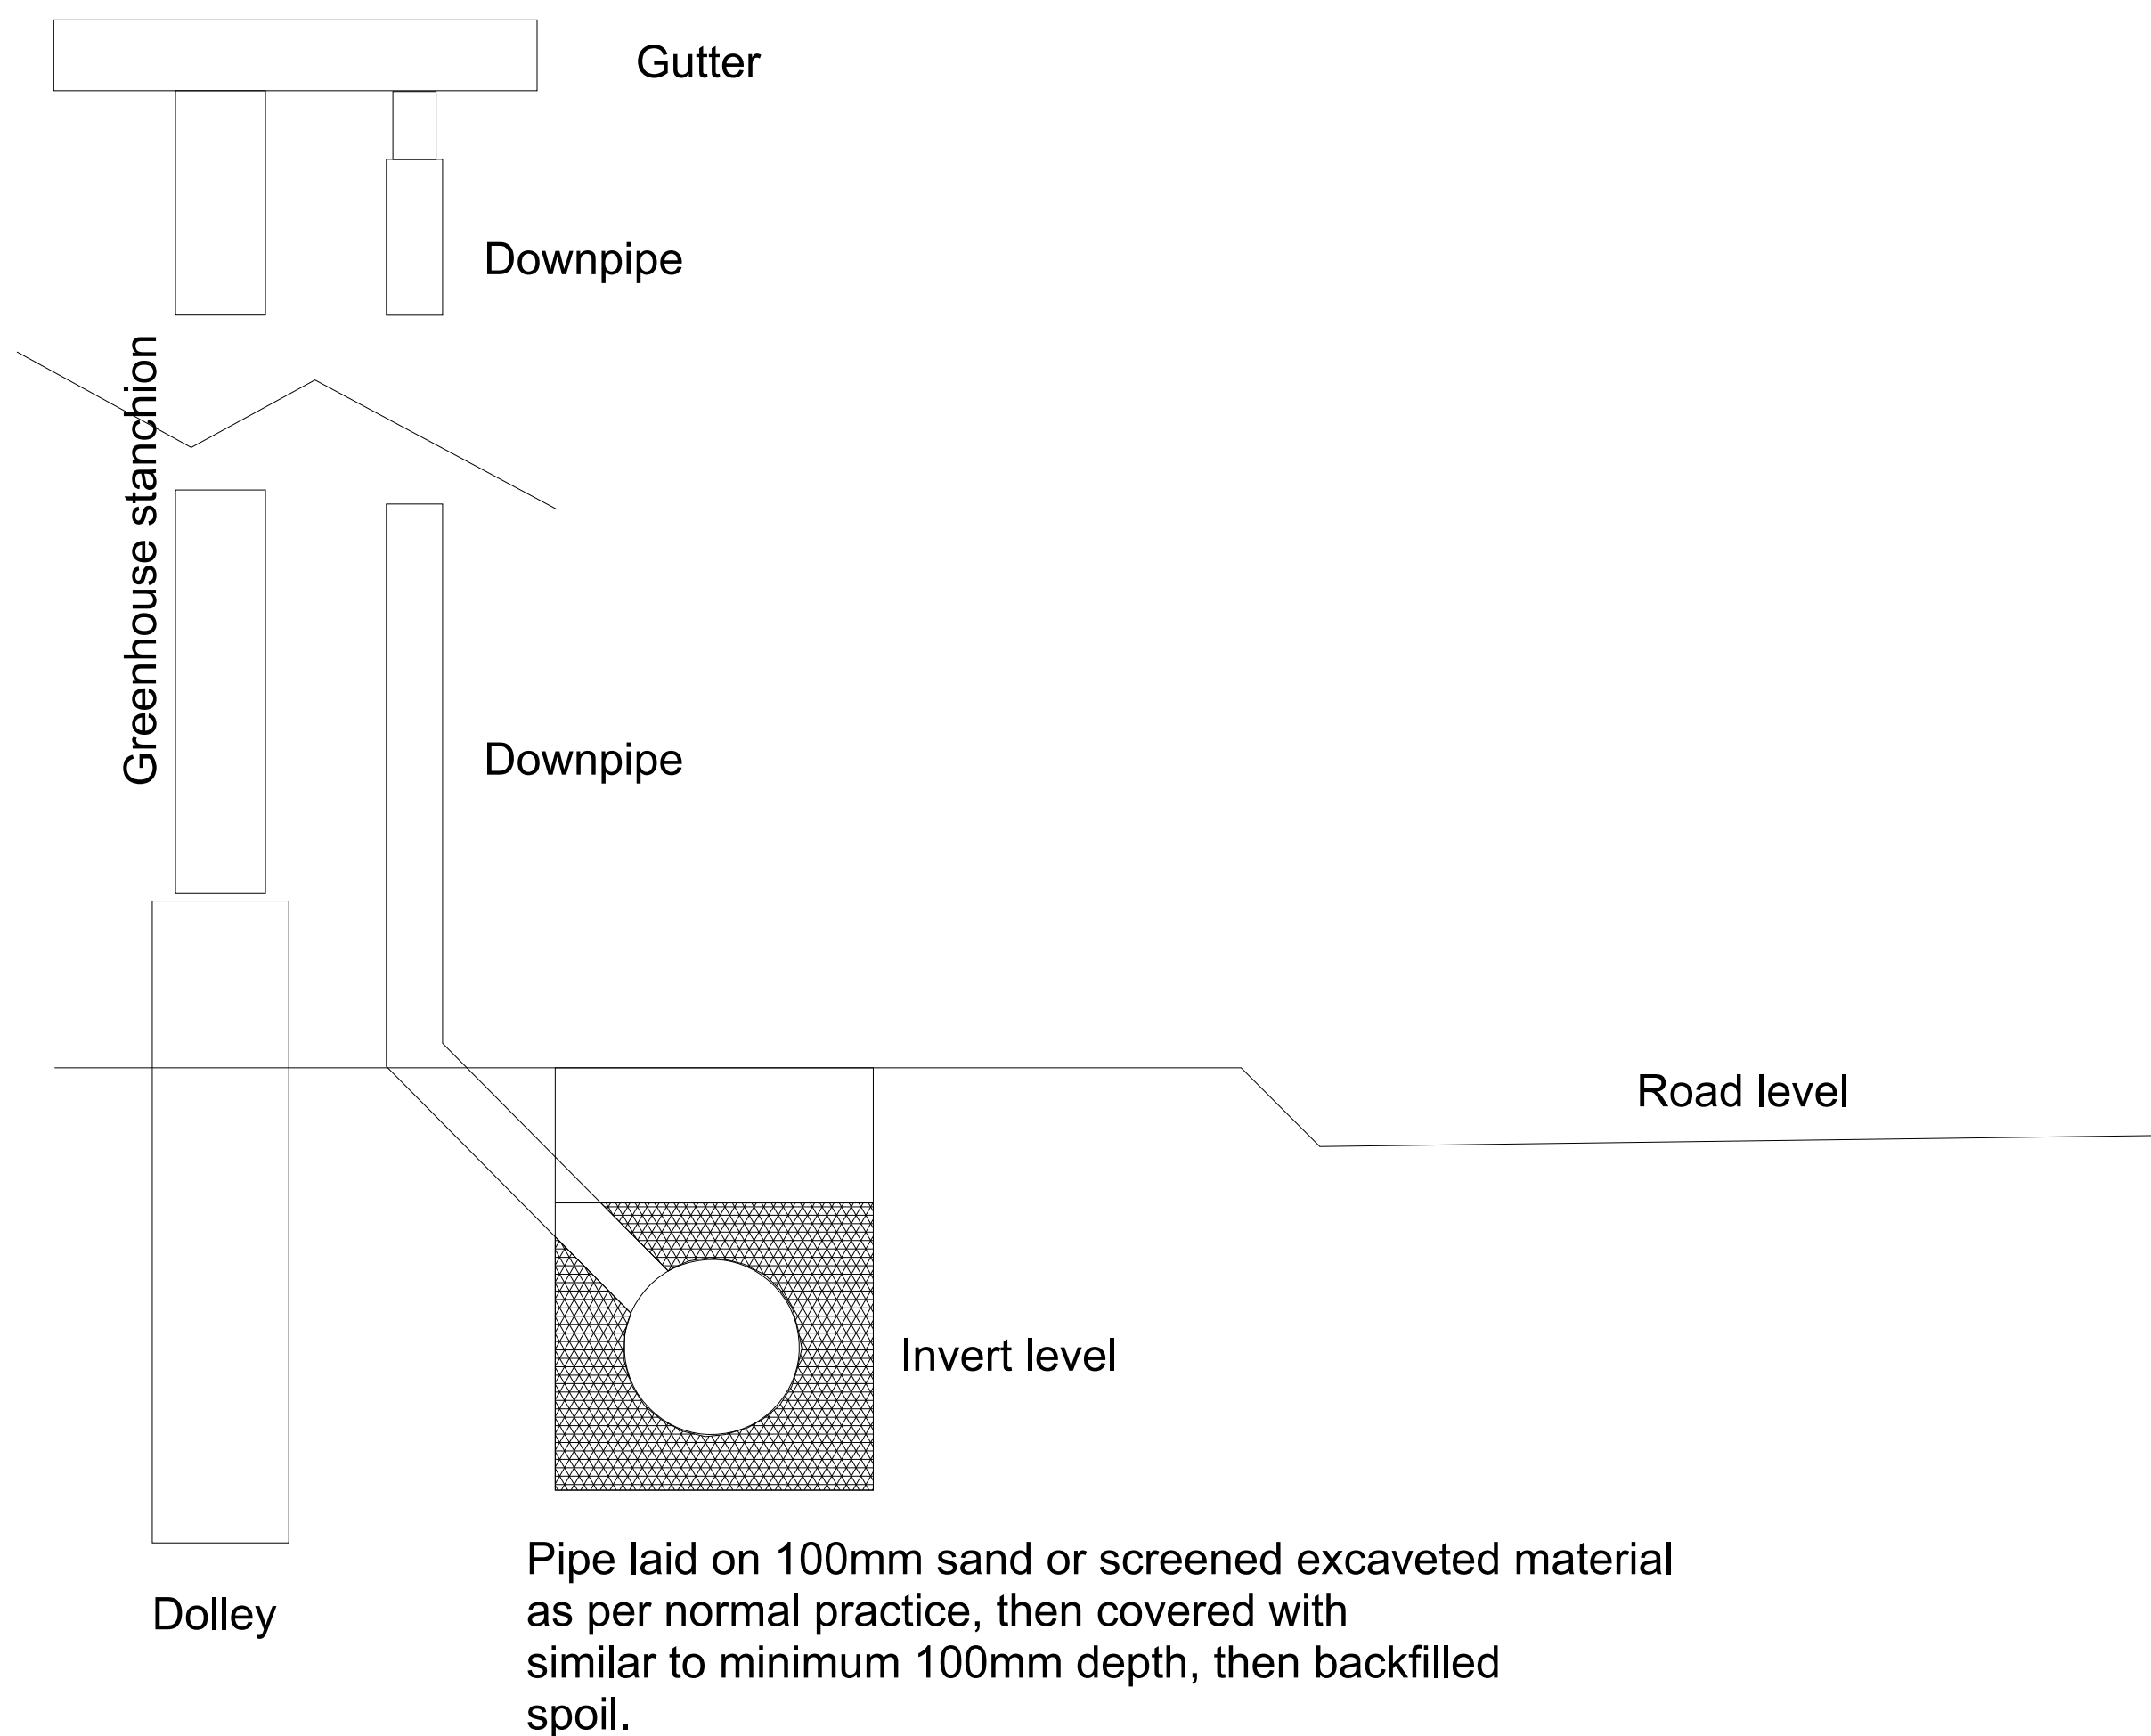


Standard downpipe / breather pipe conenction and header main (nts)

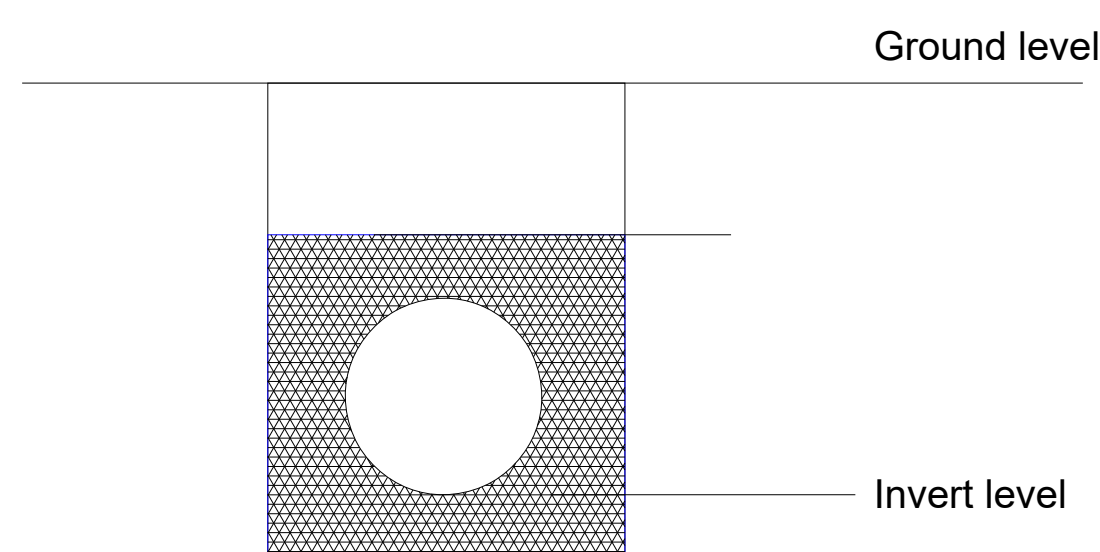


Pipe to be laid on 100mm sand or screened excavated material as per normal practice, then covered with similar to minimum 100mm depth, then backfilled spoil.
Width to suit pipe diameter and bucket.

Standard pipe installation (nts)

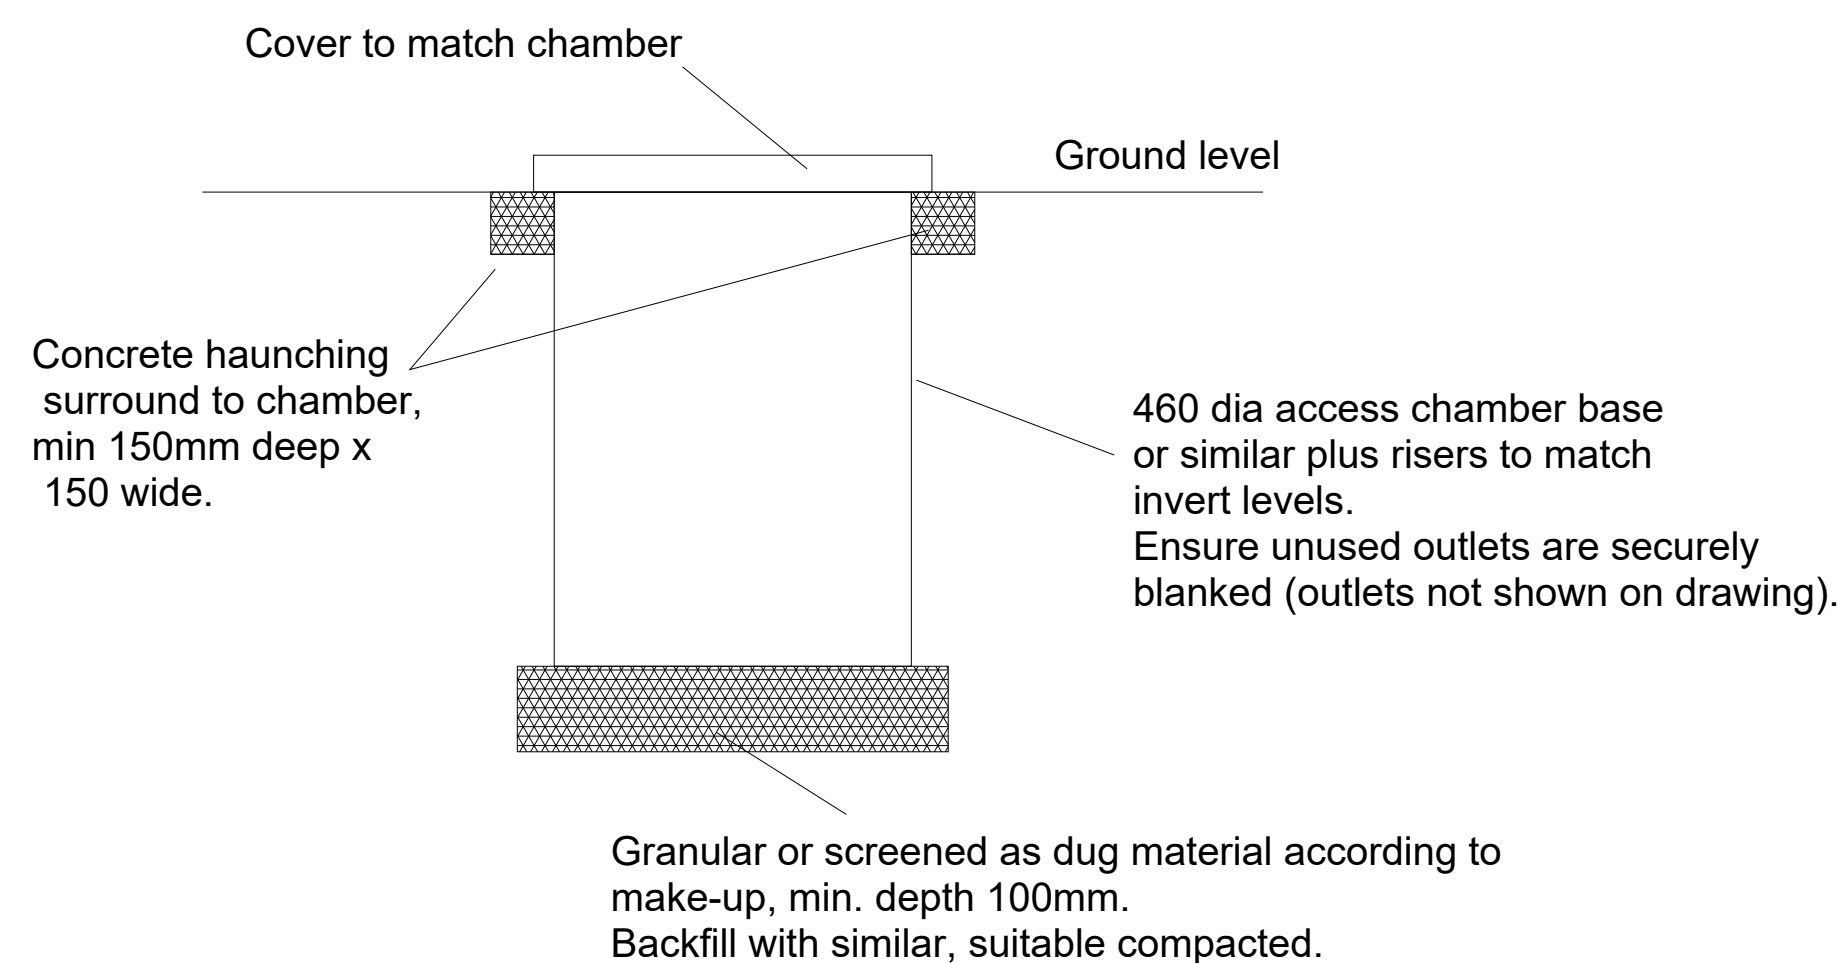

Standard IC installation (nts)

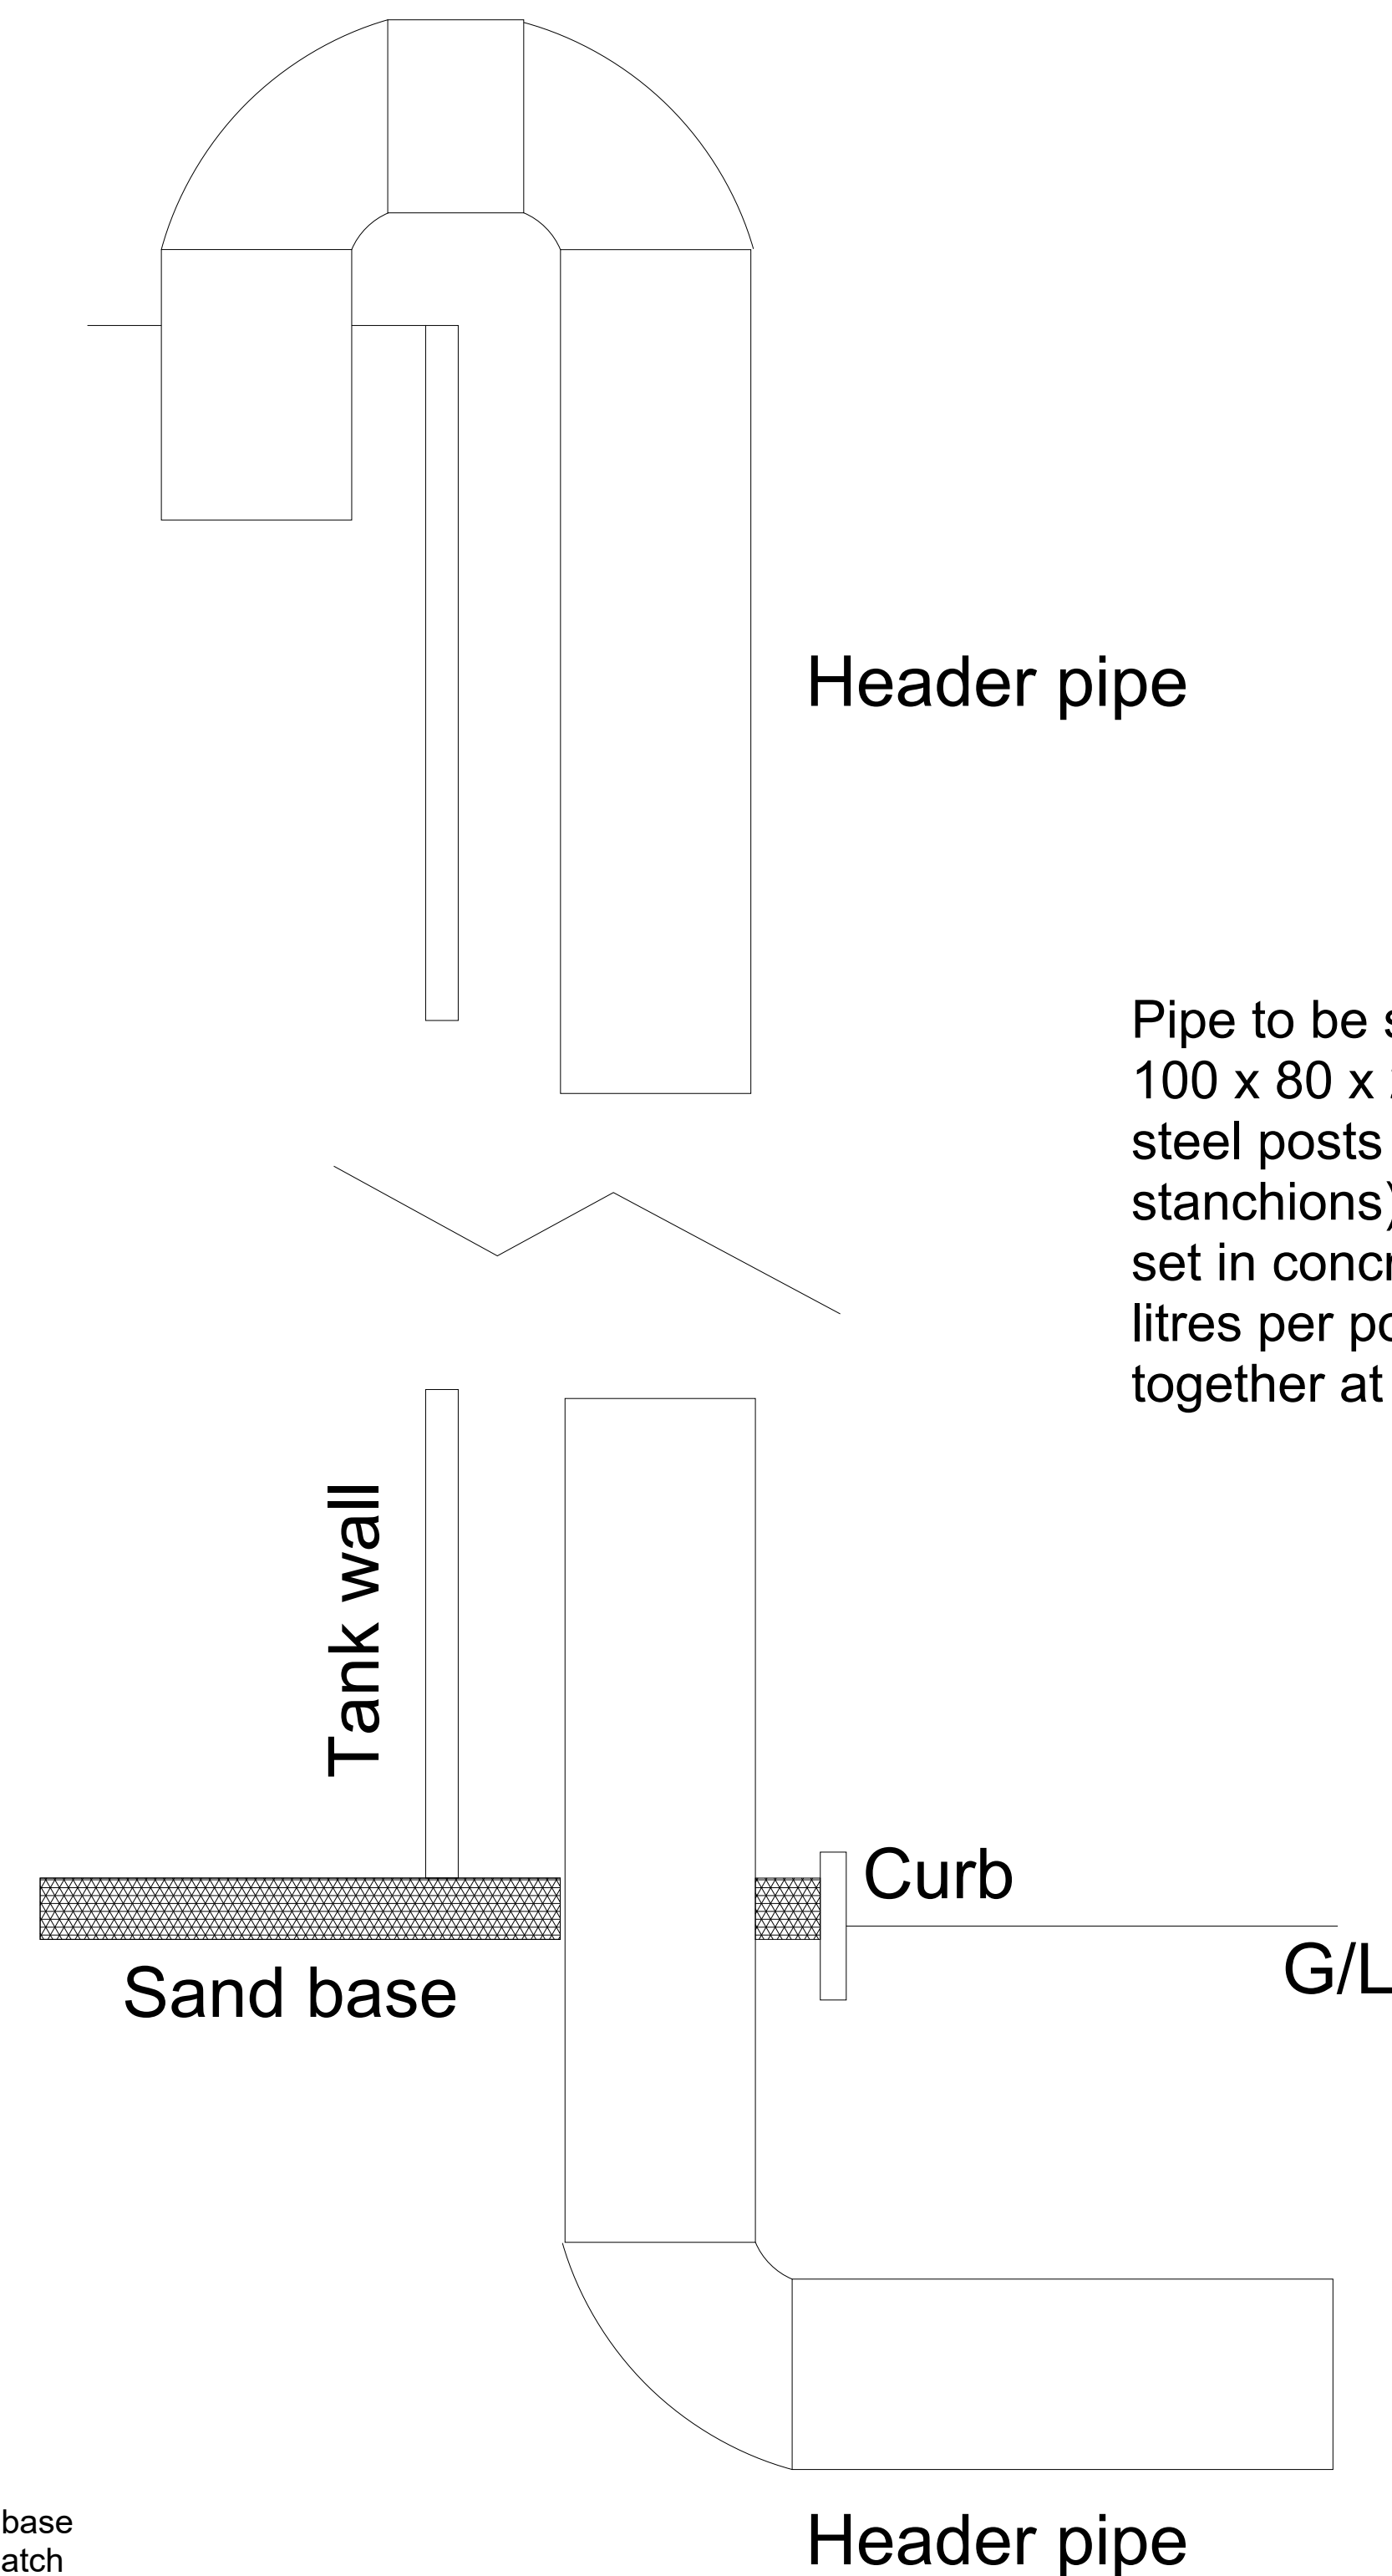

Pipe to be supported by 2 off 100 x 80 x 2.5mm galvanised steel posts (greenhouse stanchions) or equivalent, set in concrete (min 100 litres per post) and braced together at top.

Standard 'Up and over' tank fill from header main (nts)

Lakes Lane Nursery
Fleurie

Drain installation
details.

Drawn by: AM
Date: 22.3.21
Scale:
Revisions:
13.10.25 Text & standard details

Hennock International Ltd

Consulting engineers
to the land based industries
www.hennock.co.uk