


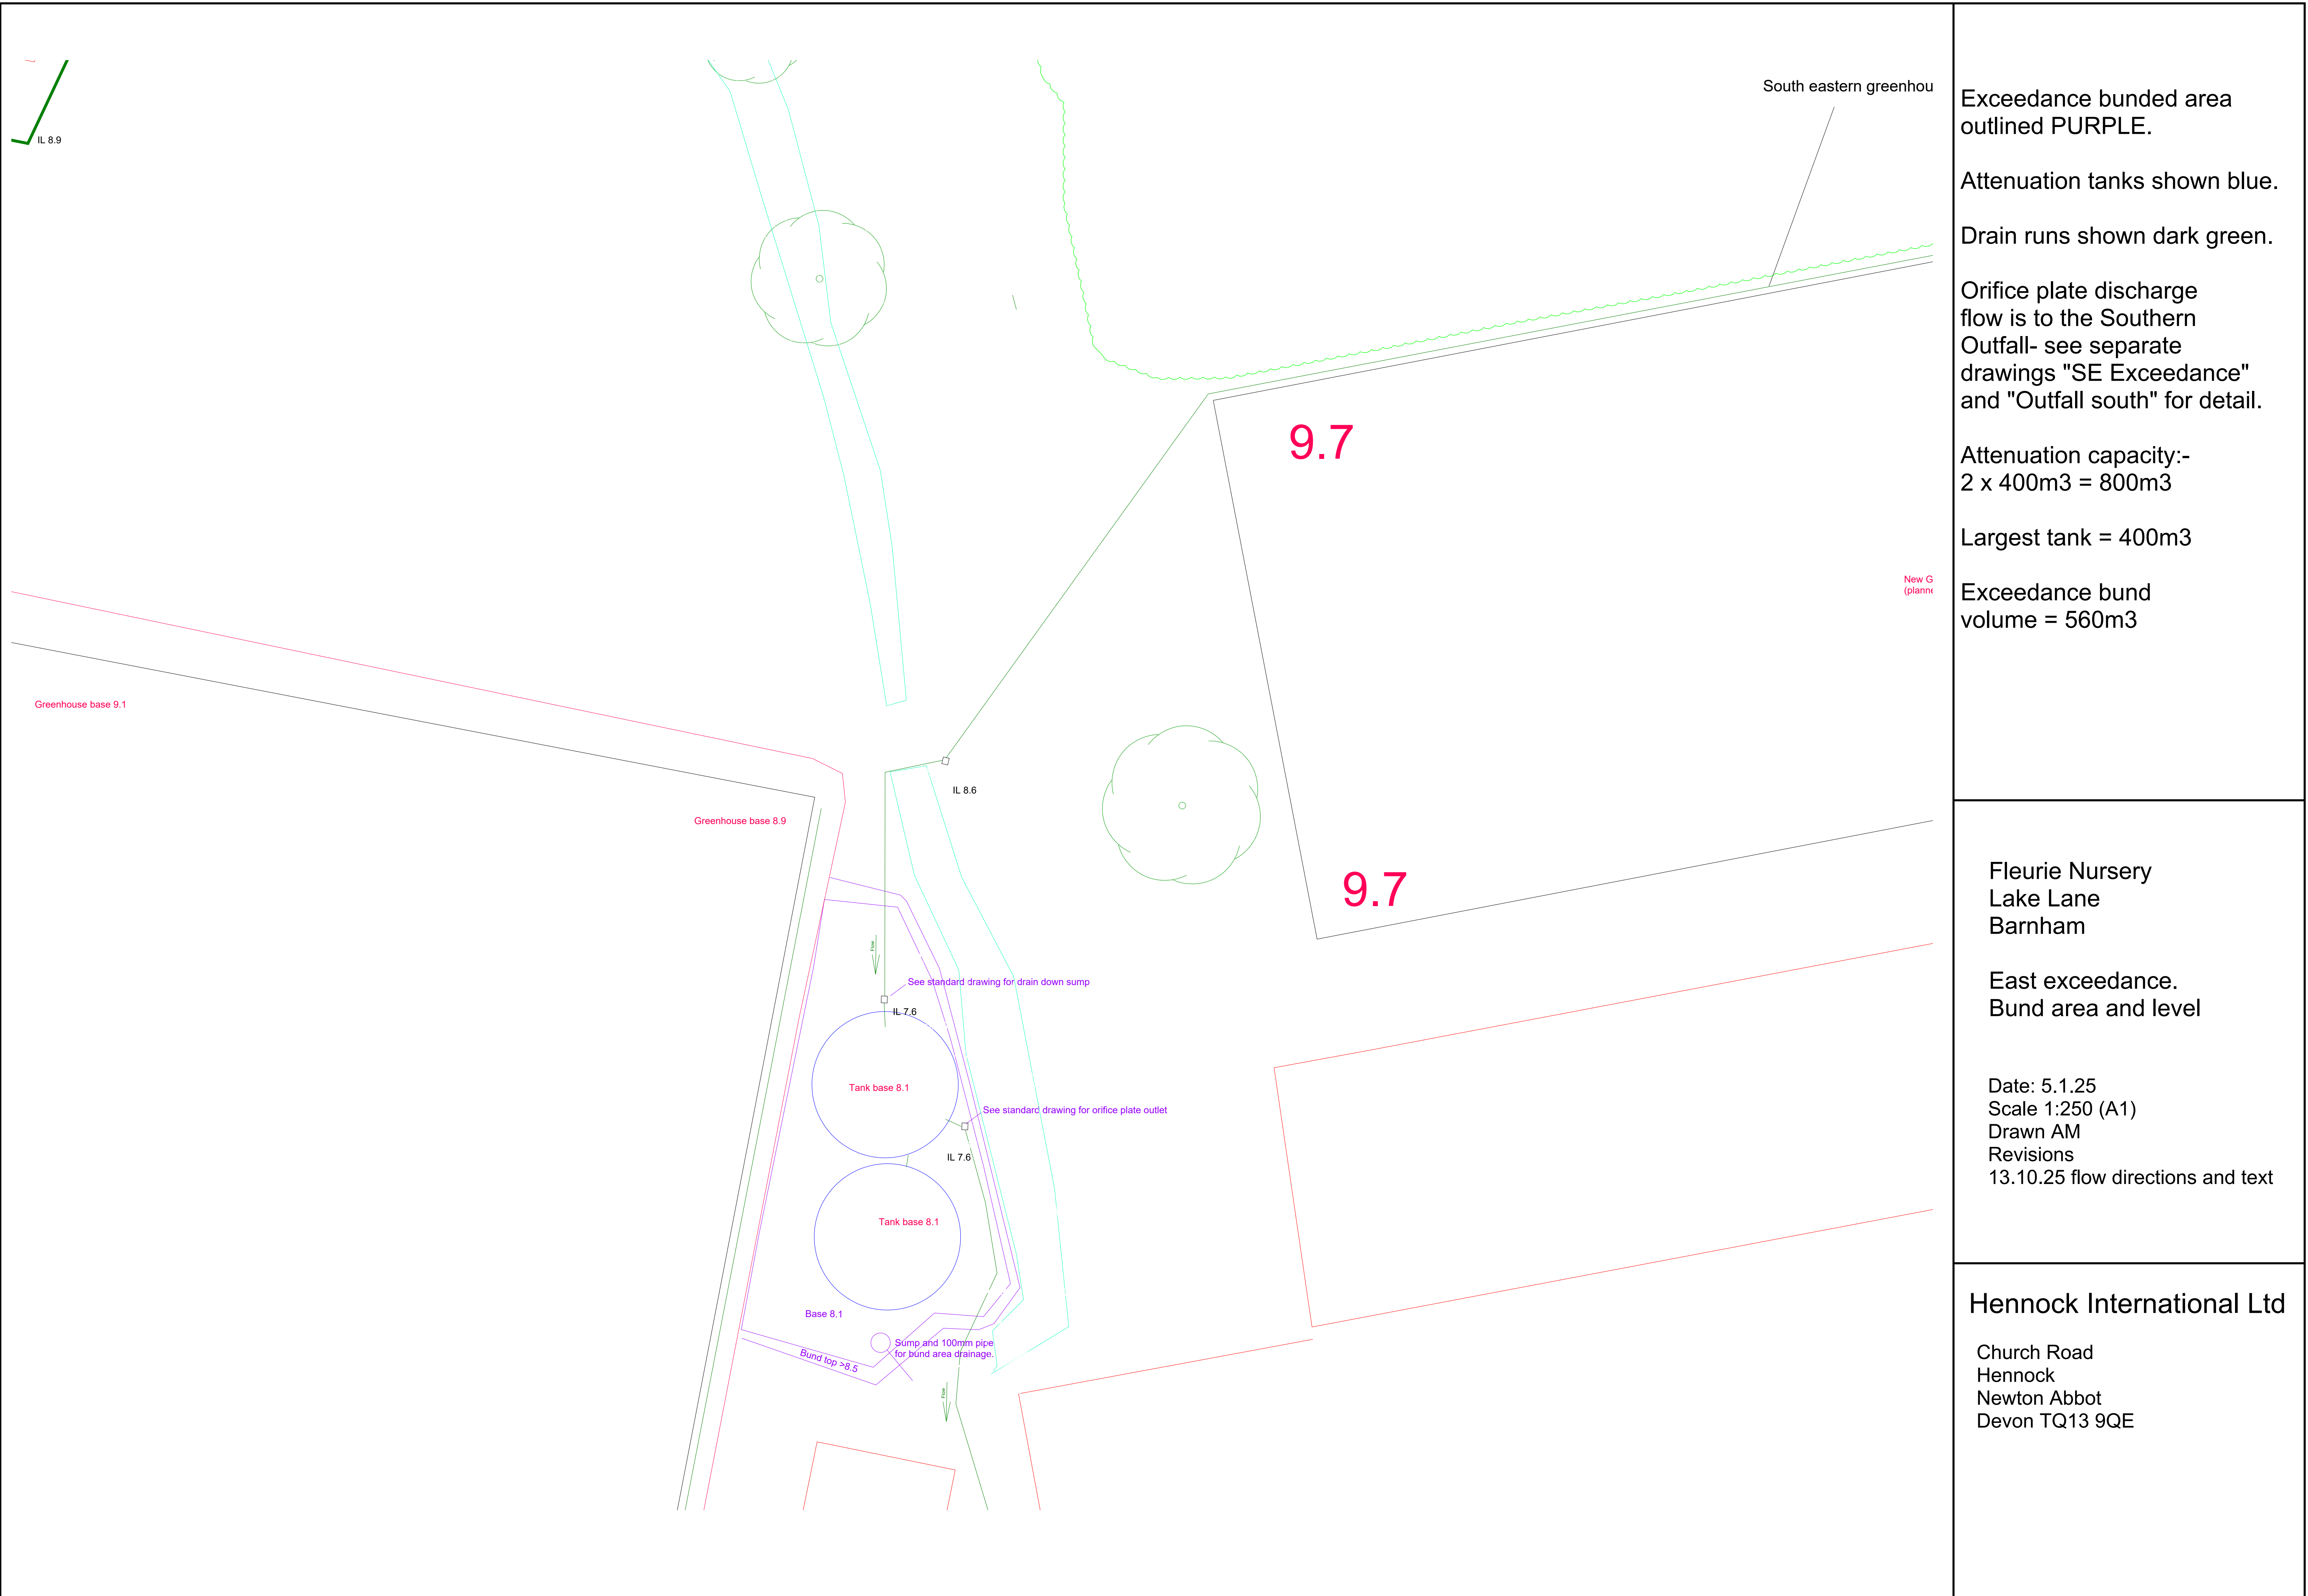

Exceedance bunded area outlined PURPLE.

Attenuation tanks shown blue.

Drain runs shown dark green.

Orifice plate discharge flow is to the Southern Outfall- see separate drawings "SE Exceedance" and "Outfall south" for detail.

Attenuation capacity:-
2 x 400m3 = 800m3

Largest tank = 400m3

Exceedance bund volume = 560m3

Fleurie Nursery
Lake Lane
Barnham

East exceedance.
Bund area and level

Date: 5.1.25
Scale 1:250 (A1)
Drawn AM
Revisions
13.10.25 flow directions and text

Hennock International Ltd

Church Road
Hennock
Newton Abbot
Devon TQ13 9QE