


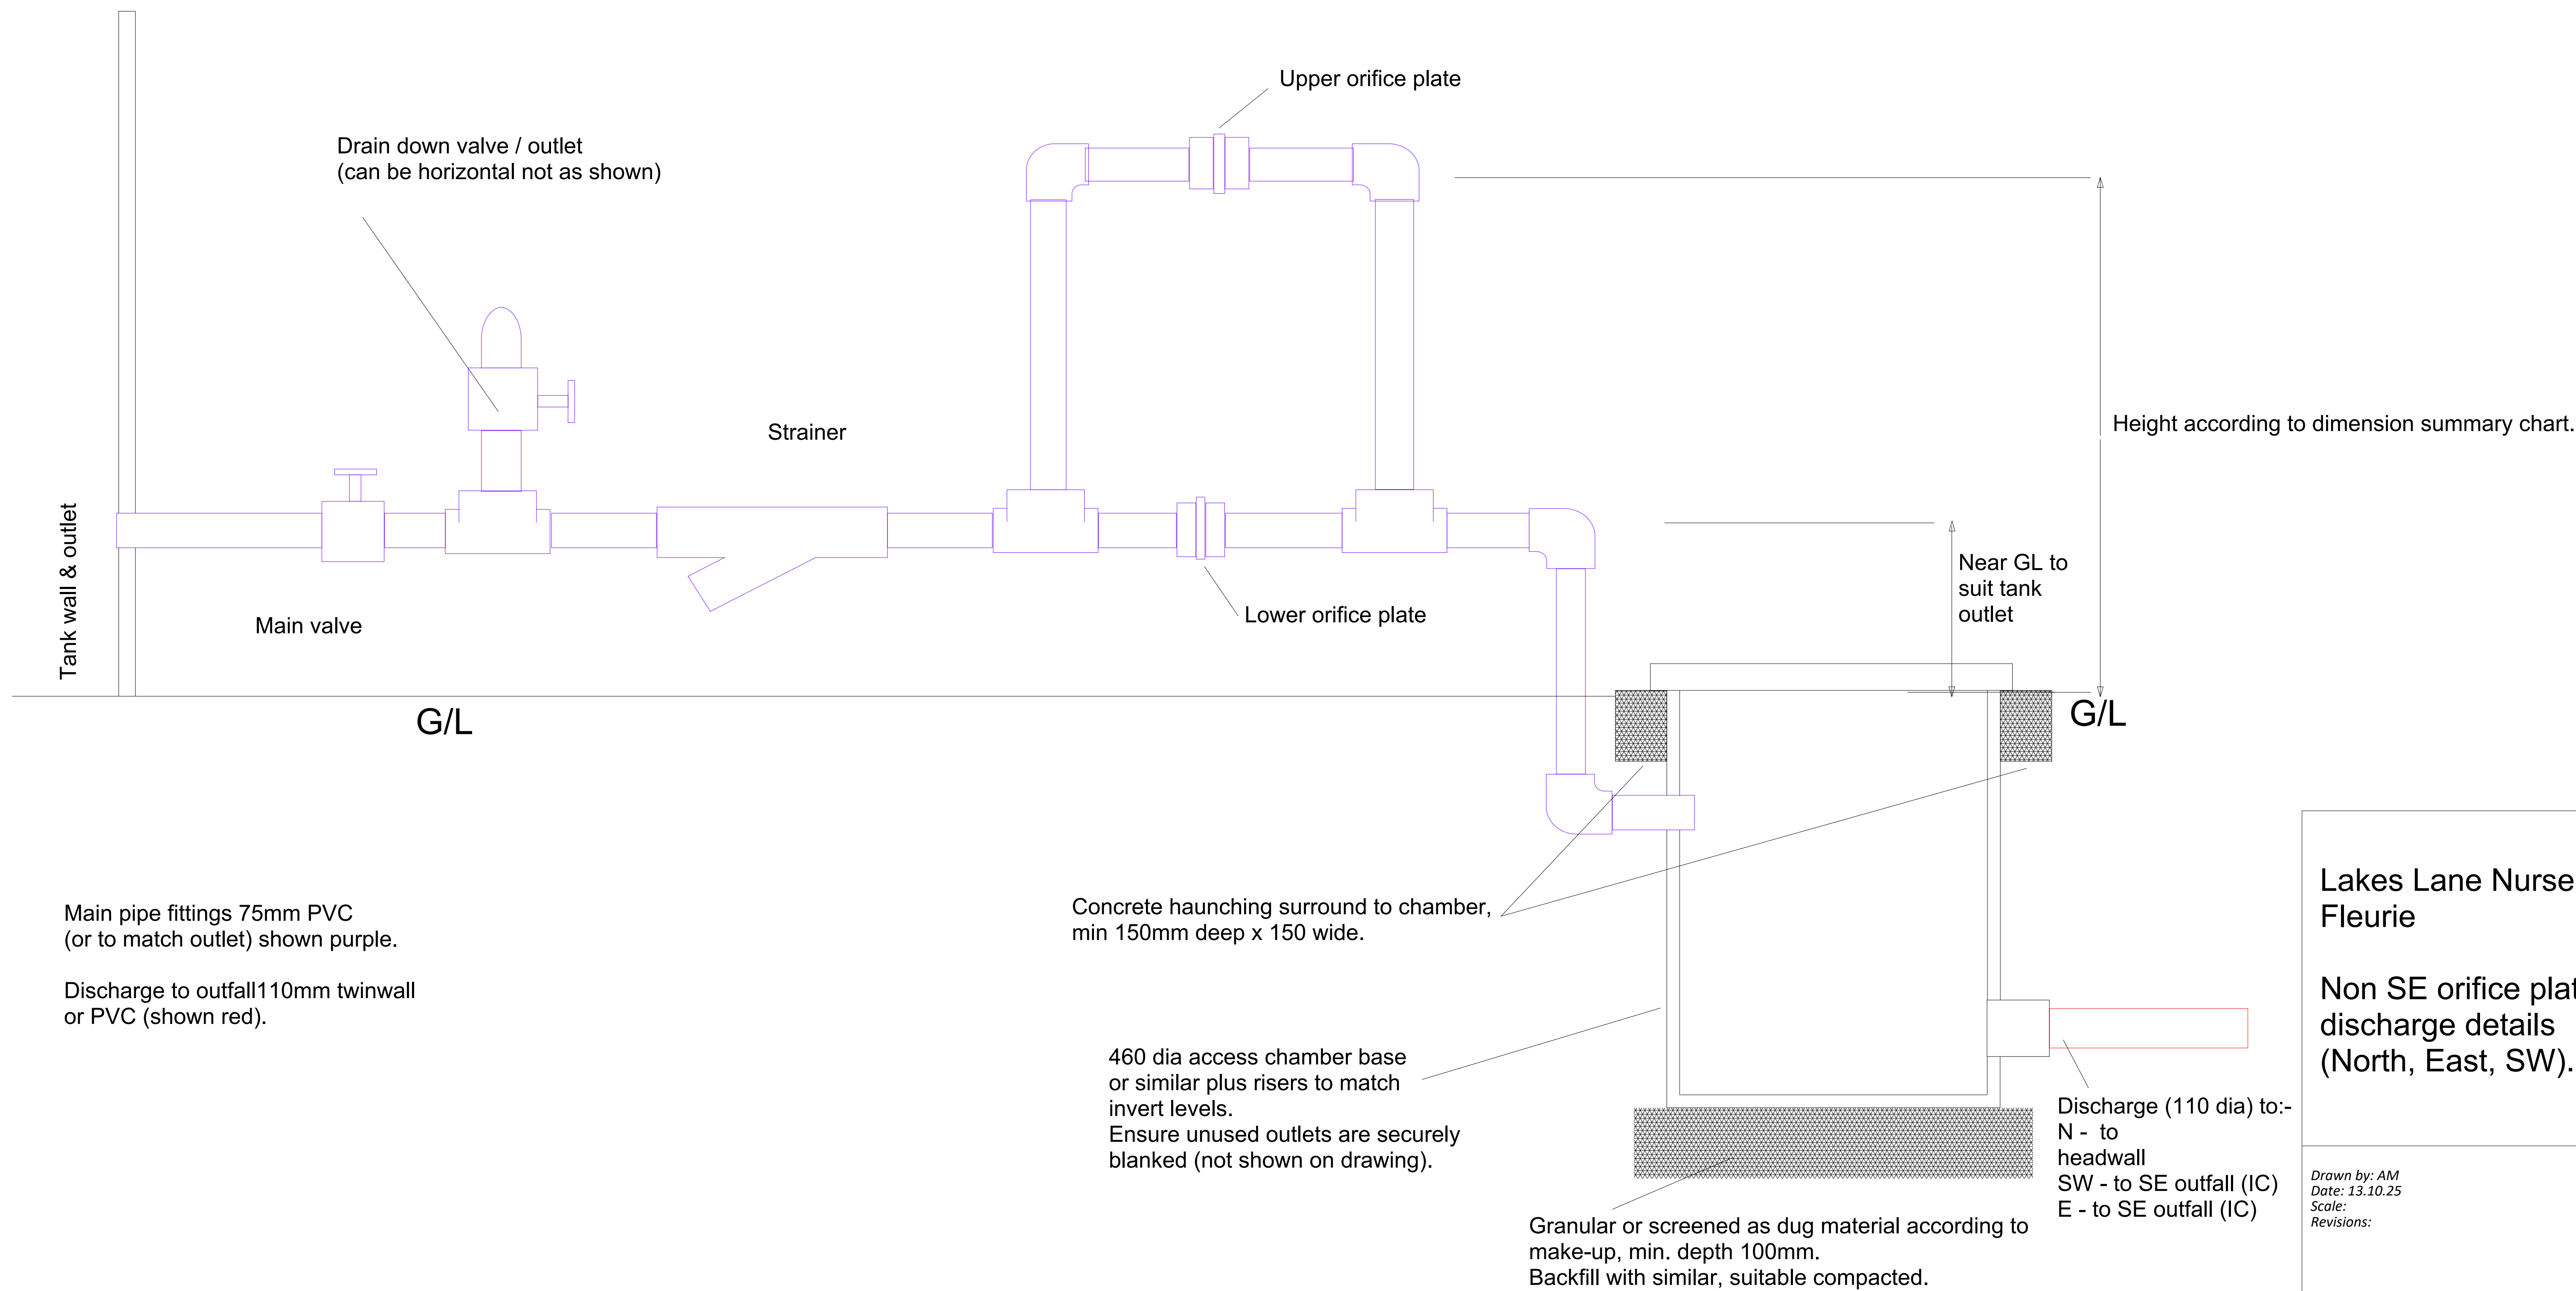

Main pipe fittings 75mm PVC
(or to match outlet) shown purple.

Discharge to outfall 110mm twinwall
or PVC (shown red).

Concrete haunching surround to chamber,
min 150mm deep x 150 wide.

460 dia access chamber base
or similar plus risers to match
invert levels.
Ensure unused outlets are securely
blanked (not shown on drawing).

Granular or screened as dug material according to
make-up, min. depth 100mm.
Backfill with similar, suitable compacted.

Discharge (110 dia) to:-
N - to headwall
SW - to SE outfall (IC)
E - to SE outfall (IC)

Lakes Lane Nursery
Fleurie

Non SE orifice plate
discharge details
(North, East, SW).

Drawn by: AM
Date: 13.10.25
Scale:
Revisions:

Hennock International Ltd

Consulting engineers
to the land based industries
www.hennock.co.uk