


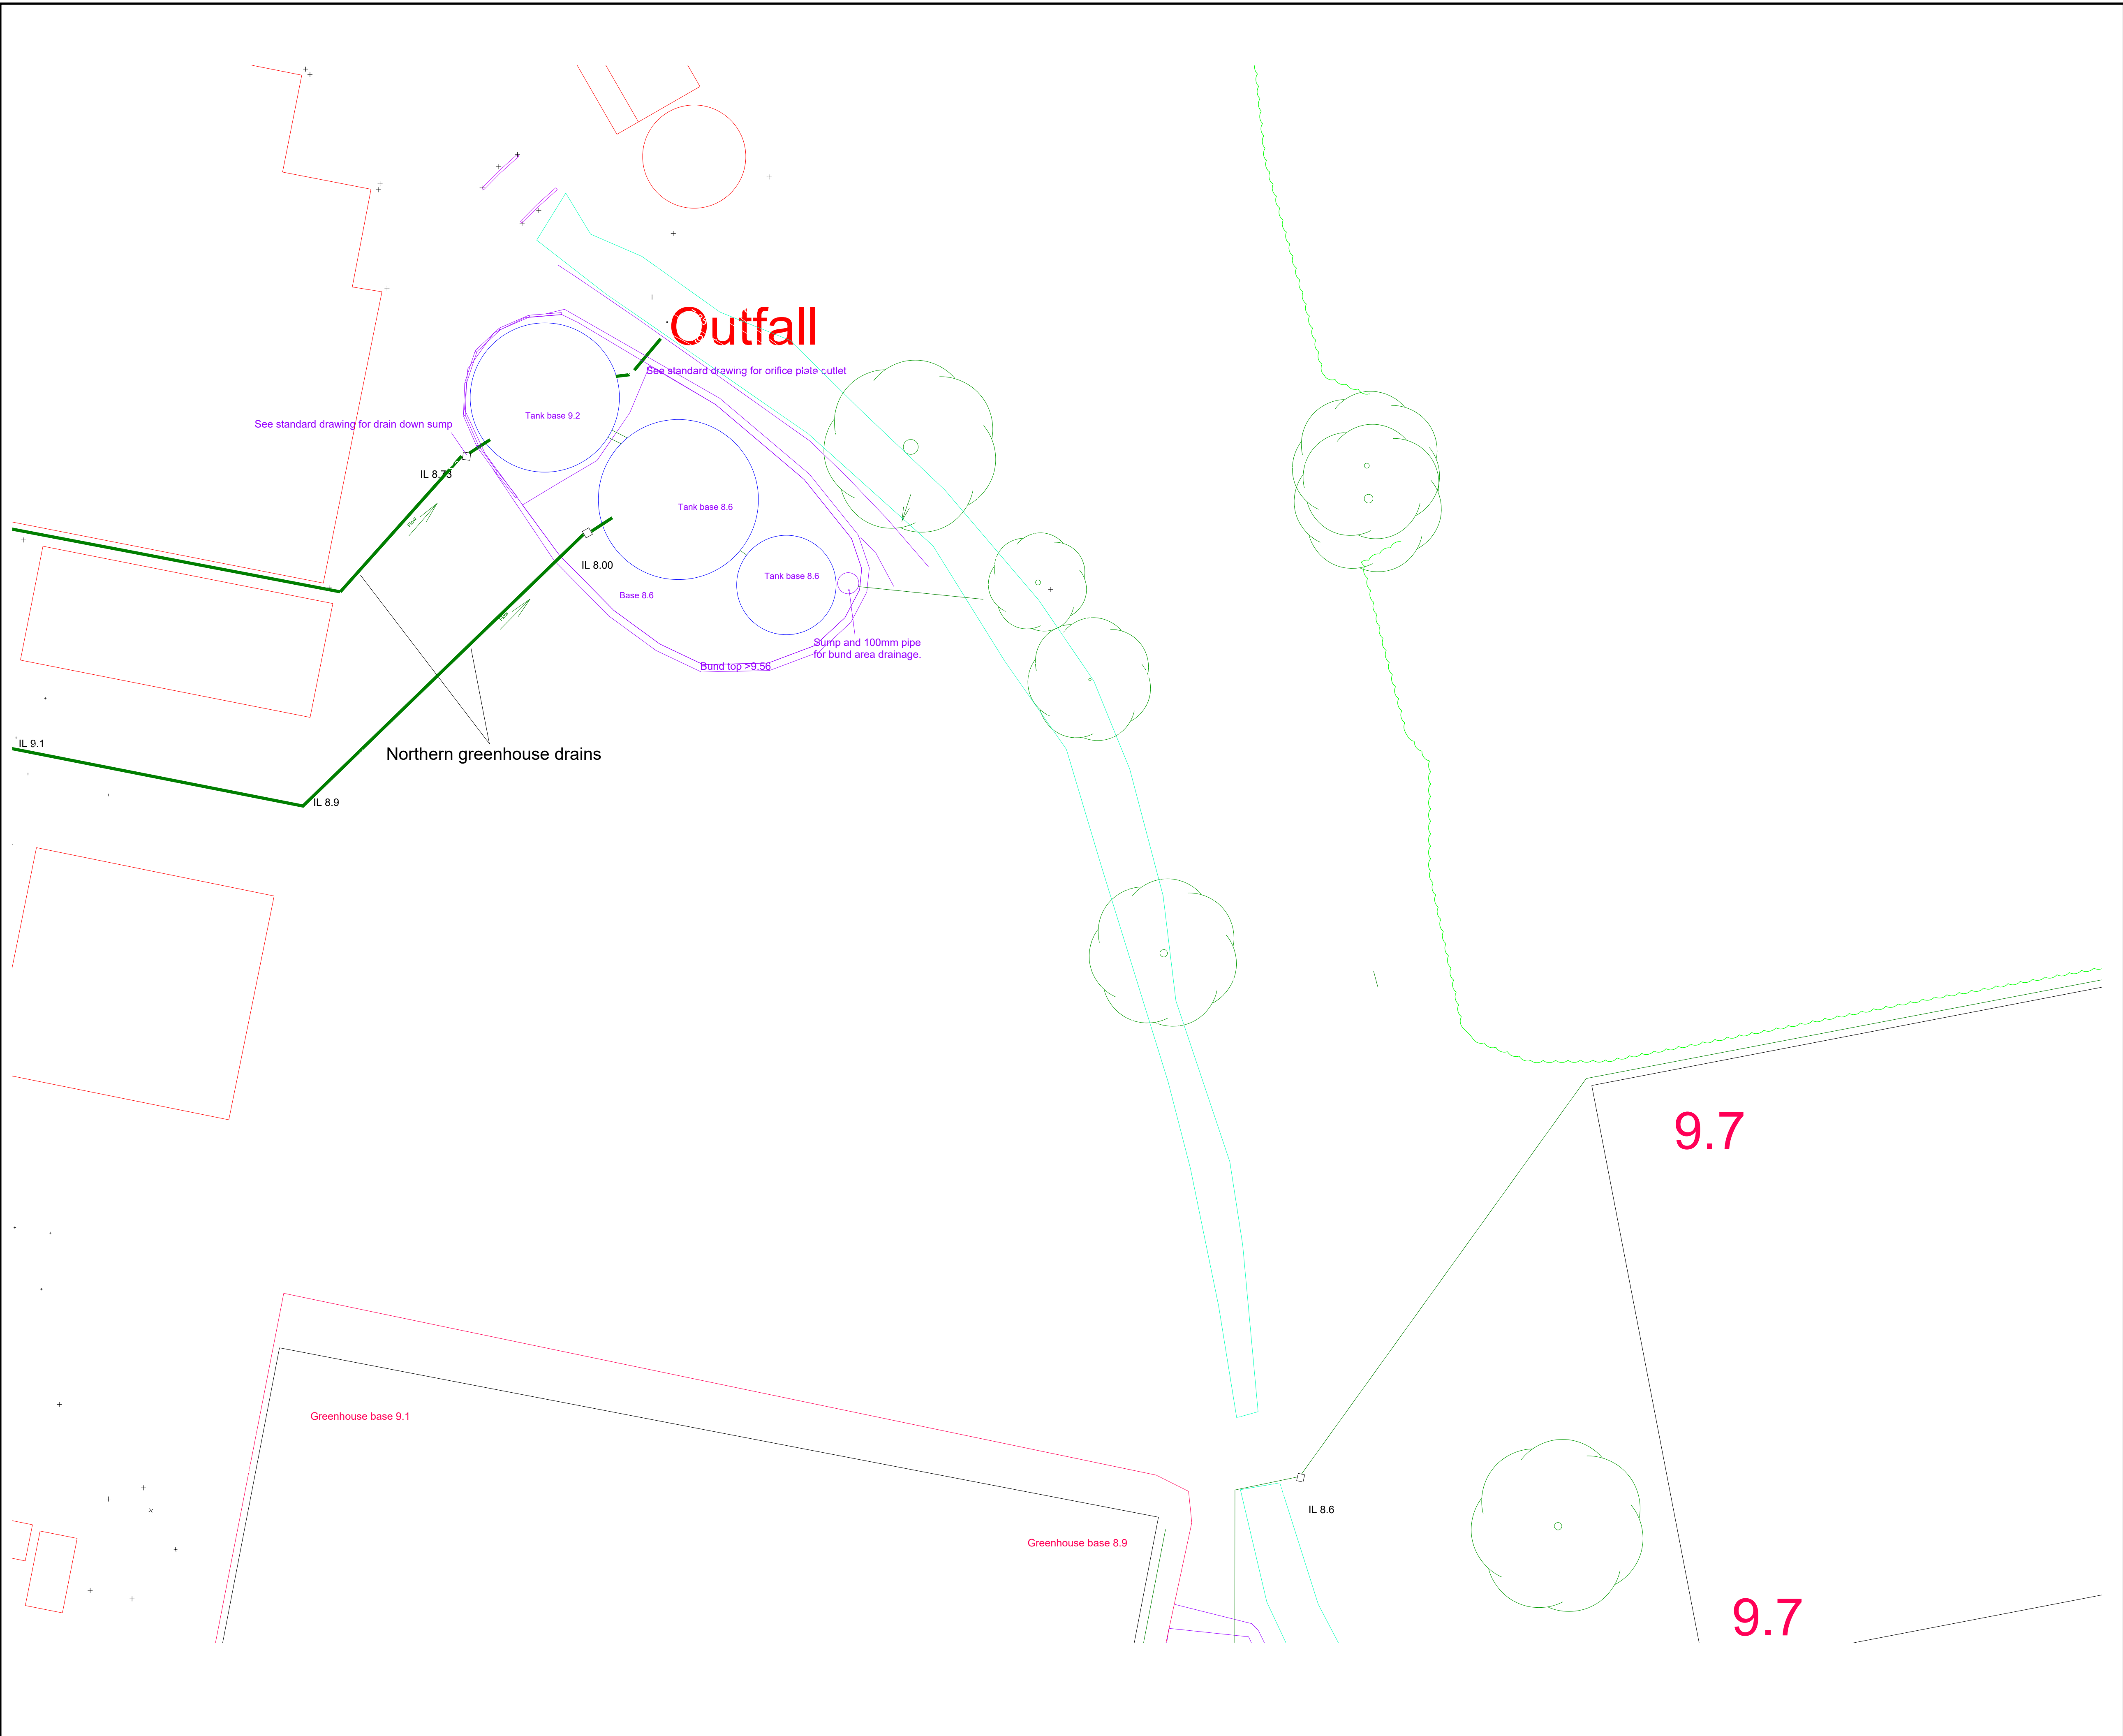

Exceedance bunded area outlined PURPLE.

Attenuation tanks shown blue.

Drain runs shown dark green.

Orifice plate discharge - see separate drawings "N exceedance" and "Outfall north" for detail.

Attenuation capacity:-  
 $338 + 235 + 75 = 648\text{m}^3$

Largest tank =  $338\text{m}^3$

Exceedance bund  
volume =  $338\text{m}^3$

Fleurie Nursery  
Lake Lane  
Barnham

North exceedance  
Bund area and level

Date: 5.1.25  
Scale 1:250 (A1)  
Drawn AM  
Revisions  
14.10 25 Text, flow, bund area

Hennock International Ltd

Church Road  
Hennock  
Newton Abbot  
Devon TQ13 9QE