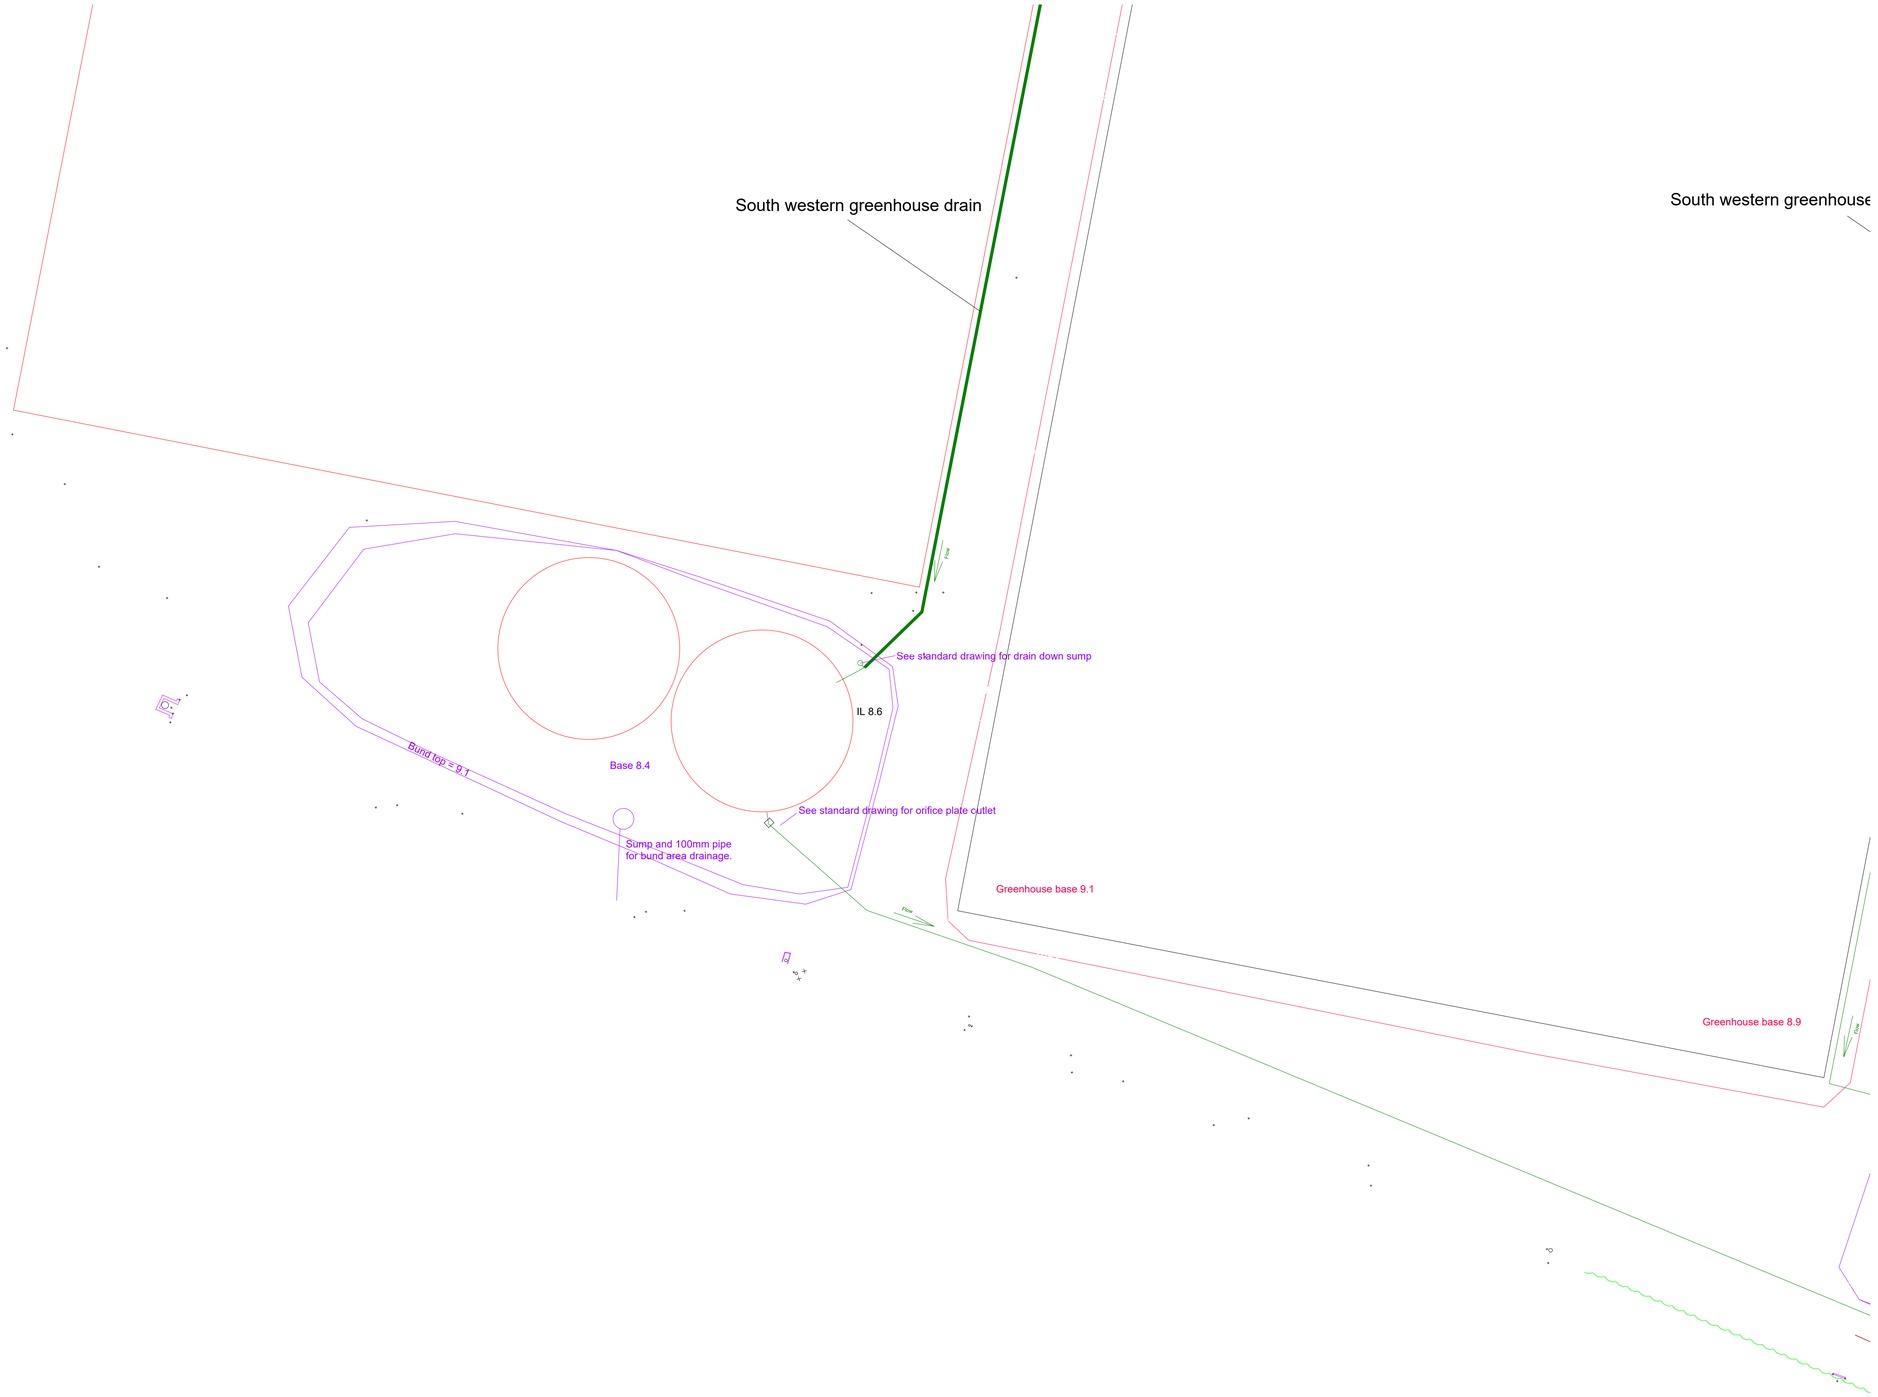



Exceedance bunded area outlined PURPLE.

Attenuation tanks shown blue.

Drain runs shown dark green.

Orifice plate discharge is via the South Outfall - see separate drawings "SE exceedance" and "Outfall south" for detail.

Attenuation capacity:-
2 x 512m3 = 1024m3

Largest tank = 512m3

Exceedance bund volume = 518m3

Fleurie Nursery
Lake Lane
Barnham

SW exceedance
Bund area and level

Date: 23.11.23
Scale 1:250 (A1)
Drawn AM
Revisions 1.1.25 Additional small tank
13.10.25 - flow & minor tweeks

Hennock International Ltd

Church Road
Hennock
Newton Abbot
Devon TQ13 9QE