



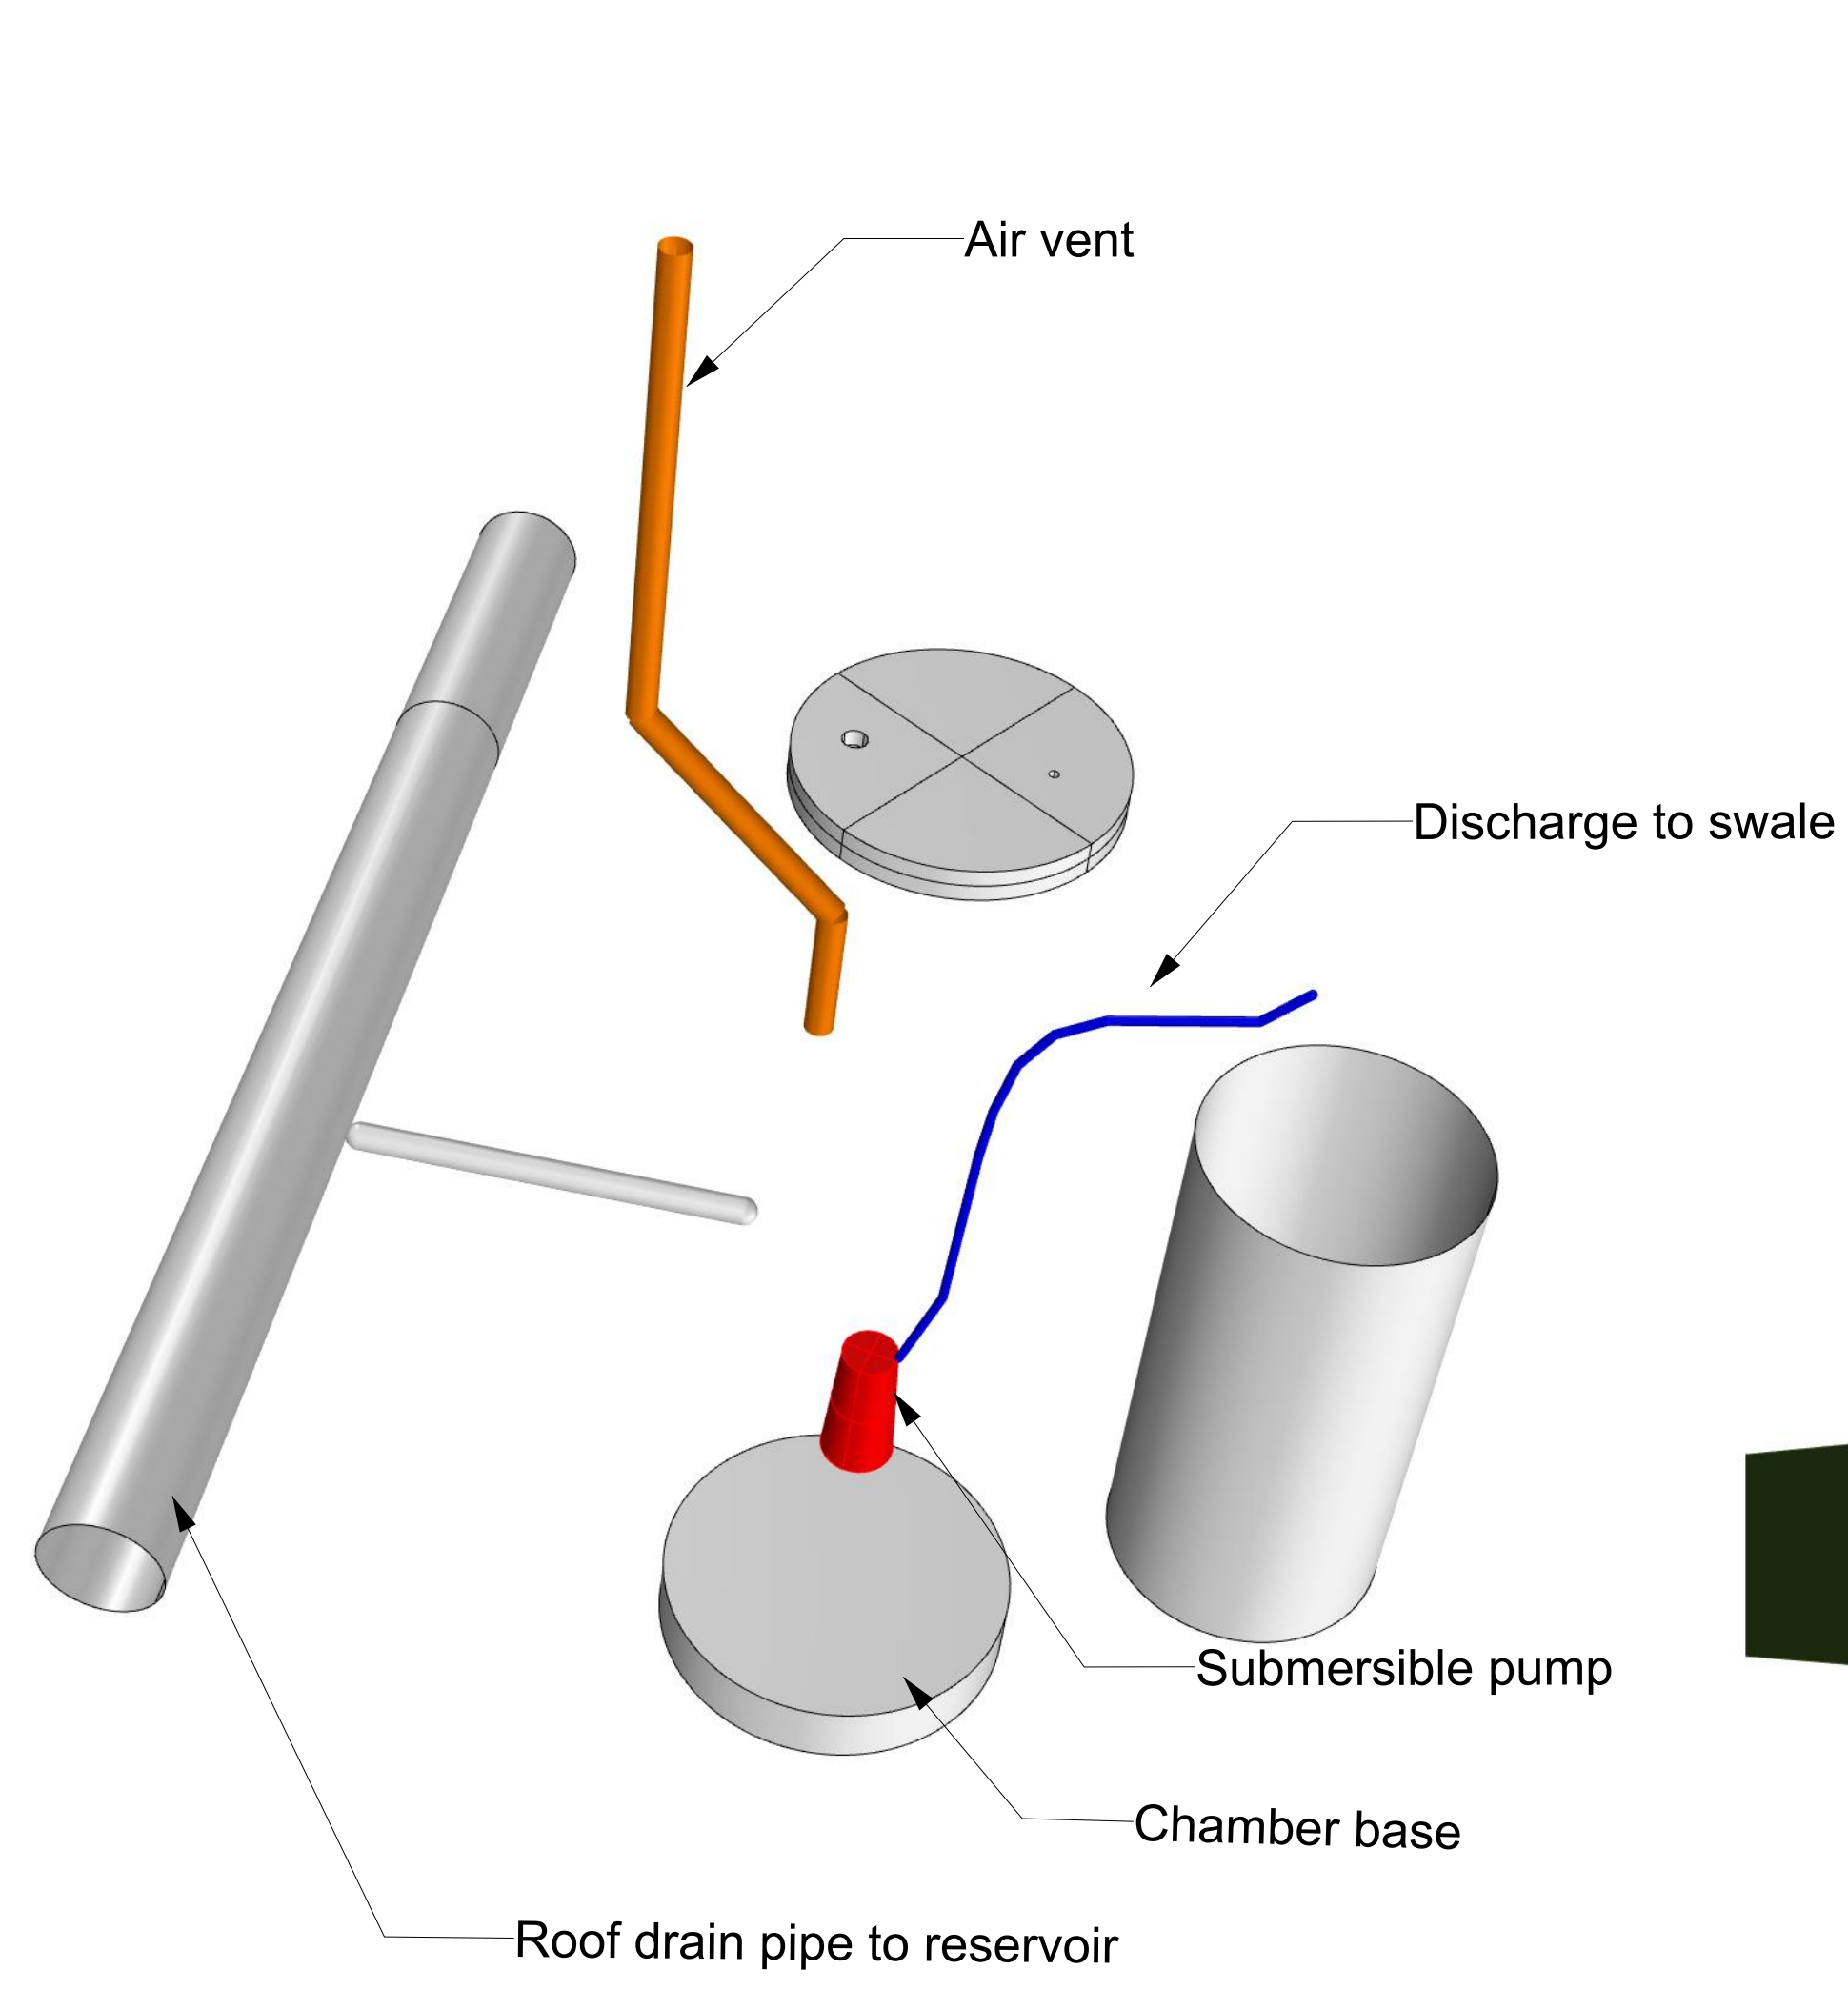

Exploded diagram

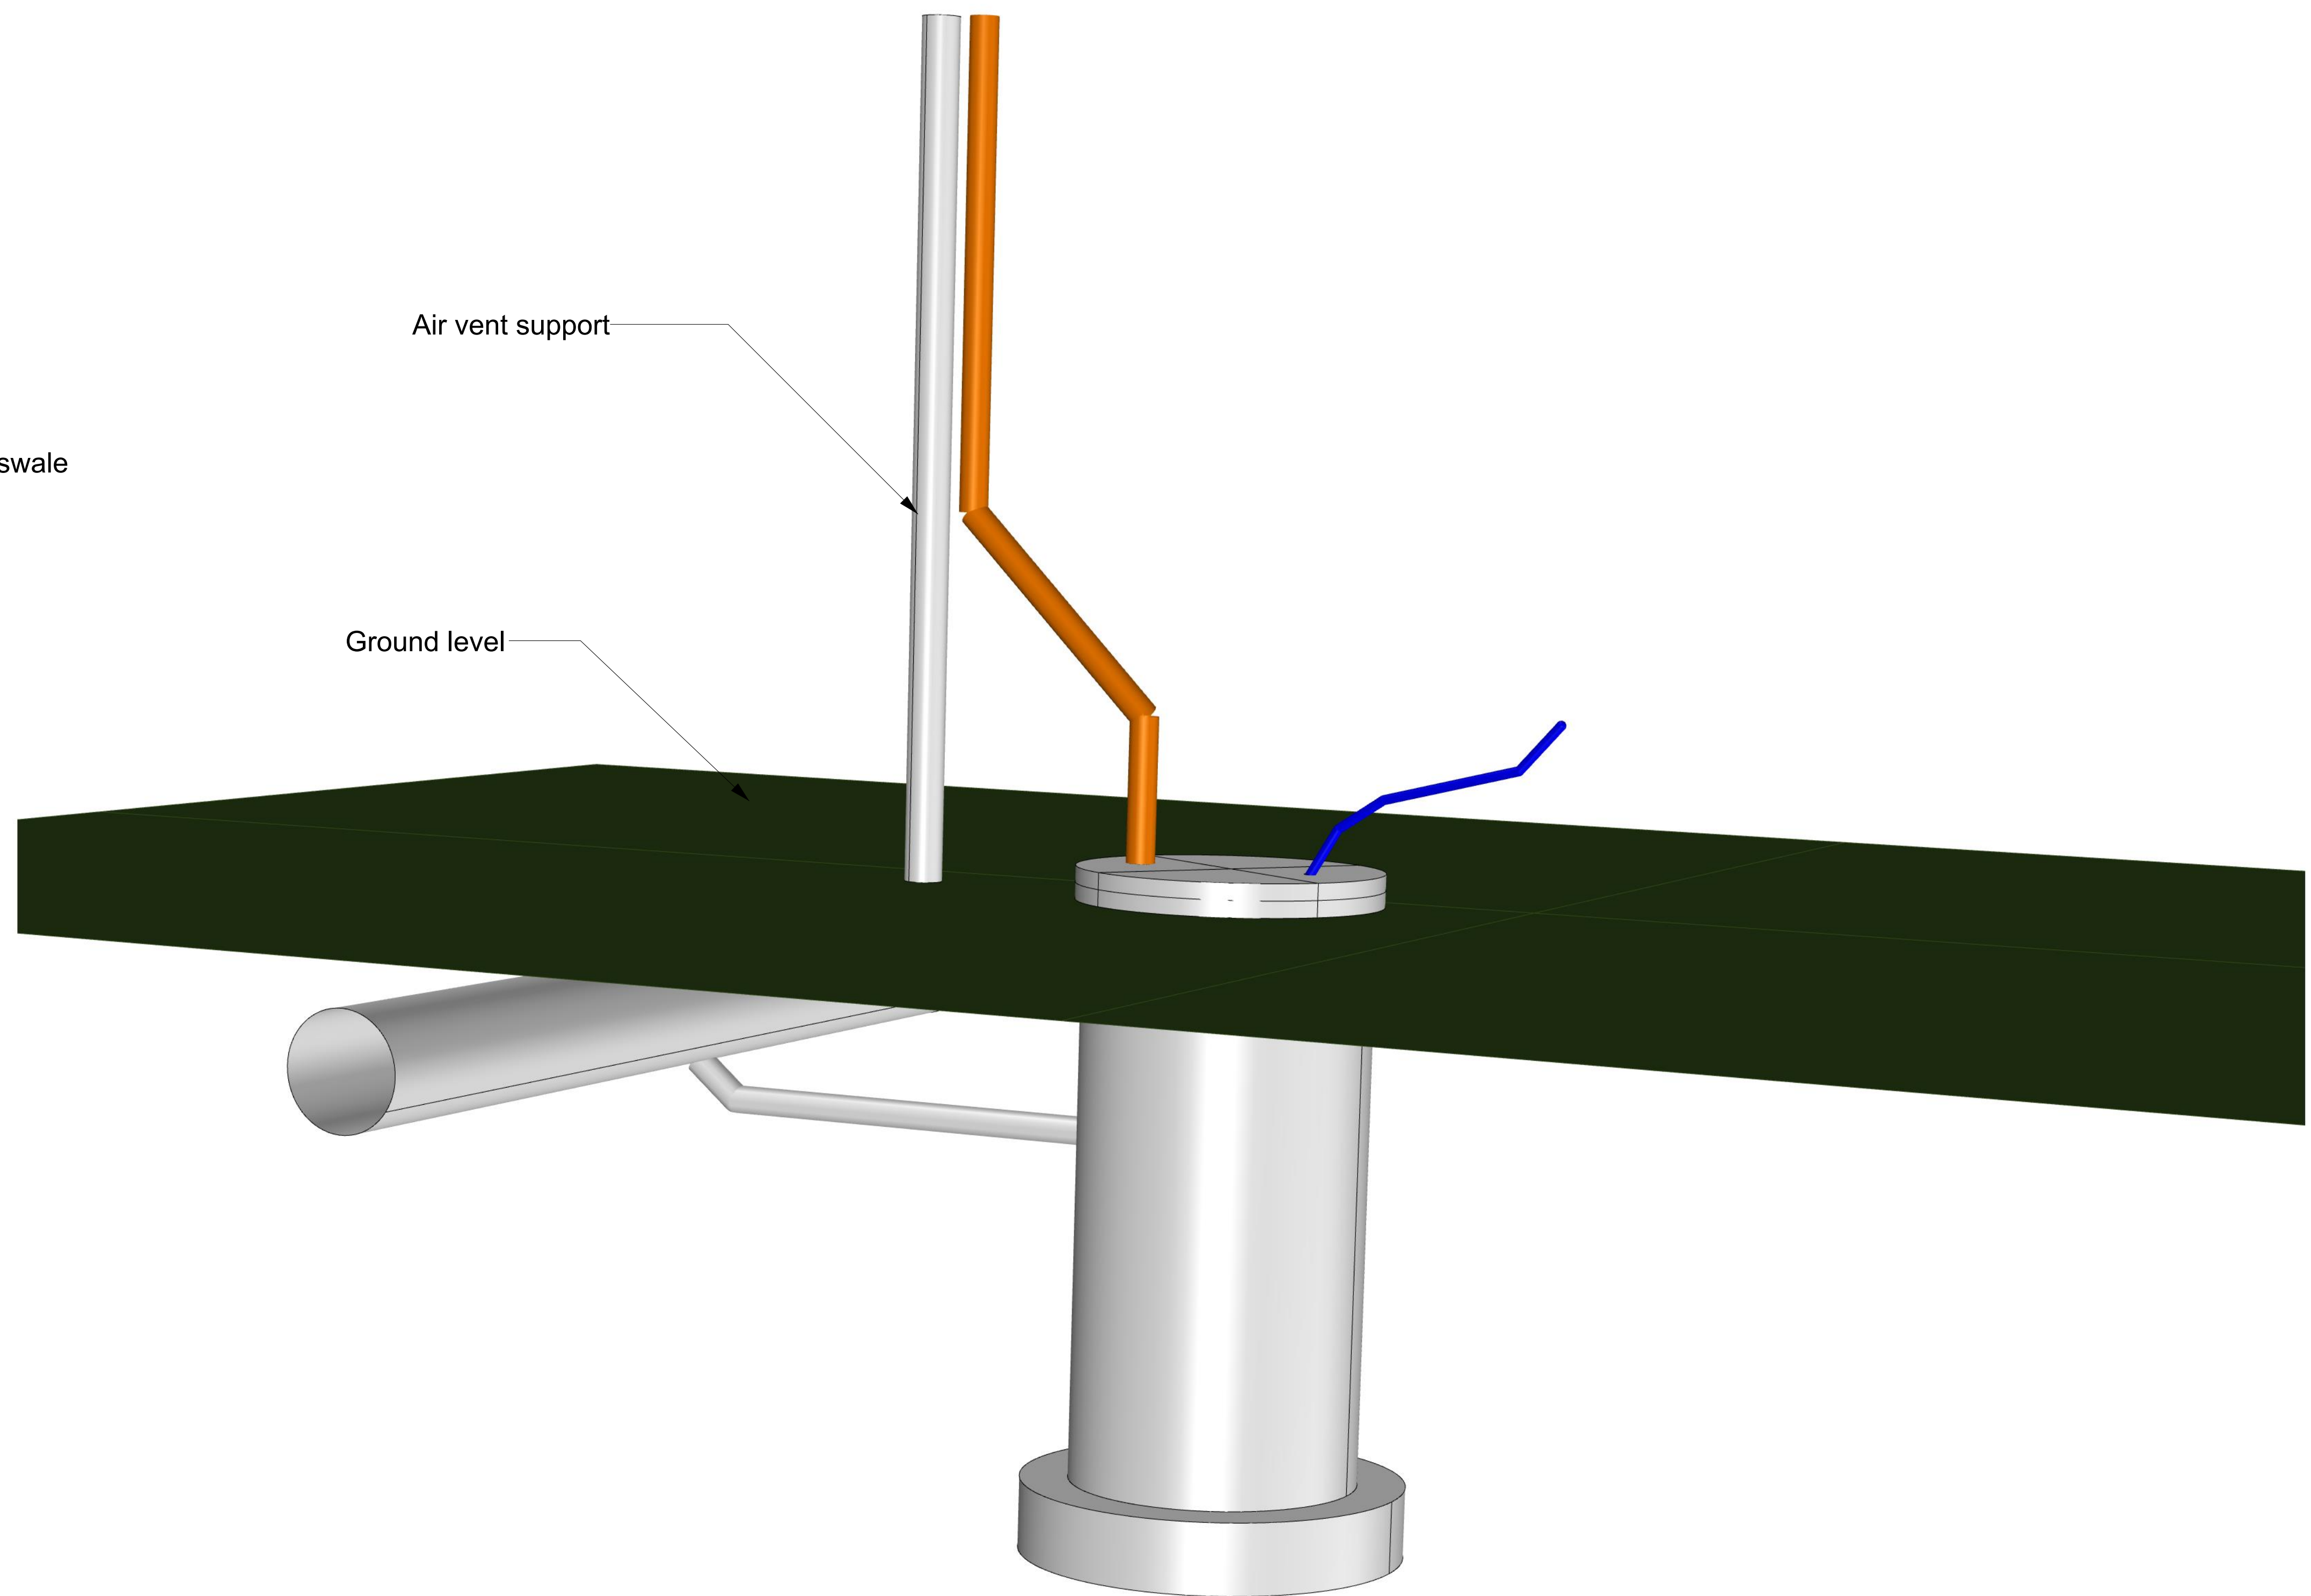

Fleurie, Lake Lane.
 Basic drain down sump design
 600 dia chamber / rings on concrete base. Sealed type manhole cover with
 2 cut outs for vent pipe and discharge pipe, to be sealed with non-setting compound.
 Air vent to top of tank plus 0.5m.
 Lowara DOC-3 sump pump on auto float switch.
 Minimum discharge head 6m, typical size 400W.
 Connection to main roof drain by saddle T

Fleurie, Lake Lane, Barnham

Title: Drain down sump design

Hennock International Ltd