


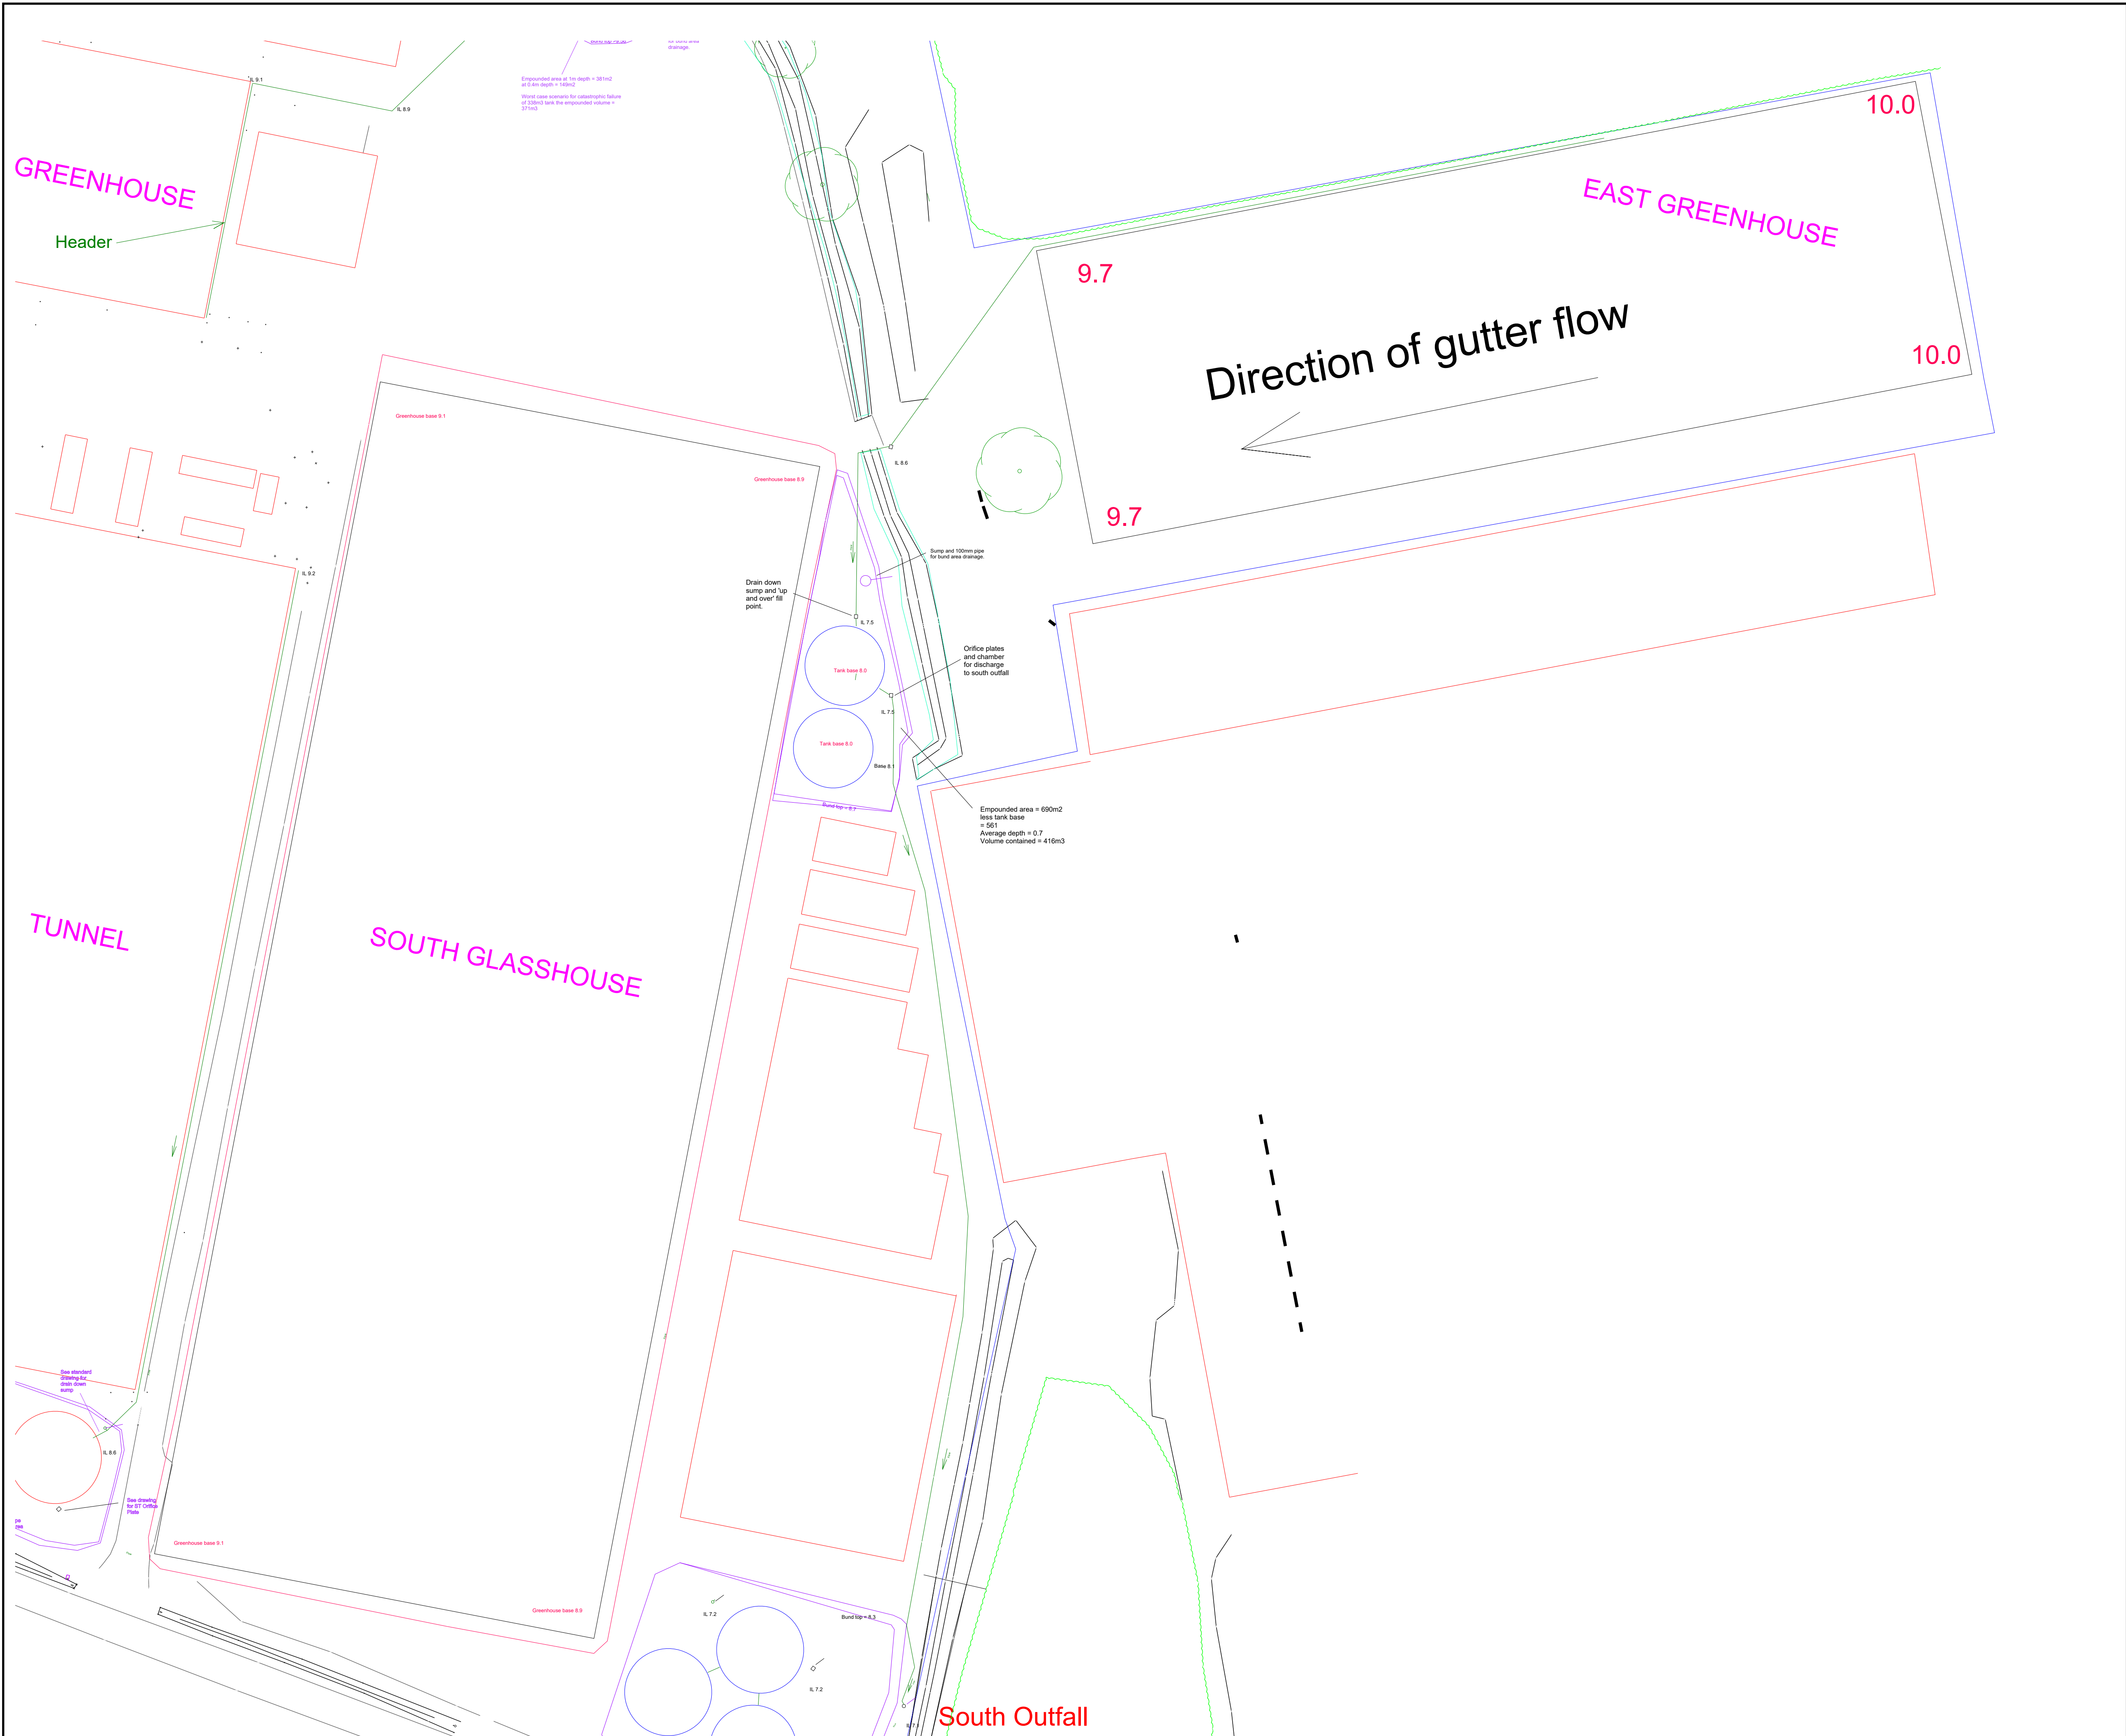

East glasshouse.

Due to the length of the greenhouse there is an internal cross header as well as an end of house header. These connect to the external drains and take the water to the attenuation tanks. These are 2 x 400m3 capacity, and there is a controlled discharge to the South Outfall.

See also drawings "East Orifice Plate", "East Pipe and Invert" and "South Outfall".

Fleurie Nursery
Lake Lane
Barnham

East Drainage

Date: 15.10.25
Scale 1:500 (A1)
Drawn AM

Revisions
31.1.26 Split drawing

Hennock International Ltd

Church Road
Hennock
Newton Abbot
Devon TQ13 9QE