


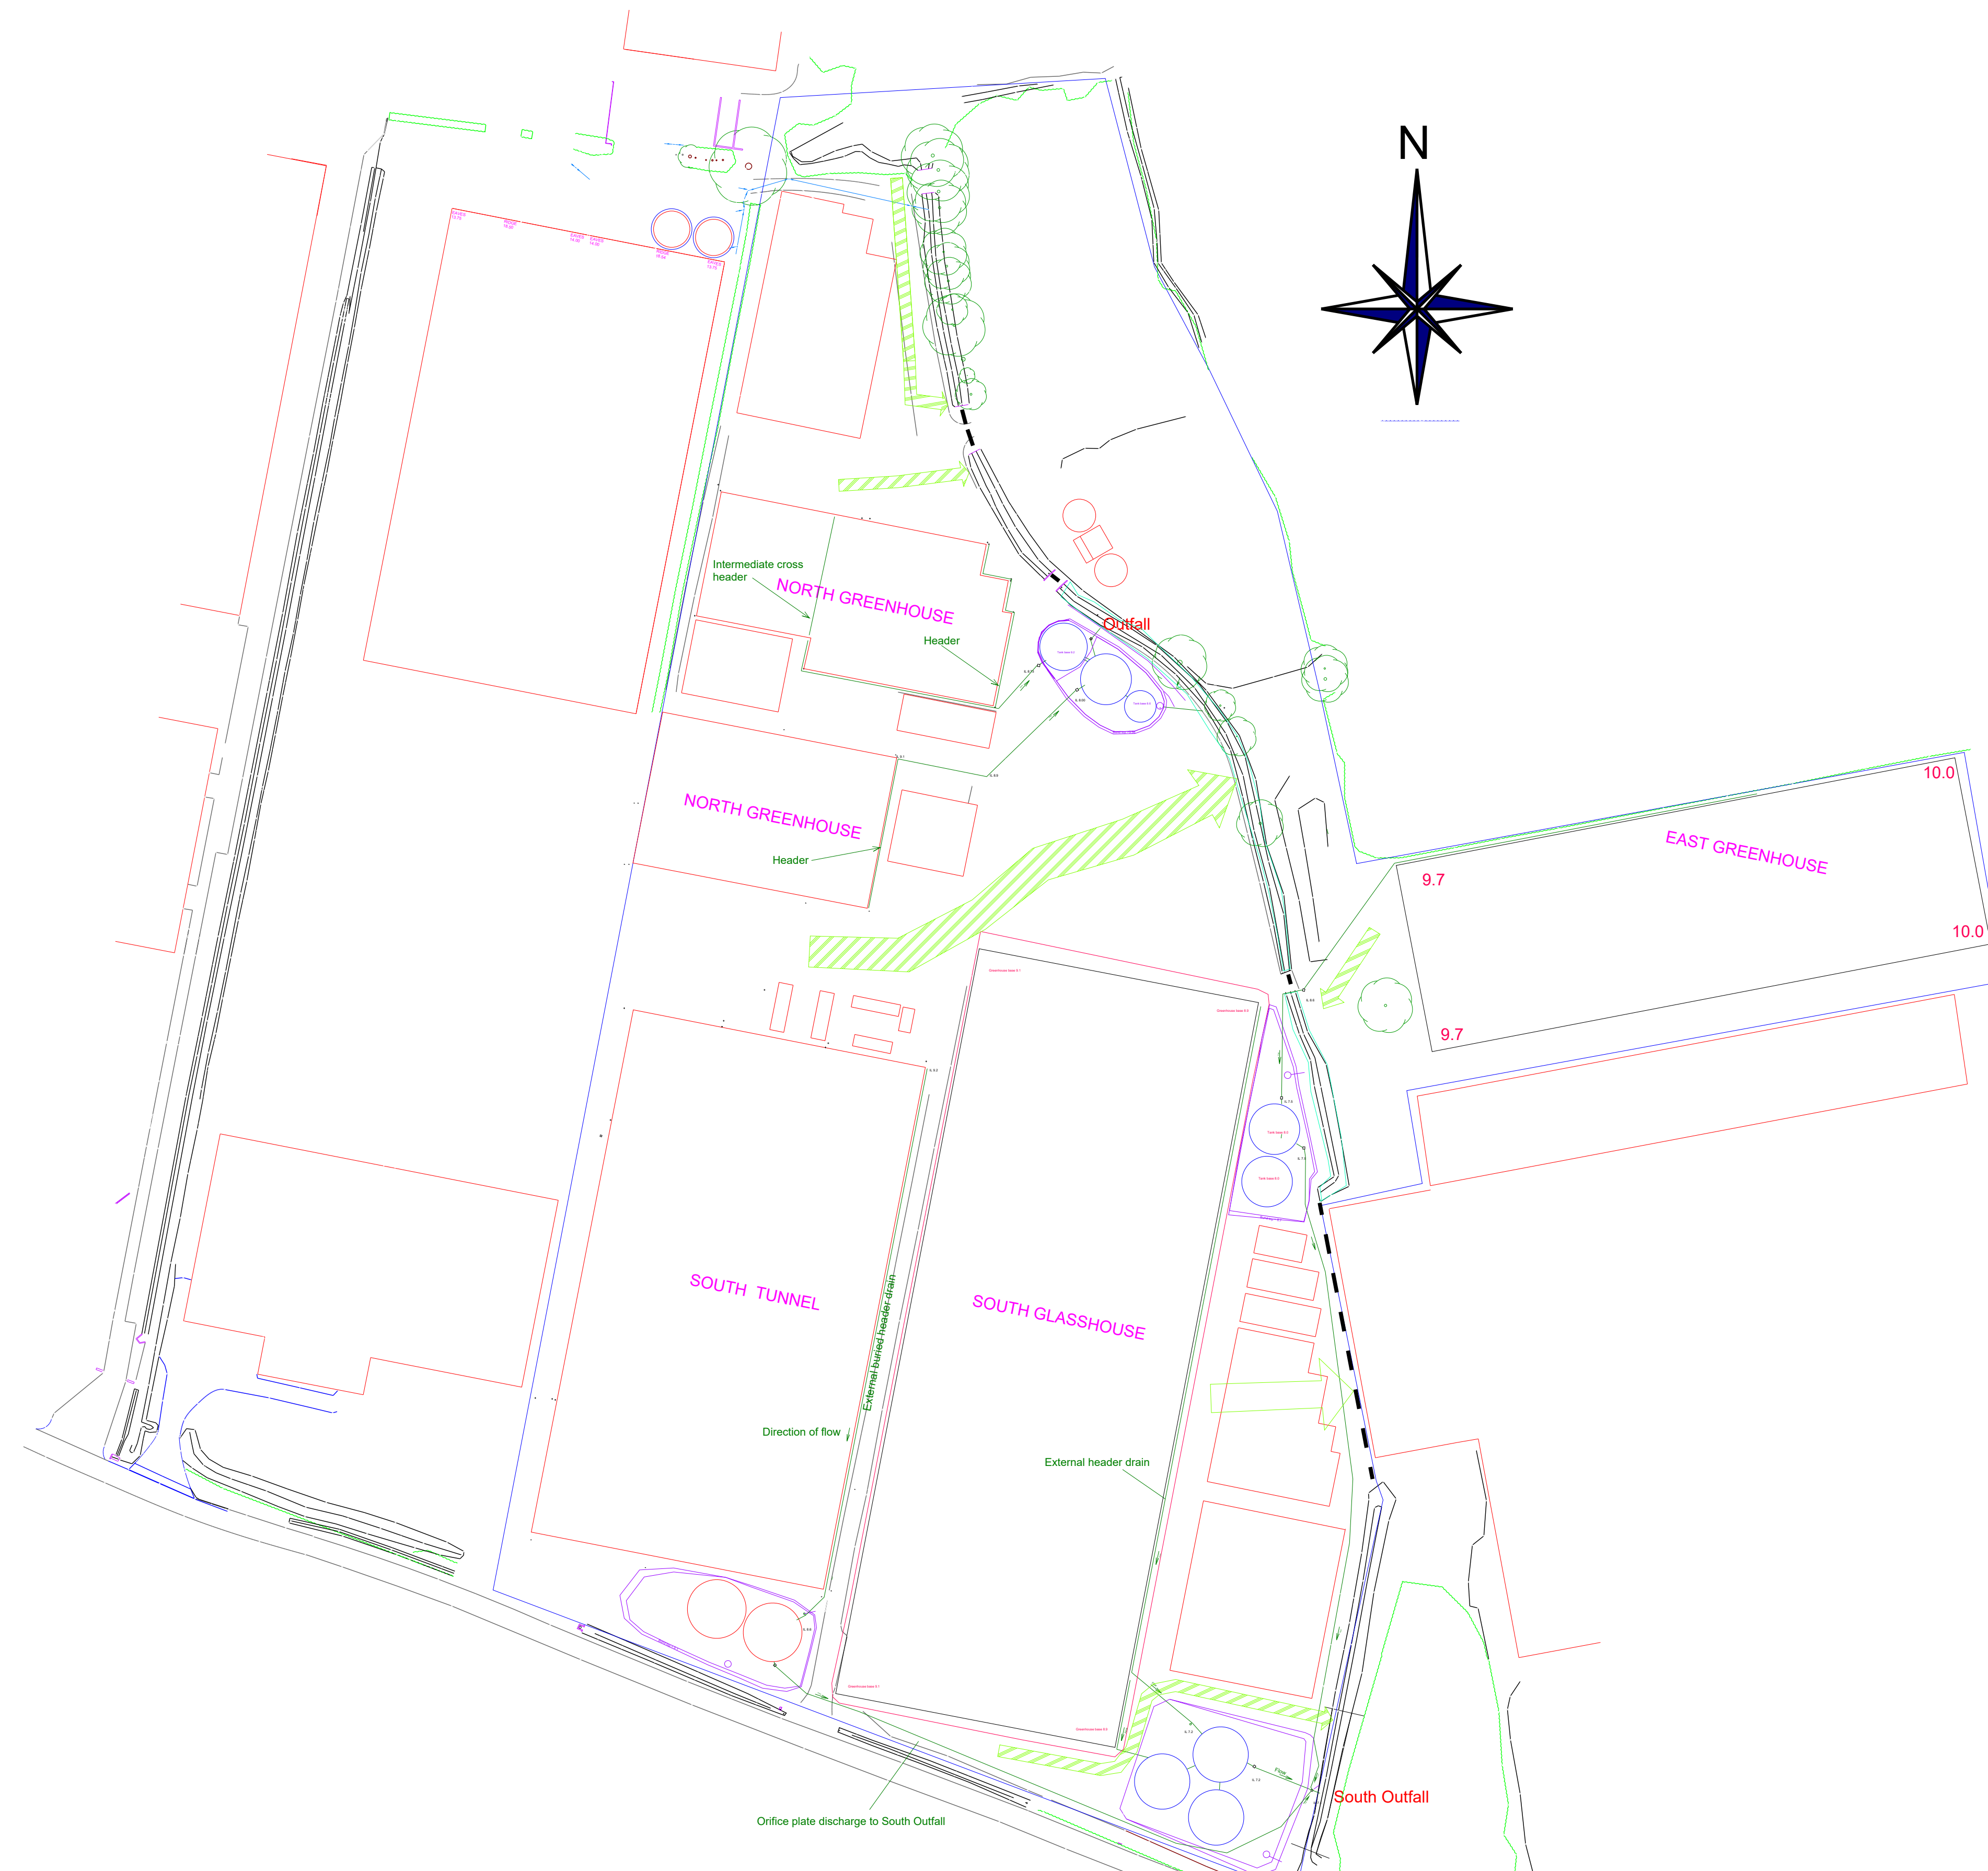

Exceedance routes

Attenuation contains 1:100 +40% CCA of the rainfall on the structures, which this application relates to.

Exceedance from the catastrophic failure of a tank is contained within the bunded exceedance areas. In the event of rainfall greater than 1:100 +40% this would be contained within the bunds with release from these through drains as shown on exceedance drawings (North, South Tunnels, South Glass, East).

Surface flows from non structure areas such as plant beds, permeable yard areas etc. greater than infiltration rate are shown by green hatched arrows.

These are based on the spot levels from the topo survey, following the contours.

Fleurie Nursery
Lake Lane
Barnham

Exceedance routes

Date: 5.2.26
Scale 1:1000 (A1)
Drawn AM

Revisions

Hennock International Ltd

Church Road
Hennock
Newton Abbot
Devon TQ13 9QE