


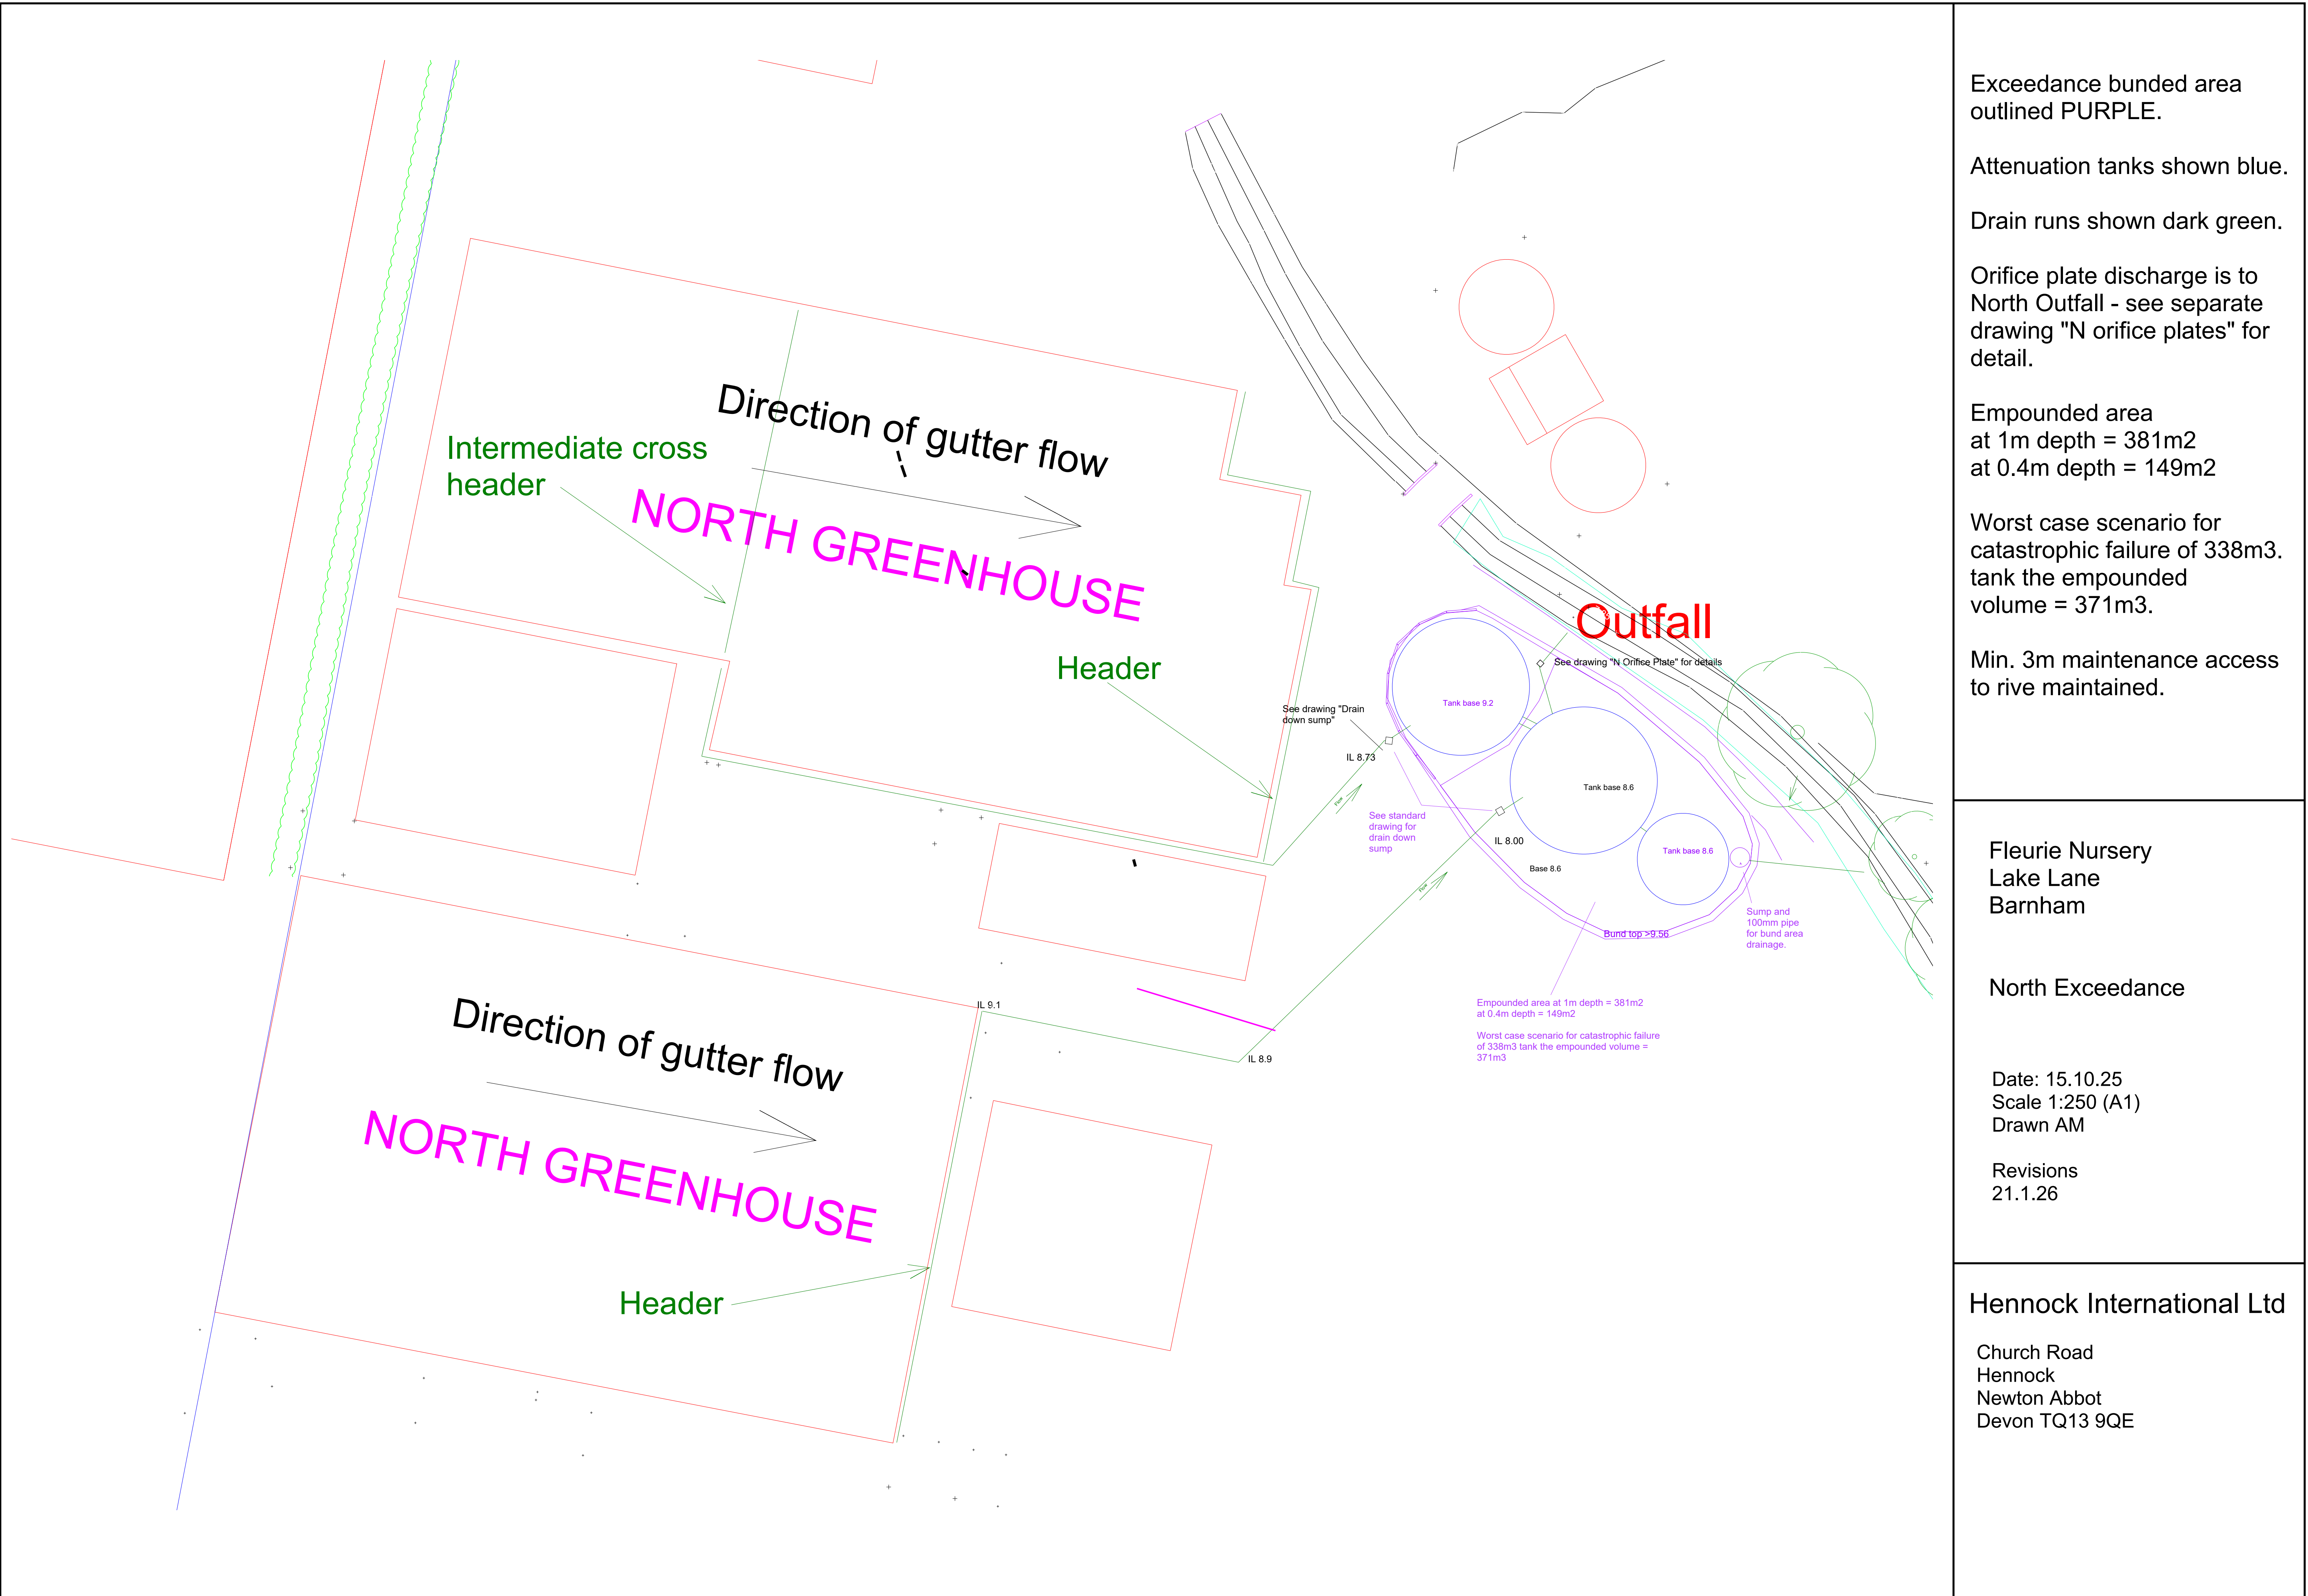

Exceedance bunded area outlined PURPLE.

Attenuation tanks shown blue.

Drain runs shown dark green.

Orifice plate discharge is to North Outfall - see separate drawing "N orifice plates" for detail.

Empounded area at 1m depth = 381m2
at 0.4m depth = 149m2

Worst case scenario for catastrophic failure of 338m3. tank the empounded volume = 371m3.

Min. 3m maintenance access to river maintained.

Fleurie Nursery
Lake Lane
Barnham

North Exceedance

Date: 15.10.25
Scale 1:250 (A1)
Drawn AM

Revisions
21.1.26

Hennock International Ltd

Church Road
Hennock
Newton Abbot
Devon TQ13 9QE