



Arun District Council
Maltravers Road
Littlehampton
BN17 5LF

Your ref
WA/68/26/PL

Our ref
DSA000056416

Date
7th August 2026

Contact
[REDACTED]

Dear Sir/Madam,

Proposal: Construction of a self-build/custom build single dwelling, with garage outbuilding and associated works. This is a departure from the local development plan and
Site address: The Greenway West Walberton Lane Walberton BN18 0QS

Thank you for your correspondence, please see our comments below regarding the above application

Tree Planting:

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition:

'In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.

Connection to public sewer - capacity available desktop study under 50:

Southern Water has undertaken a desktop study of the area, and our investigations indicate that Southern Water can facilitate foul sewerage disposal to service the proposed development. Southern Water requires a formal application for a connection to the public sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to, and approved in writing by the Local Planning Authority in consultation with Southern Water.

S106 Connection application:

Any new connections to the public sewerage system will require a Section 106 connection application to be submitted and approved by Southern Water Services.

To make an application visit Southern Water's Get Connected service:

<https://developerservices.southernwater.co.uk> and please read our New Connections Charging Arrangements documents which are available on our website via the following link:

<https://www.southernwater.co.uk/developing-building/connection-charging-arrangements>

Please note that, where there are separate systems available Southern Water will not allow surface water to connect into the public foul sewer. If this is not possible, please provide evidence that all other options have been explored.

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to and approved in writing by the Local Planning Authority in consultation with Southern Water.

Proposed soakaways:

The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development. No new soakaways should be located within 5 metres of a public or adoptable gravity sewer, rising main or water main.


No Soakaways should be connected to the public surface water sewer.

Hierarchy of Building Regulations H3 for disposal of surface water - not yet provided documentation proving compliance:

If the applicant has not already provided documentation demonstrating compliance with the surface water hierarchy reflected in part H3 of the Building Regulations, as shown below, we will require this to be provided where surface water is being considered for discharge to our network. Whilst reuse does not strictly form part of this hierarchy, Southern Water would encourage the consideration of reuse for new developments.

- Reuse
- Infiltration
- Watercourse
- Storm Sewer
- Combined Sewer

Guidance on Building Regulations is here: <https://www.gov.uk/government/publications/drainage-and-waste-disposal-approved-document-h>

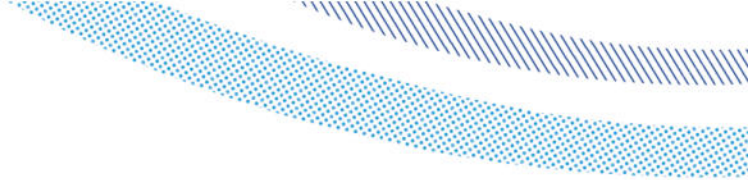

We would like to engage with you on the design for disposal of surface water for this development at the earliest opportunity and we recommend that civil engineers and landscape architects work together and with Southern Water. In many cases this may negate or reduce the need for network reinforcement and allow earlier completion of the development.

Where a surface water connection to the foul or combined sewer is being considered. Southern Water will refuse any request to discharge surface water into our 'foul only' sewer network. This includes where the surface water hierarchy has been followed and all alternative options have been exhausted. This approach ensures that we work together to better protect the environment, improve water quality, and reduce flood risk. It also supports our work to separate rainwater from sewage at source to meet storm overflow reduction targets under Defra's Storm Overflows Discharge Reduction Plan, as well as to reduce the number of sewer flooding incidents that are caused by hydraulic overload of our sewer network during periods of sustained rainfall.

Applications for surface water connections into a combined sewer will only be permitted if;

a) there are no alternative options under the surface water disposal hierarchy.

b) there is capacity*.

The above is supported by our Surface Water Management Policy, which is available to view on our website. It is also supported by the National standards for sustainable drainage systems (SuDS) - GOV.UK which states the following in Paragraph 1.10 - Surface water runoff from the development shall not discharge to a foul drainage system'

Condition:

We request that should this application receive planning approval, the following condition is attached to the consent: Construction of the development shall not commence until details of the proposed means of surface water run off disposal in accordance with Part H3 of Building Regulations hierarchy as well as acceptable discharge points, rates and volumes have been agreed by the Lead Local Flood Authority, in consultation with Southern Water.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site. If this happens, please call our Customer Service Desk on [REDACTED]


For further assistance, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX ([REDACTED])

Website: southernwater.co.uk or by email at: [REDACTED]

Yours faithfully,

Future Growth Planning Team
Developer Services

[Southernwater.co.uk/developing-building/planning-your-development](https://southernwater.co.uk/developing-building/planning-your-development)

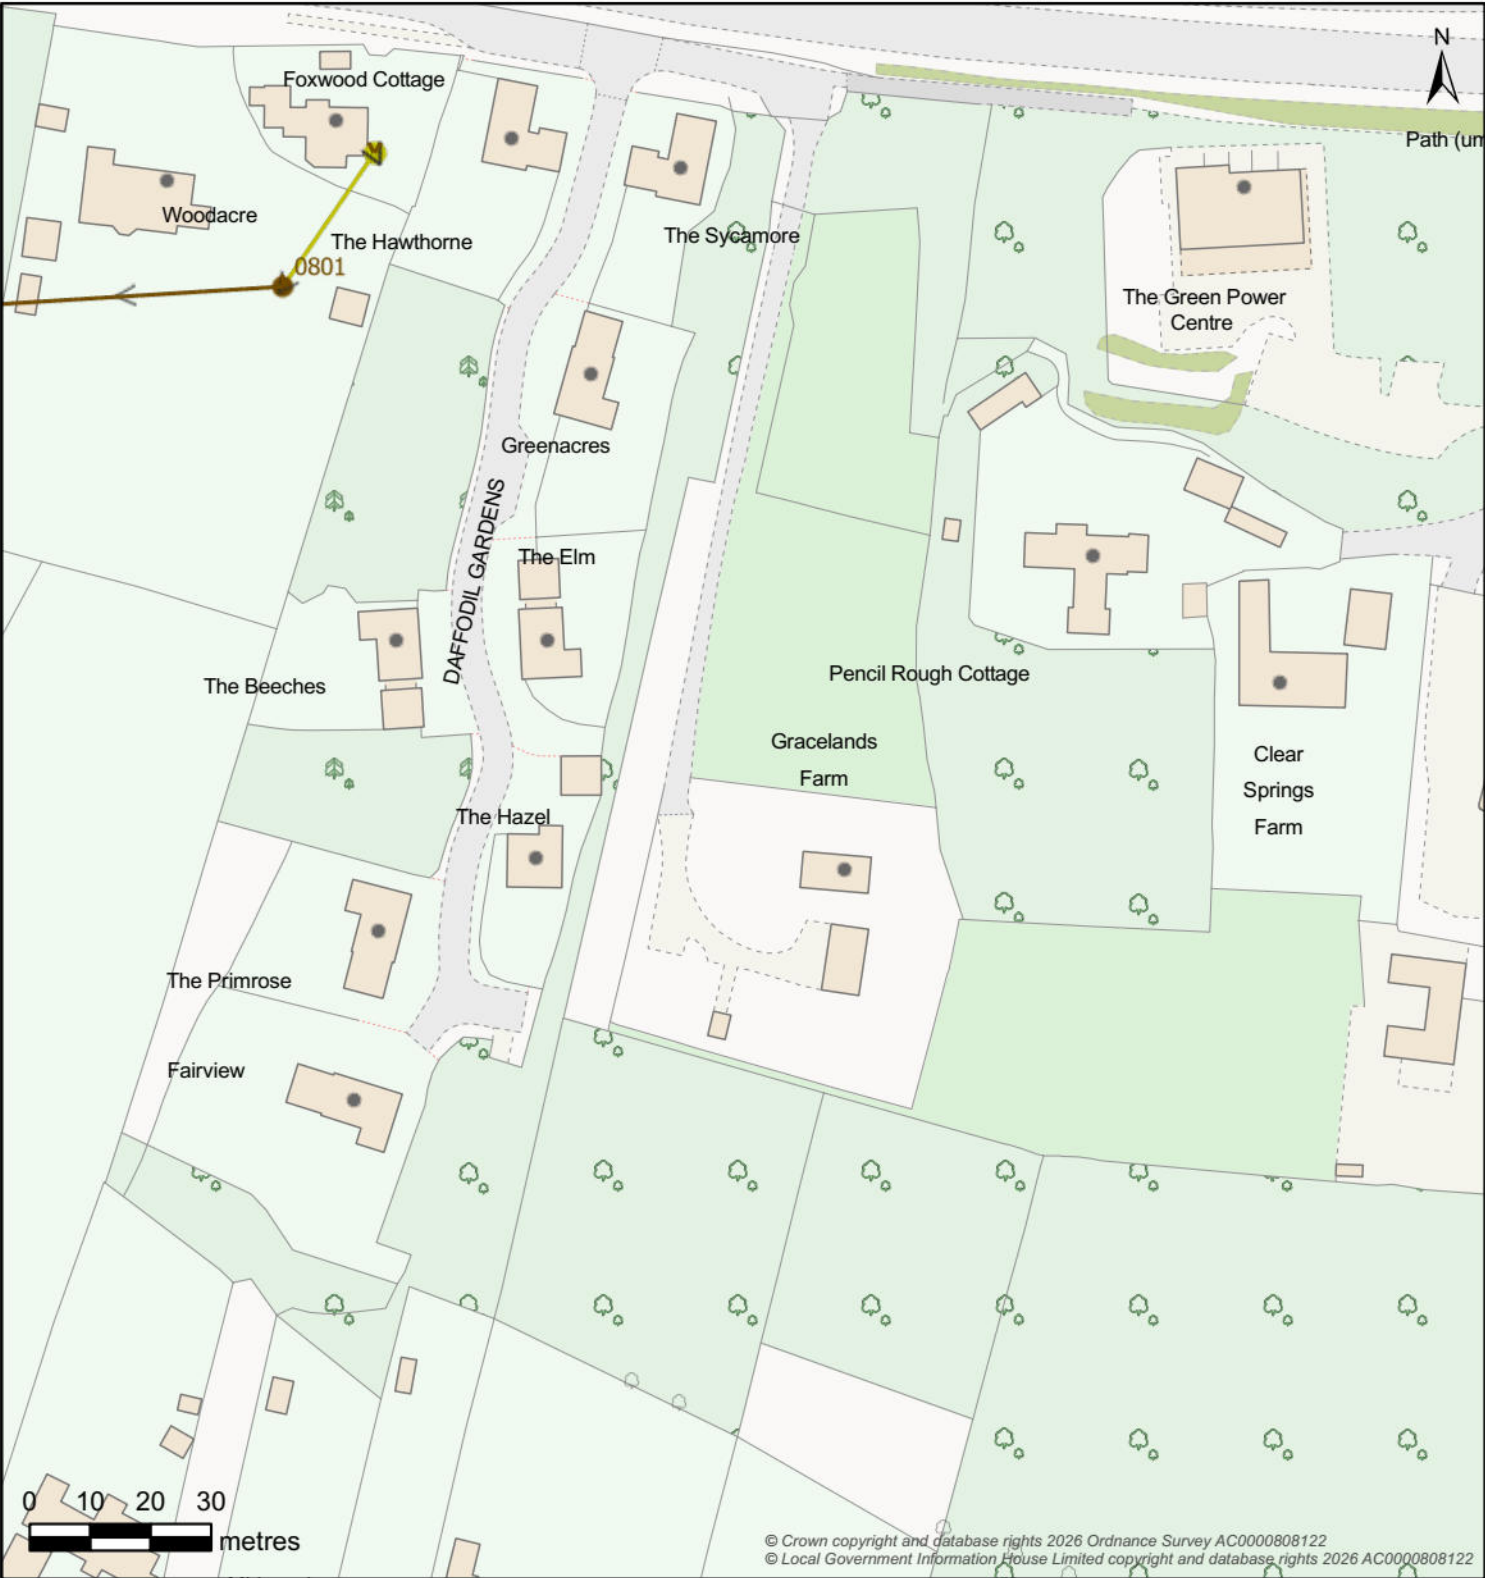

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe		Sludge	Treated Effluent	Catchment	Sub-Catchment
Outfall				Surface Water			
Overflow				Private			
Rising Main							
Sewer							

Map Title: SW Print

Printed By: Isaac.Vowles
Date Printed: 07/08/2026
Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

[REDACTED]

Arun District Council, Civic Centre, Maltravers Rd
Littlehampton, West Sussex, BN17 5LF
www.arun.gov.uk

To register to receive notification of planning applications in your area please go to
<https://www1.arun.gov.uk/planning-application-finder>

Our priorities...

 Improving the wellbeing of Arun	 Delivering the right homes in the right places	 Supporting our environment to support us	 Fulfilling Arun's economic potential	 Our core foundations	 
--	---	---	---	--	--

Connect with us: [Facebook](#) | [X](#) | [Instagram](#)

From: SouthernWater PlanningConsultations

Sent: 07 August 2026 10:14

To: Planning.Responses <Planning.Responses@arun.gov.uk>

Subject: DSA000056416; WA/68/26/PL - The Greenway West Walberton Lane Walberton BN18 0QS

CAUTION: This email originated from outside of the organisation. You should take extra care when clicking links or opening attachments - if you are unsure the content is safe contact the IT Helpdesk before clicking or opening.

Good afternoon,

Please see the attached GIS snippet and our response letter

Yours sincerely

Isaac Vowles

Developer Services

[REDACTED]

southernwater.co.uk



from
Southern Water

This e-mail is intended solely for the person or organisation to which it is addressed. It may contain privileged and confidential information. If you are not the intended recipient, you are prohibited from copying, disclosing or distributing this e-mail or its contents (as it may be unlawful for you to do so) or taking any action in reliance on it.

If you receive this e-mail by mistake, please delete it then advise the sender immediately.

Without prejudice to the above prohibition on unauthorised copying and disclosure of this e-mail or its contents, it is your responsibility to ensure that any onward transmission, opening or use of this message and any attachments will not adversely affect your or the onward recipients' systems or data. Please carry out such virus and other such checks as you consider appropriate.

An e-mail reply to this address may be subject to monitoring for operational reasons or lawful business practices

This e-mail is issued by Southern Water Services Limited, company number 2366670, registered in England and having its registered office at Southern House, Yeoman Road, Worthing, BN13 3NX, England.

In sending this e-mail the sender cannot be deemed to have specified authority and the contents of the e-mail will have no contractual effect unless (in either case) it is otherwise agreed between Southern Water Services Limited and the recipient.