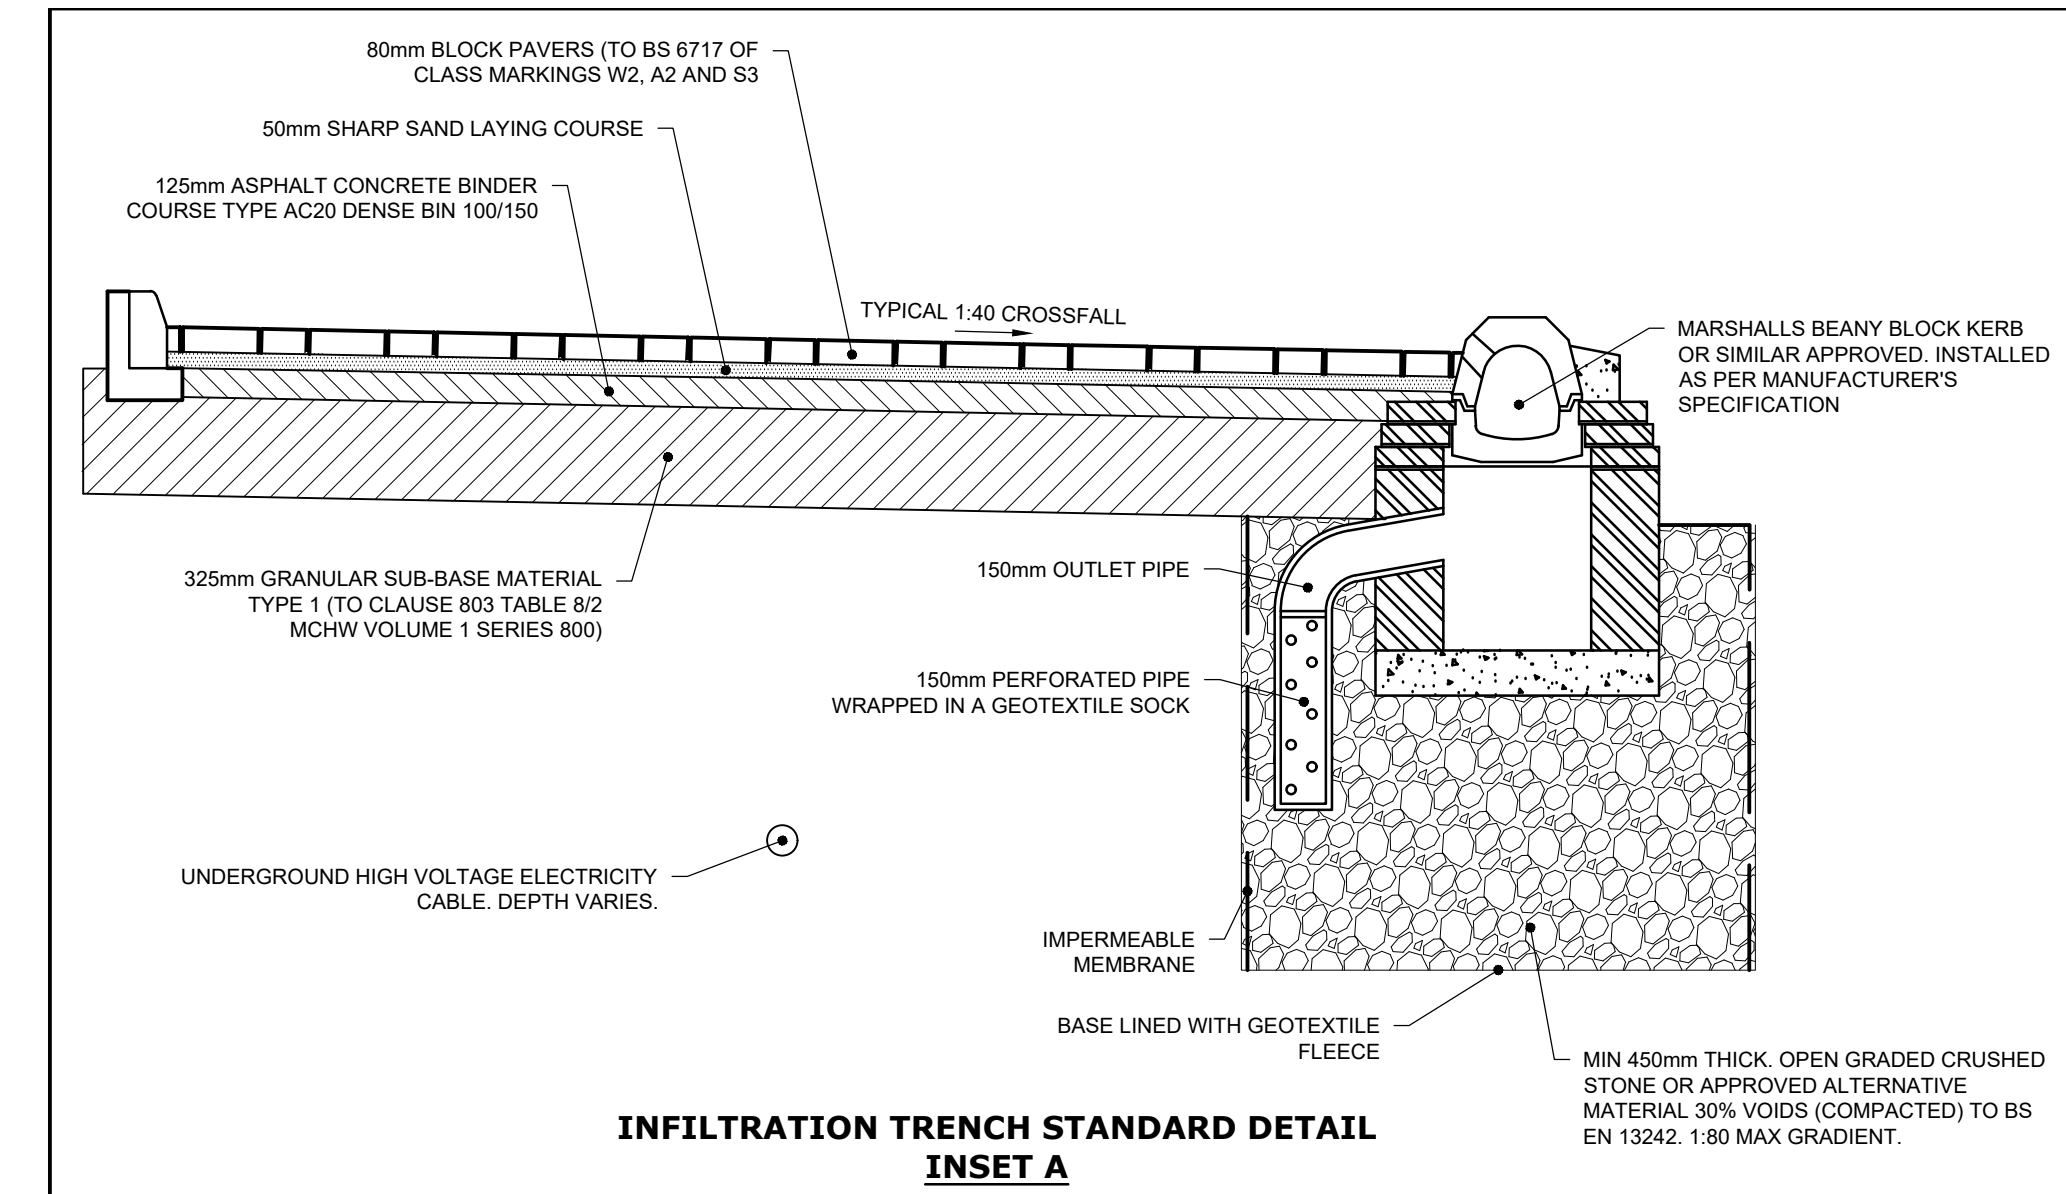


NOTE: LOCAL KNOWLEDGE INFORMS PREMISES WITHIN THE SITE BOUNDARY ARE SUPPLIED WITH HEATING OIL AND NOT MAINS GAS.

NOTE: RECORD INFORMATION INDICATES 3x33KV AND 1X FIBRE OPTIC CABLE IN THIS DUCT.

NOTE: TRIAL EXCAVATIONS INDICATE 11KV HIGH VOLTAGE ELECTRICITY CABLE DUCT POSITION DIFFERS FROM RECORD INFORMATION.

NOTE: LOCAL KNOWLEDGE INFORMS OF 3 WATER MAINS WITHIN MAYPOLE LANE, UNABLE TO LOCATE, ASSUMED DUE TO SMALL DIAMETER AND MATERIAL OF SERVICE.

NOTE: TRIAL EXCAVATIONS INDICATE FIBRE OPTIC CABLE DUCT POSITION DIFFERS FROM RECORD INFORMATION.

NOTE: TRIAL EXCAVATION 1 BL 5.44 HV CWL 5.50 QA 1500 PVC DATA CWL 5.50 QA 1000 PVC

NOTE: RECORD INFORMATION INDICATES 3x33KV AND 1X FIBRE OPTIC CABLE IN THIS DUCT.

NOTE: SWEEPS UNDERTAKEN USING GPR AND VARIOUS PASSIVE FREQUENCIES WITH EML. NO FURTHER LIVE THROUGH UTILITIES DETECTED.

NOTE: SWEEPS UNDERTAKEN USING GPR AND VARIOUS PASSIVE FREQUENCIES WITH EML. NO FURTHER LIVE THROUGH UTILITIES DETECTED.

NOTE: SWEEPS UNDERTAKEN USING GPR AND VARIOUS PASSIVE FREQUENCIES WITH EML. NO FURTHER LIVE THROUGH UTILITIES DETECTED.

- NOTES
1. DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
 2. ALL DIMENSIONS SHOWN ON THIS DRAWING ARE IN METRES.
 3. DRAINAGE PROPOSALS ARE INDICATIVE AND SUBJECT TO DETAILED DESIGN.
 4. TOPOGRAPHICAL SURVEY AND EXISTING UTILITIES DATA HAS BEEN PROVIDED BY MKSURVEYS, DRAWING NO 26436 R4, DATED JUNE 2019.
 5. PROPOSED SITE LAYOUT IS PROVIDED BY REDROW, DRAWING NO SK3_1_2207_9691 DATED OCT 2018.
 6. SUDS DESIGN IS BASED ON THE PRELIMINARY FALLING HEAD INFILTRATION TESTS THAT WERE UNDERTAKEN BY LEAP ENVIRONMENTAL IN MARCH 2019.

LEGEND

- SITE BOUNDARY
- PROPOSED SURFACE WATER DRAINAGE
- GRANULAR INFILTRATION TRENCH
- CELLULAR INFILTRATION TANK
- GULLY AND CONNECTION
- TREES TO BE REMOVED
- 3.5m WORKS/RE-GRADE ZONE

FOR INFORMATION ONLY - NOT FOR CONSTRUCTION

D INFILTRATION TANK ADDED AND TRENCH REDUCED	SG	LH	RS	27.09.19
C PROPOSED EMBANKMENT AND REGRADE ZONE ADJUSTED.	SG	LH	RS	13.09.19
B ADDITIONAL REGRADE ZONE ADDED	LP	RS	RS	14.06.19
A INFILTRATION TRENCH RELOCATED. REGRADE ZONE ADDED	LP	RS	RS	22.05.19

Rev	Amendments	Dm	Chk	App	Date
-----	------------	----	-----	-----	------

**ODYSSEY**

Tuscany House
White Hart Lane
Basingstoke
Hampshire RG21 4AF

Telephone: 01256 331144
Fax: 01256 331134
E: info@odysseyconsult.co.uk
W: www.odysseyconsult.co.uk

Job Title
NORTH END ROAD, YAPTON

Drawing Title
ACCESS ROAD STRATEGY

Client
REDROW HOMES

Scale 1:200 @A1	Date MAY 19	Designed LP
Drawn LP	Checked RS	Approved RS
Job No 18-343	Drawing No 18-343/003	Rev D