

Secondary cavity tray Type G900 by CAVITY TRAYS LTD (shown dotted) with upstand linked to internal blockwork as per NHBC 6.1.17. Cavity trays must rise minimum 150mm across cavity.

Cavity tray Type G900 with attached lead flashing by CAVITY TRAYS LTD (shown dotted) with upstand linked to internal blockwork as per NHBC 6.1.17. Cavity trays must rise minimum 150mm across cavity.

Full height louvred weep vent to be provided spaced at maximum 450mm c/s. (colour to suit brickwork).

Mastic seal to top, side and soffit of GRP canopy upstand to eliminate capillary action.

Attached lead flashing shown shaded.


Lintels (shown dotted) must bear on full (NOT CUT) blocks and must be firmly bedded in mortar.

Special cavity tray PAH/9114 (shown dotted) by CAVITY TRAYS LTD to overlap Type C cavity tray over lintel and extend beyond lintel to nearest perp joint. Upstand linked to internal blockwork as per NHBC 6.1 D6 (b).

Cavity tray stop end (Type L90) must be installed as per approved manufacturers instructions.

Cavity tray Type C by CAVITY TRAYS LTD to be installed over lintel and extend min 300mm past structural bay opening. Please state when ordering if IG (Barratt) or Catnic (DWH) lintel is being used to ensure correct profile delivered to site.

Full height louvred weep vent seen lintel stop end and end of al tray. (Colour to suit work)

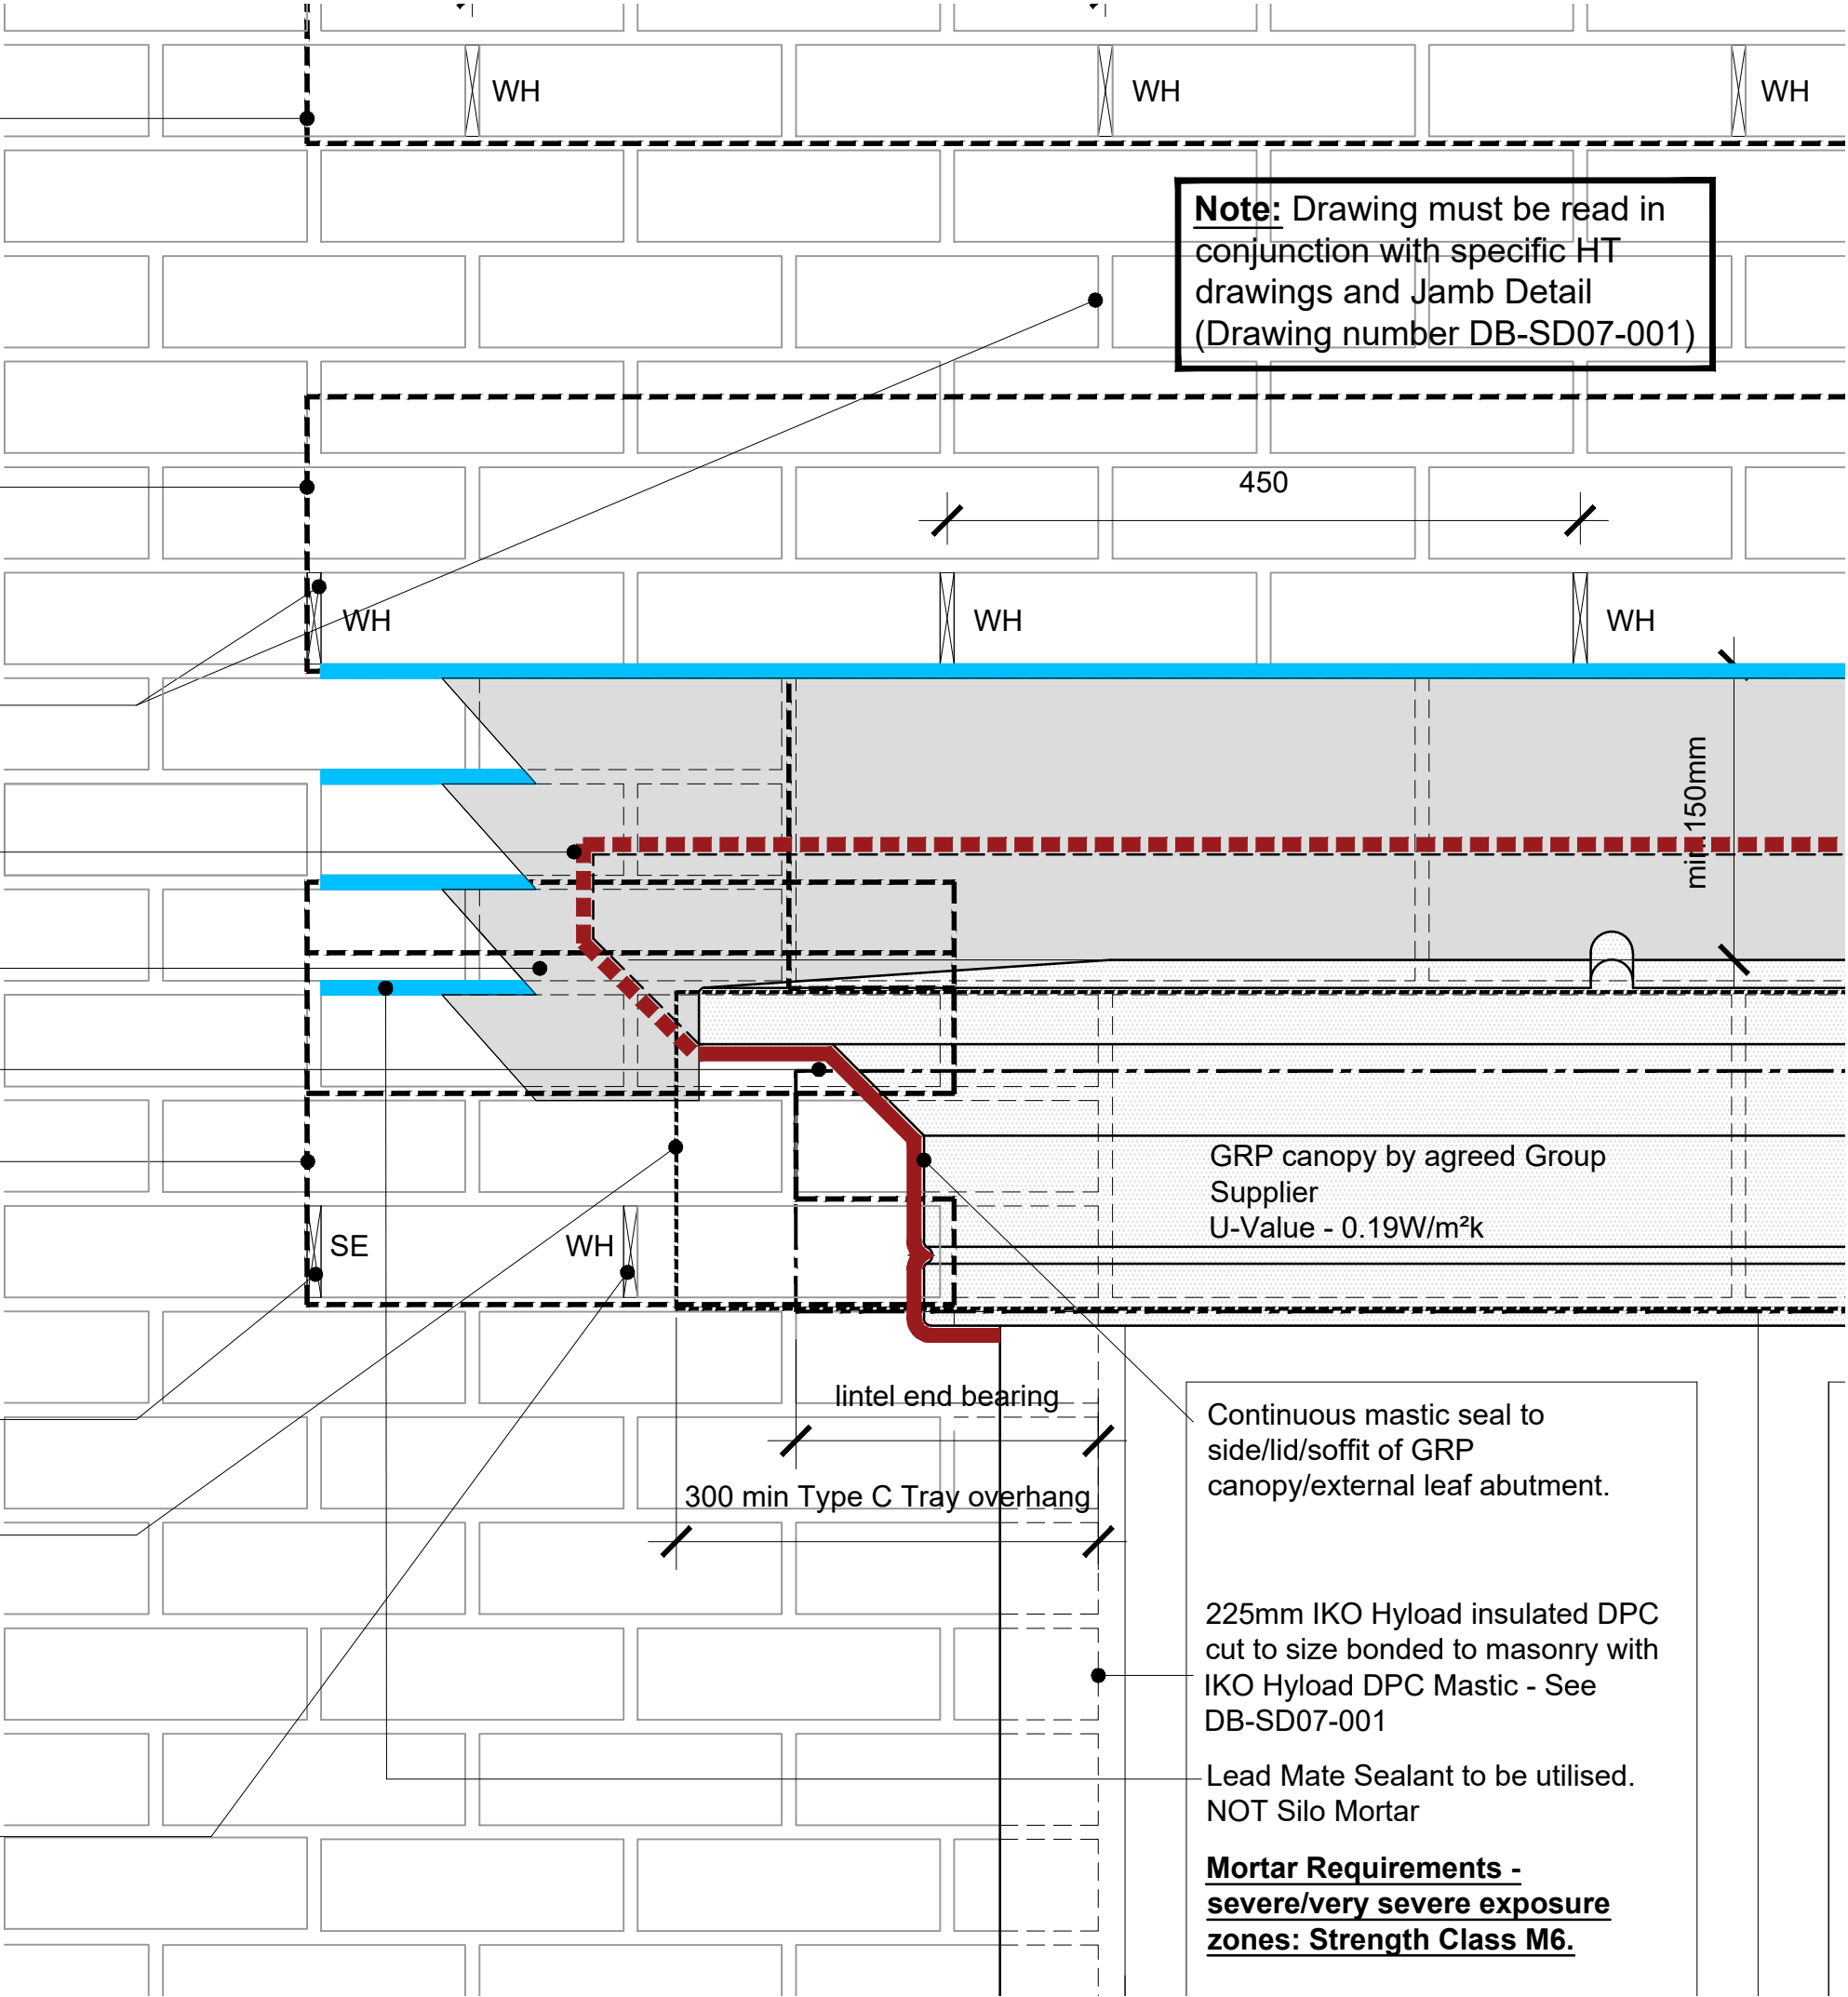

FOR SEVERE / VERY SEVERE EXPOSURE SITES - BRICK OUTER LEAF

EXTERNAL REFERENCE :



Date: Jan 21

Description: Secondary cavity tray moved up by 150mm

Rev: A

Brand: BARRATT / DAVID WILSON HOMES

Range: 2010 / 2016 & -5 / -7

Title: TYPICAL BAY HEAD DETAIL - ELEVATION

Detail No: DB-SD07-009 SHT 1 of 2

Drawn: GDT Checked: GDT Scale: 1:5 Date: Feb 20