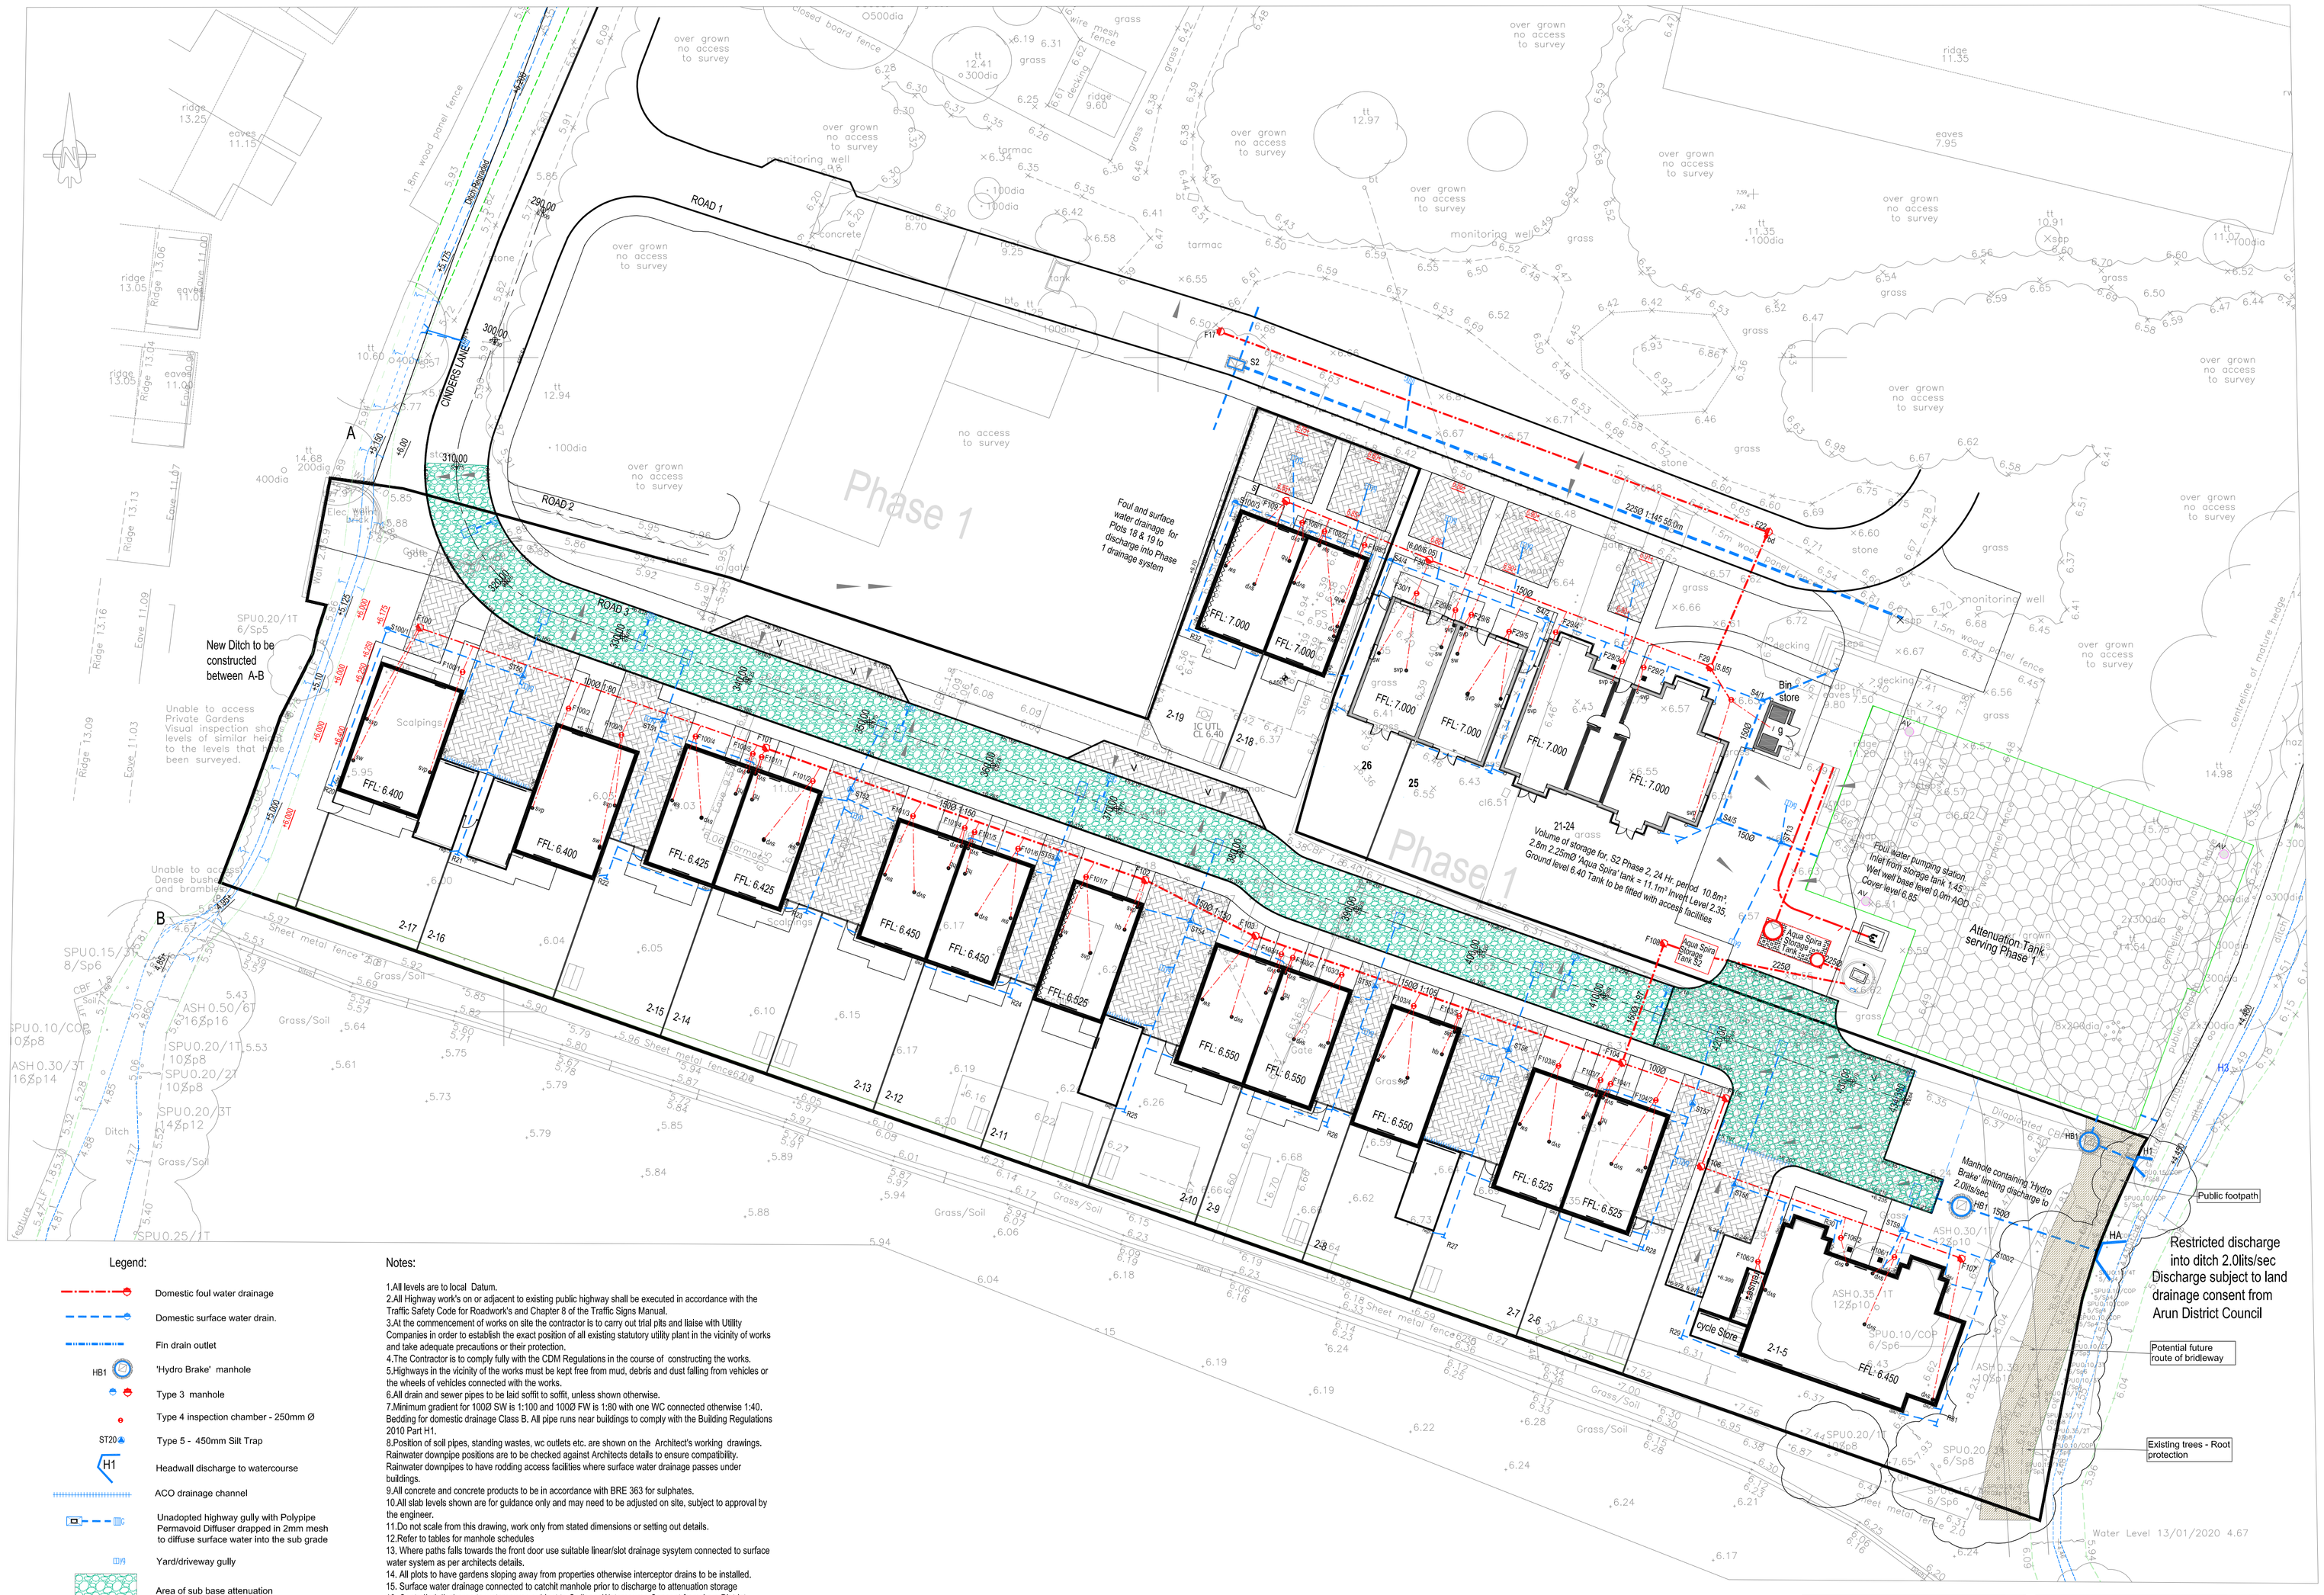

Legend:

- Domestic foul water drainage
- Domestic surface water drain.
- Fin drain outlet
- HB1 'Hydro Brake' manhole
- Type 3 manhole
- Type 4 inspection chamber - 250mm Ø
- ST20 Type 5 - 450mm Silt Trap
- H1 Headwall discharge to watercourse
- ACO drainage channel
- Unadopted highway gully with Polyplpe Permavoid Diffuser drapped in 2mm mesh to diffuse surface water into the sub grade
- Yard/driveway gully
- Area of sub base attenuation
- +8.385 Proposed road levels
- +8.385 Proposed levels
- +8.40 Existing surveyed levels
- FFL 6.90 Proposed Finished Floor Level
- Carriageway crossfall
- Underbuild
- S Step 150mm
- Site Boundary

Notes:

1.All levels are to local Datum.
2.All Highway work's on or adjacent to existing public highway shall be executed in accordance with the Traffic Safety Code for Roadwork's and Chapter 8 of the Traffic Signs Manual.
3.At the commencement of works on site the contractor Is to carry out trial pits and liaise with Utility Companies in order to establish the exact position of all existing statutory utility plant in the vicinity of works and take adequate precautions or their protection.
4.The Contractor is to comply fully with the CDM Regulations in the course of constructing the works.
5.Highways in the vicinity of the works must be kept free from mud, debris and dust falling from vehicles or the wheels of vehicles connected with the works.
6.All drain and sewer pipes to be laid soffit to soffit, unless shown otherwise.
7.Minimum gradient for 100Ø SW is 1:100 and 100Ø FW is 1:80 with one WC connected otherwise 1:40. Bedding for domestic drainage Class B. All pipe runs near buildings to comply with the Building Regulations 2010 Part H1.
8.Position of soil pipes, standing wastes, wc outlets etc. are shown on the Architect's working drawings. Rainwater downpipe positions are to be checked against Architects details to ensure compatibility. Rainwater downpipes to have rodding access facilities where surface water drainage passes under buildings.
9.All concrete and concrete products to be in accordance with BRE 363 for sulphates.
10.All slab levels shown are for guidance only and may need to be adjusted on site, subject to approval by the engineer.
11.Do not scale from this drawing, work only from stated dimensions or setting out details.
12.Refer to tables for manhole schedules
13. Where paths falls towards the front door use suitable linear/slot drainage sysytem connected to surface water system as per architects details.
14. All plots to have gardens sloping away from properties otherwise interceptor drains to be installed.
15. Surface water drainage connected to catchit manhole prior to discharge to attenuation storage
16. Controlled discharge to watercourse subject to Ordinary Watercourse Consent from Arun District Council.
17. This drawing is to be read in conjunction with all relevent engineering drawings issued by Kazys Narbutas Consulting and Crayfern Homes for this site only.

SAFETY, HEALTH & ENVIRONMENTAL INFORMATION CDM Regulations 2015

In addition to the hazards/risks normally associated with the type of work detailed on this drawing note should be made of the following:

- Working in vicinity of live highway
- Services to be located prior to any excavation work being undertaken
- Deep excavations
- Working on live foul sewers

It is assumed that all works will be carried out by a competent contractor working, where appropriate, to an approved method statement. Contractor is not relieved of any of his obligations under all applicable health and safety regulations.

SURFACE WATER DRAINAGE MANHOLE SCHEDULE

REFERENCE	Cover Level (m)	Invert Level (m)	Depth to Soffit (m)	Size (mm)	Type	Cover Grade
HB1	6.40	4.800	1.450	1500 diameter	Hydro Brake	D400
HA	6.30	4.70	1.45	150 diameter	Headwall Type H1	
S100/1	6.20	5.770	0.430	450 diameter	3	B125
S100/2	6.30	5.720	0.480	450 diameter	3	B125
S100/3	6.70	6.130	0.470	450 diameter	3	B125
R20	6.65	6.10	0.45		RE	B125
R21	6.65	**6.10**	**0.45**		RE	**B125**
R22	6.65	6.10	0.45		RE	B125
R23	6.80	6.25	0.45		RE	B125
R24	6.80	6.25	0.45		RE	B125
R25	6.85	6.28	0.47		RE	B125
R26	6.90	6.25	0.55		RE	B125
R27	6.65	6.08	0.47		RE	B125
R28	6.65	6.09	0.46		RE	B125
R29	6.65	6.08	0.47		RE	B125
R30	6.65	6.10	0.45		RE	B125
R31	6.65	6.10	0.45		RE	B125
R32	6.70	6.24	0.34		RE	B125
ST50	6.65	6.10	0.45	450 diameter	5	B125
ST51	6.65	**6.10**	**0.45**	450 diameter	5	**B125**
ST52	6.65	6.10	0.45	450 diameter	5	B125
ST53	6.80	6.25	0.45	450 diameter	5	B125
ST54	6.80	6.25	0.45	450 diameter	5	B125
ST55	6.85	6.28	0.47	450 diameter	5	B125
ST56	6.90	6.25	0.55	450 diameter	5	B125
ST57	6.65	6.08	0.47	450 diameter	5	B125
ST58	6.65	6.09	0.46	450 diameter	5	B125
ST59	6.65	6.08	0.47	450 diameter	5	B125
ST10	6.65	6.10	0.45	450 diameter	5	B125
ST11	6.65	6.10	0.45	450 diameter	5	B125
ST12	6.90	5.20	1.60	450 diameter	5	B125
ST13	6.85	5.10	1.60	450 diameter	5	B125

FOUL DRAINAGE MANHOLE SCHEDULE

REFERENCE	Cover Level (m)	Invert Level (m)	Depth to Soffit (m)	Size (mm)	Type	Cover Grade
F100	6.25	5.550	0.600	450 diameter	3	B125
F101	6.27	5.200/5.150	0.970	450 diameter	3	B125
F102	6.375	4.945	1.280	450 diameter	3	B125
F103	6.45	4.882	1.418	450 diameter	3	B125
F104	6.40	4.600/4.650	1.650	450 diameter	3	B125
F105	6.32	5.250	0.970	450 diameter	3	B125
F106	6.30	5.330	0.870	450 diameter	3	B125
F107	6.30	5.600	0.600	450 diameter	3	B125
F108	6.40	4.500	0.500	450 diameter	3	B125
F109	6.85	6.250	0.500	450 diameter	3	B125
F100/1	6.25	5.650	0.500	250 diameter	4	B125
F100/2	6.25	5.650	0.500	250 diameter	4	B125
F100/3	6.25	5.650	0.500	250 diameter	4	B125
F100/4	6.275	5.675	0.500	250 diameter	4	B125
F100/5	6.275	5.675	0.500	250 diameter	4	B125
F101/1	6.275	5.675	0.500	250 diameter	4	B125
F101/2	6.275	5.675	0.500	250 diameter	4	B125
F101/3	6.30	5.700	0.500	250 diameter	4	B125
F101/4	6.30	5.700	0.500	250 diameter	4	B125
F101/5	6.30	5.700	0.500	250 diameter	4	B125
F101/6	6.30	5.700	0.500	250 diameter	4	B125
F101/7	6.375	5.775	0.500	250 diameter	4	B125
F103/1	6.40	5.800	0.500	250 diameter	4	B125
F103/2	6.40	5.800	0.500	250 diameter	4	B125
F103/3	6.40	5.800	0.500	250 diameter	4	B125
F103/4	6.40	5.800	0.500	250 diameter	4	B125
F103/5	6.40	5.800	0.500	250 diameter	4	B125
F103/6	6.375	5.775	0.500	250 diameter	4	B125
F103/7	6.375	5.775	0.500	250 diameter	4	B125
F104/1	6.375	5.775	0.500	250 diameter	4	B125
F104/2	6.375	5.775	**0.500**	250 diameter	4	B125
F106/1	6.30	5.600	0.500	250 diameter	4	B125
F106/2	6.30	5.600	0.500	250 diameter	4	B125
F106/3	6.30	5.600	0.500	250 diameter	4	B125
F108/1	6.85	6.250	0.500	250 diameter	4	B125
F108/2	6.85	6.250	0.500	250 diameter	4	B125
F108/3	6.85	6.250	0.500	250 diameter	4	B125

Rev.	Date	Details	Initials
C	14.10.20	Detailed design	KN
B	23.02.20	Adjusted for revised layout	KN
A	28.01.20	First issue	KN

Drawing Status
PRELIMINARY-FOR TENDER

Project
CINDERS NURSERY: Phase 2
YAPTON

Client
Crayfern HOMES

KAZYS NARBUTAS CONSULTING
Civil Engineering Consultant
Unit 3B, Tannery Court, Tannery Lane, East Wellow, Romsey, Hants. SO51 6DP
Telephone: 01794 322903 Email: kazys.n@knc.email

Drawing Title
Engineering Details
Drainage Layout

Drawn	Checked	Scales	Paper Size	Date
KN		1:250	A1	01.20
Job No.		Drawing No.		Revision
KNC2006		502-01		C

This drawing is the copyright of Kazys Narbutas Consulting and may not be copied, altered or reproduced in any form or passed to a third party without the consent of Kazys Narbutas Consulting. Do not scale from this drawing, use figured dimensions only.
Dimensions should be checked and verified on site and any discrepancies should be reported to Kazys Narbutas Consulting as soon as possible.

ARUN DISTRICT COUNCIL TO ADOPTION