


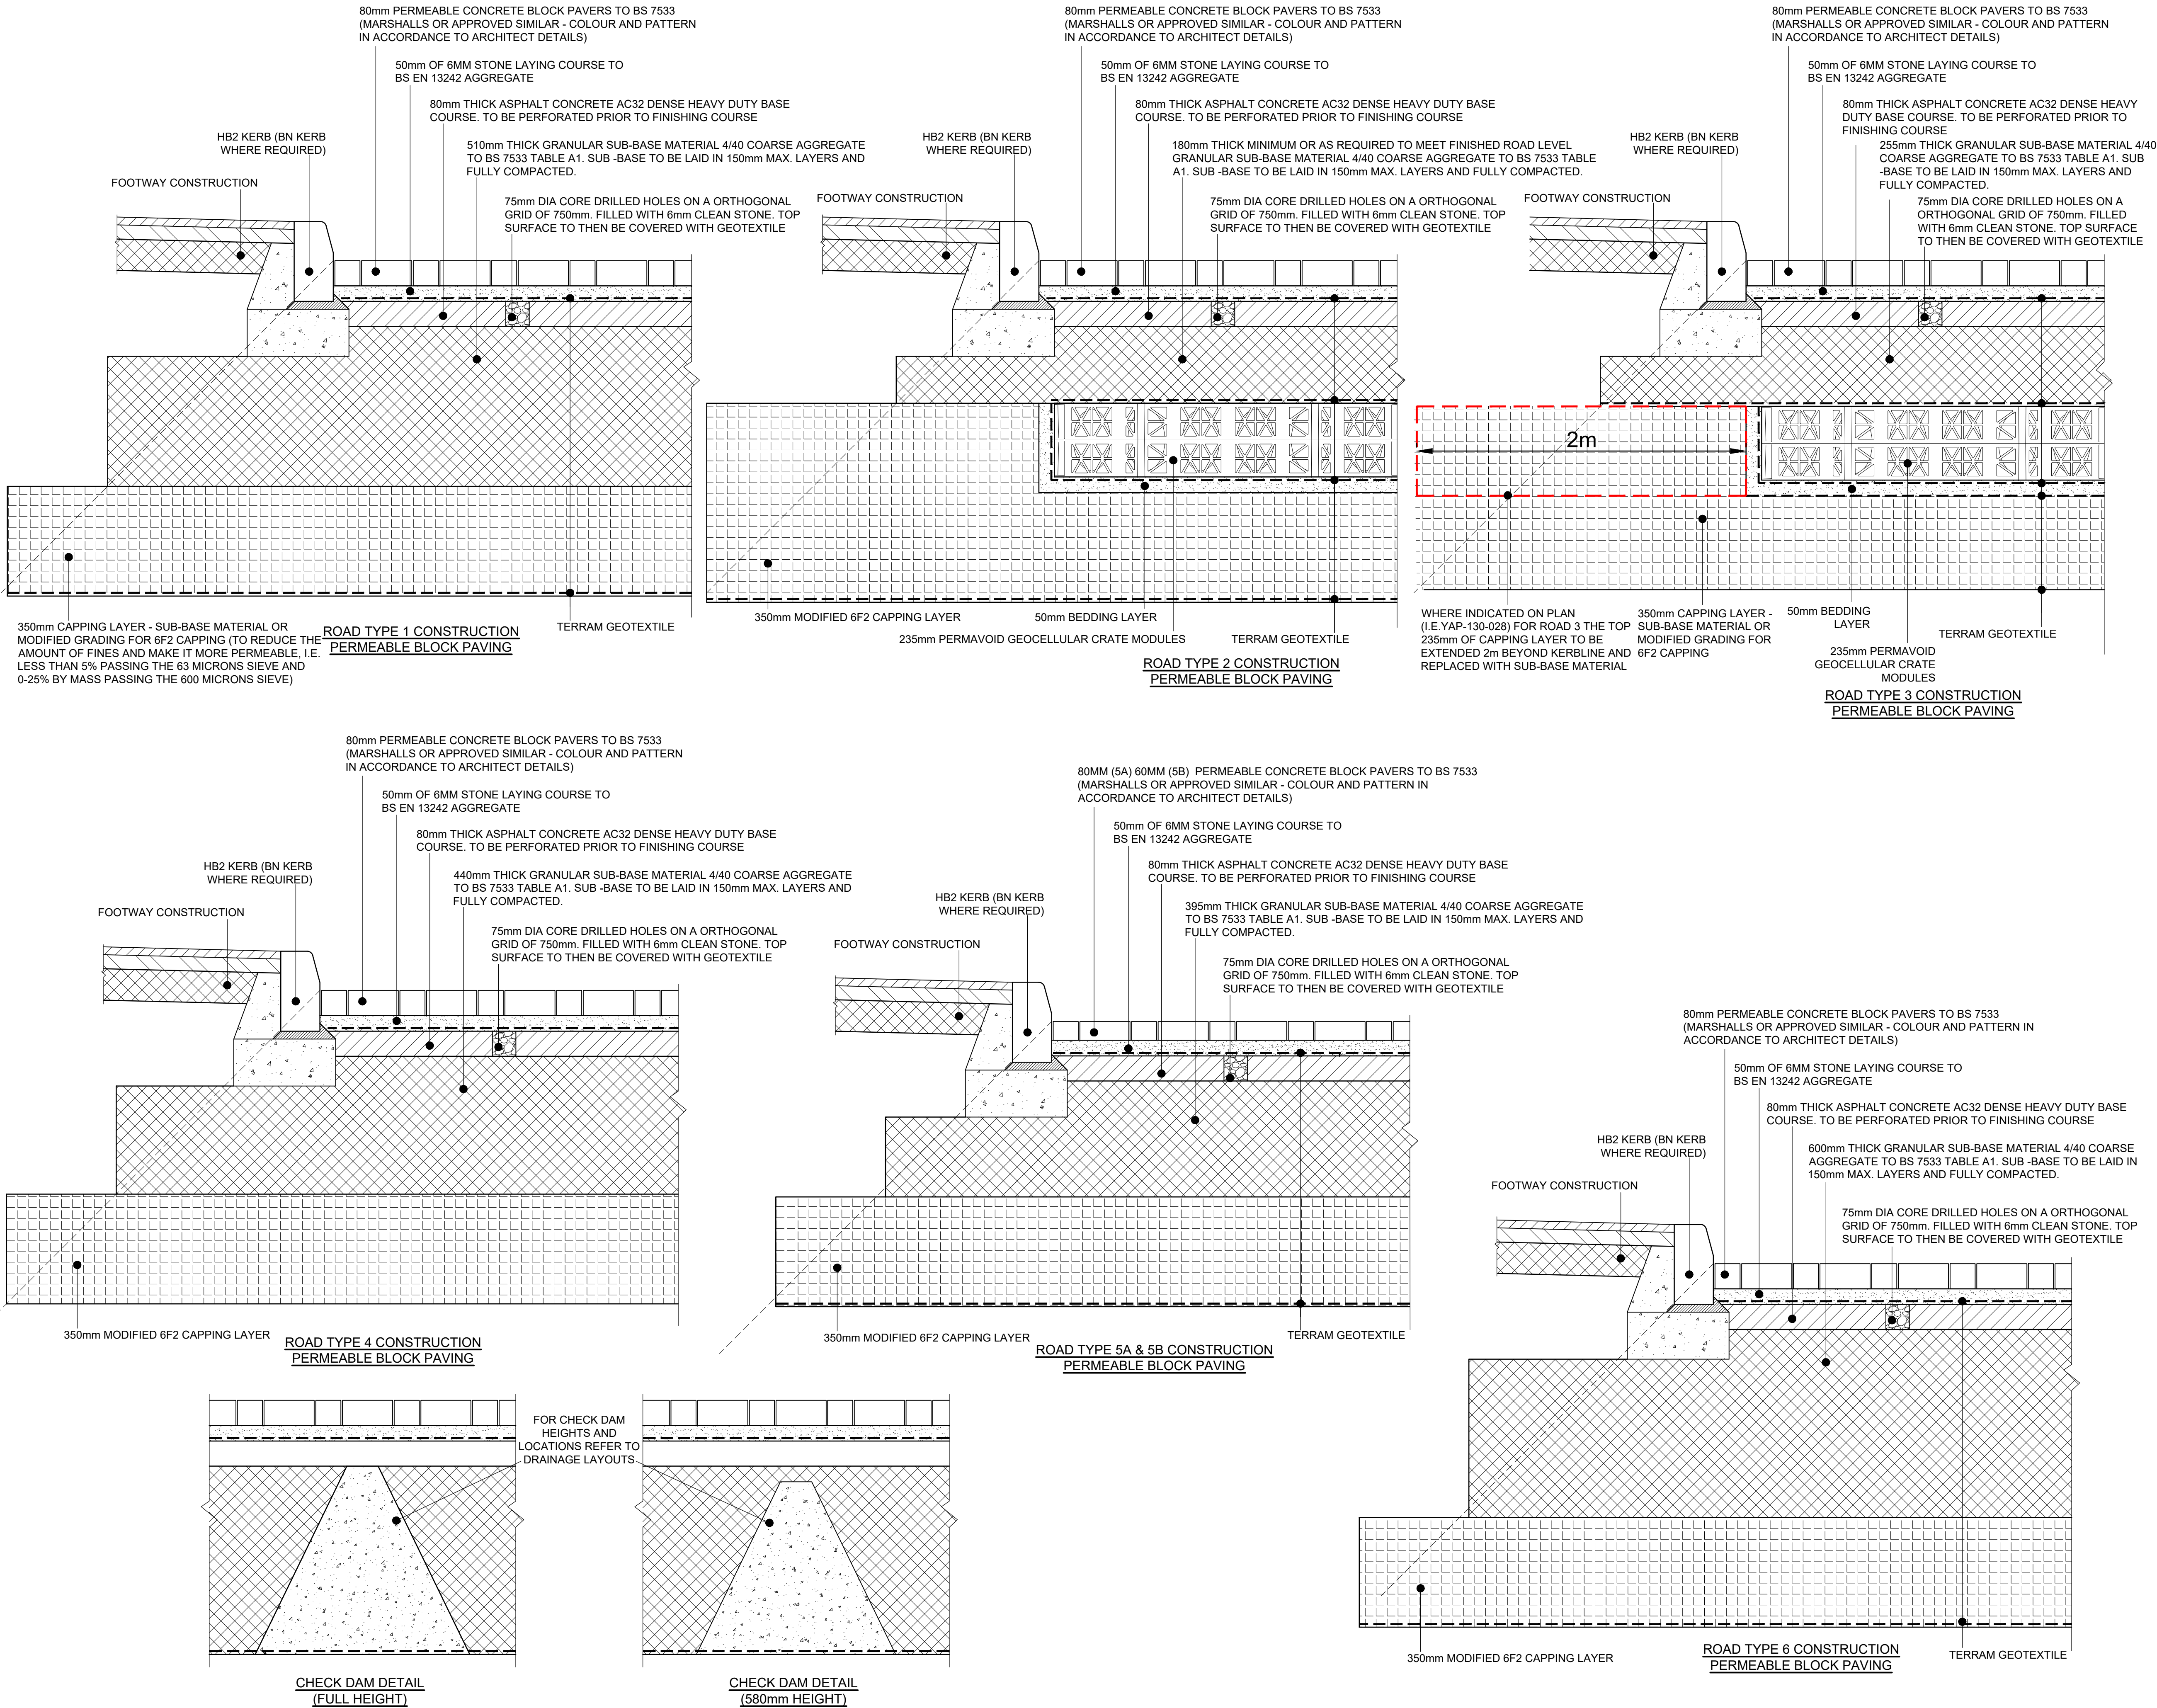

- NOTES**
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELATED DRAWINGS.
 - DO NOT SCALE FROM THIS DRAWING. WORK FROM FIGURED DIMENSIONS ONLY.
 - NO DEVIATION FROM THE DETAILS SHOWN ON THIS DRAWING IS PERMITTED WITHOUT PERMISSION FROM THE ENGINEER.
 - IN COMPLIANCE WITH CDM 2015 ODYSSEY HAS FOLLOWED ITS DESIGN RISK MANAGEMENT PROCESS FOR HAZARD ELIMINATION AND RISK REDUCTION IN DEVELOPING THE ODYSSEY DESIGNS SHOWN ON THIS DRAWING. THERE ARE NO ABNORMAL OR UNUSUAL RESIDUAL RISKS ASSOCIATED WITH THE DESIGN. ANY OTHER RESIDUAL RISKS ARE THOSE THAT WOULD NORMALLY BE EXPECTED BY COMPETENT PERSONS OR CONTRACTORS ENGAGED ON WORK OF THIS NATURE OR TYPE.
 - WORKS TO BE CARRIED OUT IN ACCORDANCE WITH SPECIFICATION FOR HIGHWAY WORKS (SHW) LATEST EDITION AND CURRENT BRITISH STANDARDS.
 - ALL ASPHALT / BITUMINOUS MATERIAL SHALL BE TRANSPORTED LAID COMPACTED AND TESTED TO BS EN 594987
 - ALL ASPHALT AND SURFACING MATERIAL TO BE LAID BY AN EXPERIENCED SURFACING CONTRACTOR.
 - KERB UP STANDS AT PEDESTRIAN, TACTILE AND VEHICULAR CROSSINGS ARE TO BE IN ACCORDANCE WITH THE CONSTRUCTION MAKEUP LAYOUT DRAWINGS.
 - SURFACE COURSE SHALL NOT BE TRAFFICKED FOR 24 HOURS.
 - WITH SUB-BASE MATERIAL PARTICULAR ATTENTION SHALL BE PAID TO PLACING AND COMPACTING TO ACHIEVE MAXIMUM DENSITY.
 - IF APPROVED GRADED HARDCORE SHALL BE BLINDED WITH TYPE 1 OR TYPE 2 MATERIAL PRIOR TO LAYING BINDER COURSE IN ORDER TO PROVIDE A WELL COMPACTED, CLOSED EVEN SURFACE TO THE REQUIRED LEVELS AND FALL.
 - THE HIGHWAY CONSTRUCTION MAKEUP SHOWN ON THIS DRAWING IS BASED UPON A DESIGN 'CBR' VALUE OF 2% AS PER WYG GROUND INVESTIGATION REPORT A112666 (DATED 28 MAY 2019).
 - THE CONTRACTOR SHALL CONFIRM AT HIS OWN EXPENSE THE 'CBR' VALUE ALONG THE CARRIAGEWAY ROUTE AT 30m CENTRES. SHOULD THE SUB-GRADE HAVE A CBR VALUE OF LESS THAN 2% ENGINEER MUST BE INFORMED IMMEDIATELY AND DESIGN WILL BE REVIEWED.
 - ANY SOFT SPOTS ARE TO BE REMOVED AND REPLACED WITH CLASS 6F2 OR MATERIAL APPROVED AND TO THE SATISFACTION OF THE ENGINEER.
 - IF SUB GRADE IS FROST SUSCEPTIBLE THEN THE NON FROST SUSCEPTIBLE FOUNDATION MUST NOT BE LESS THAN 450mm THICK.
 - ALL JOINTS IN BINDER AND BASE COURSES TO BE SEALED WITHIN 24 HOURS IN ACCORDANCE WITH SHW CLAUSE 903.

T4	DETAILS UPDATED AS A RESULT OF DRAINAGE CHANGES	JK	AK	SW	17.12.20
T3	DETAILS ADJUSTED FOR CLARITY	JK	AK	SW	09.11.20
T2	TITLE BLOCK UPDATED	AK	SW	SW	21.10.20
Rev	Amendments	Dm	Chk	App	Date

**ODYSSEY**

Odyssey House
Unit 3 Winchester Hill Business Park
Winchester Hill, Romsey
Southampton SO51 7UT

Telephone: 01794 537980
Fax: 01265 331134
E: info@odysseyconsult.co.uk
W: www.odysseyconsult.co.uk

Job Title			
LAND AT STAKERS FARM, YAPTON			
Drawing Title			
HIGHWAY CONSTRUCTION DETAILS (SHEET 1 OF 2)			
Client			
DANDARA LIMITED (SOUTHERN)			
Scale	Date	Designed	
AS SHOWN @A1	SEP 2020	AK	
Drawn	Checked	Approved	
JK	AK	SW	
Job No	Drawing No	Rev	
19-156	YAP-180-035	T4	