





Arek Kadlec

From: [REDACTED]
Sent: 05 April 2022 15:42
To: Arek Kadlec
Subject: FW: Planning Consultation on: Y/6/22/DOC

Hi Arek,

Please see confirmation below of the 250mm from Parchow.

I know this is a question but any idea how much longer we will be until we can resubmit something we are confident Laura will OK?

Subject: Re: Planning Consultation on: Y/6/22/DOC

Hi David.

I can confirm it was 250mm crates from SDS used, apologies for the error on the sheet

Kind regards,

Tom Hunter
Operations Manager
Parchow Groundworks

Subject: FW: Planning Consultation on: Y/6/22/DOC

Tom,

As mentioned in the email just sent prior to this, can you please look at the below email and come back to me ASAP

Arek Kadlec

Subject: FW: SUDS information
Attachments: GEOLight 600 800 Datasheet.pdf

[REDACTED]

Tom,

The loadings should be fine assuming light traffic i.e. cars, occasional bin lorry/fire tender. As you know we proposed our strongest unit the GEOLight 800. See data sheet attached.

In terms of volumes the total gross for the tanks combined is 148.67m3 and the GEOLight units have a void ratio of at least 95%.


Andrew Coulson
Business Development Manager

[REDACTED]



Clearwater House | Castlemills | Biddisham | Somerset | BS26 2RE | United Kingdom

[REDACTED]





**UK BUSINESS
AWARDS 2017
WINNER**

This e-mail and any attachments are strictly confidential and intended solely for the addressee. It may contain information which is covered by legal, professional or other privilege. If you are not the intended recipient of this document then you must immediately inform the sender or the addressee below and delete this e-mail and any attachments completely from your computer system. You must not take copies or reveal the contents of this document to anyone, nor rely on any action based upon it. E-mail is an informal method of communication and is subject to possible data corruption.

SBS Holdings Ltd (Group of Companies) reserves the right to exercise control over the content of the information contained in transmissions made via the Internet. Opinions, conclusions and other information expressed in this message are solely those of the author and are not given or endorsed by the SBS Holdings Ltd (Group of Companies) unless otherwise indicated by an authorised representative independent of this message. It is the responsibility of the recipient to ensure that this message and any attachments are virus free and no responsibility is accepted by SBS Holdings Ltd (Group of Companies) for any loss or damage arising in any way for its use.



SDS GEOLIGHT

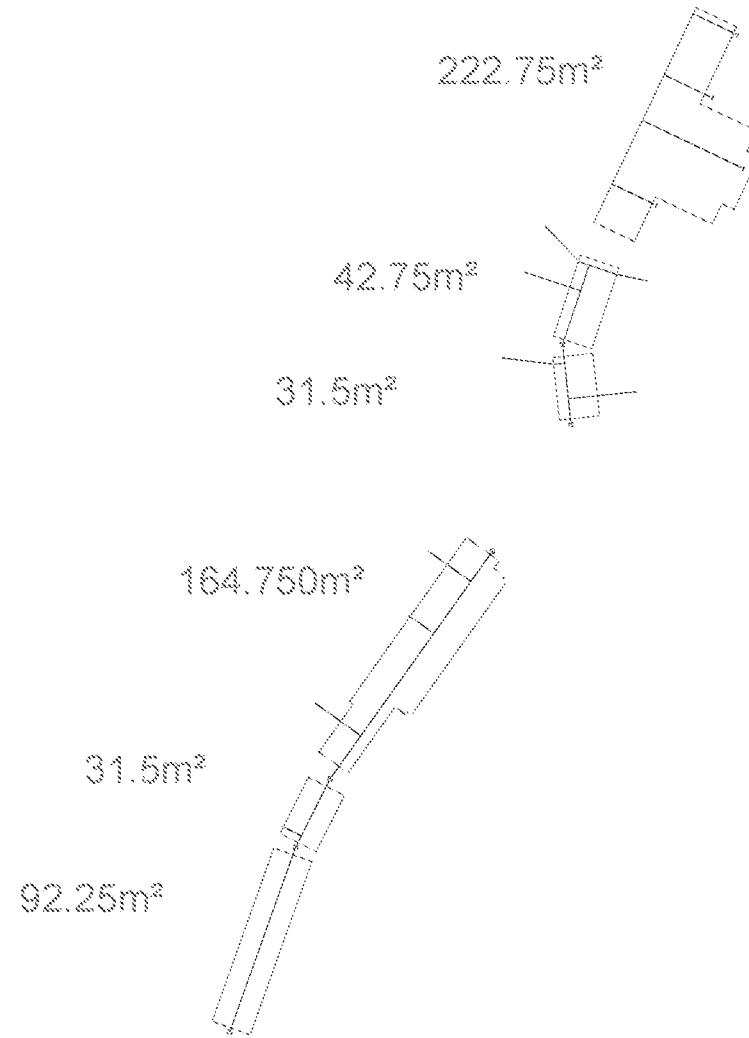

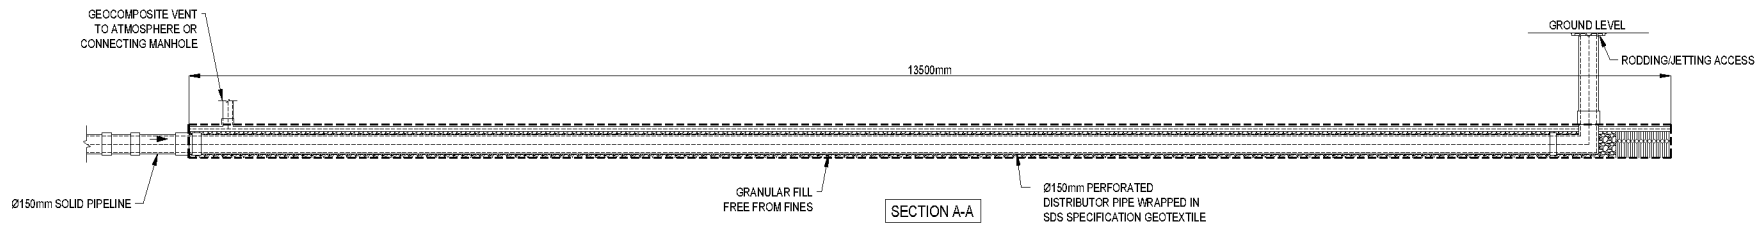

APPROX. CL 6.460 - 6.720

TOT 6.245
IL 5.995

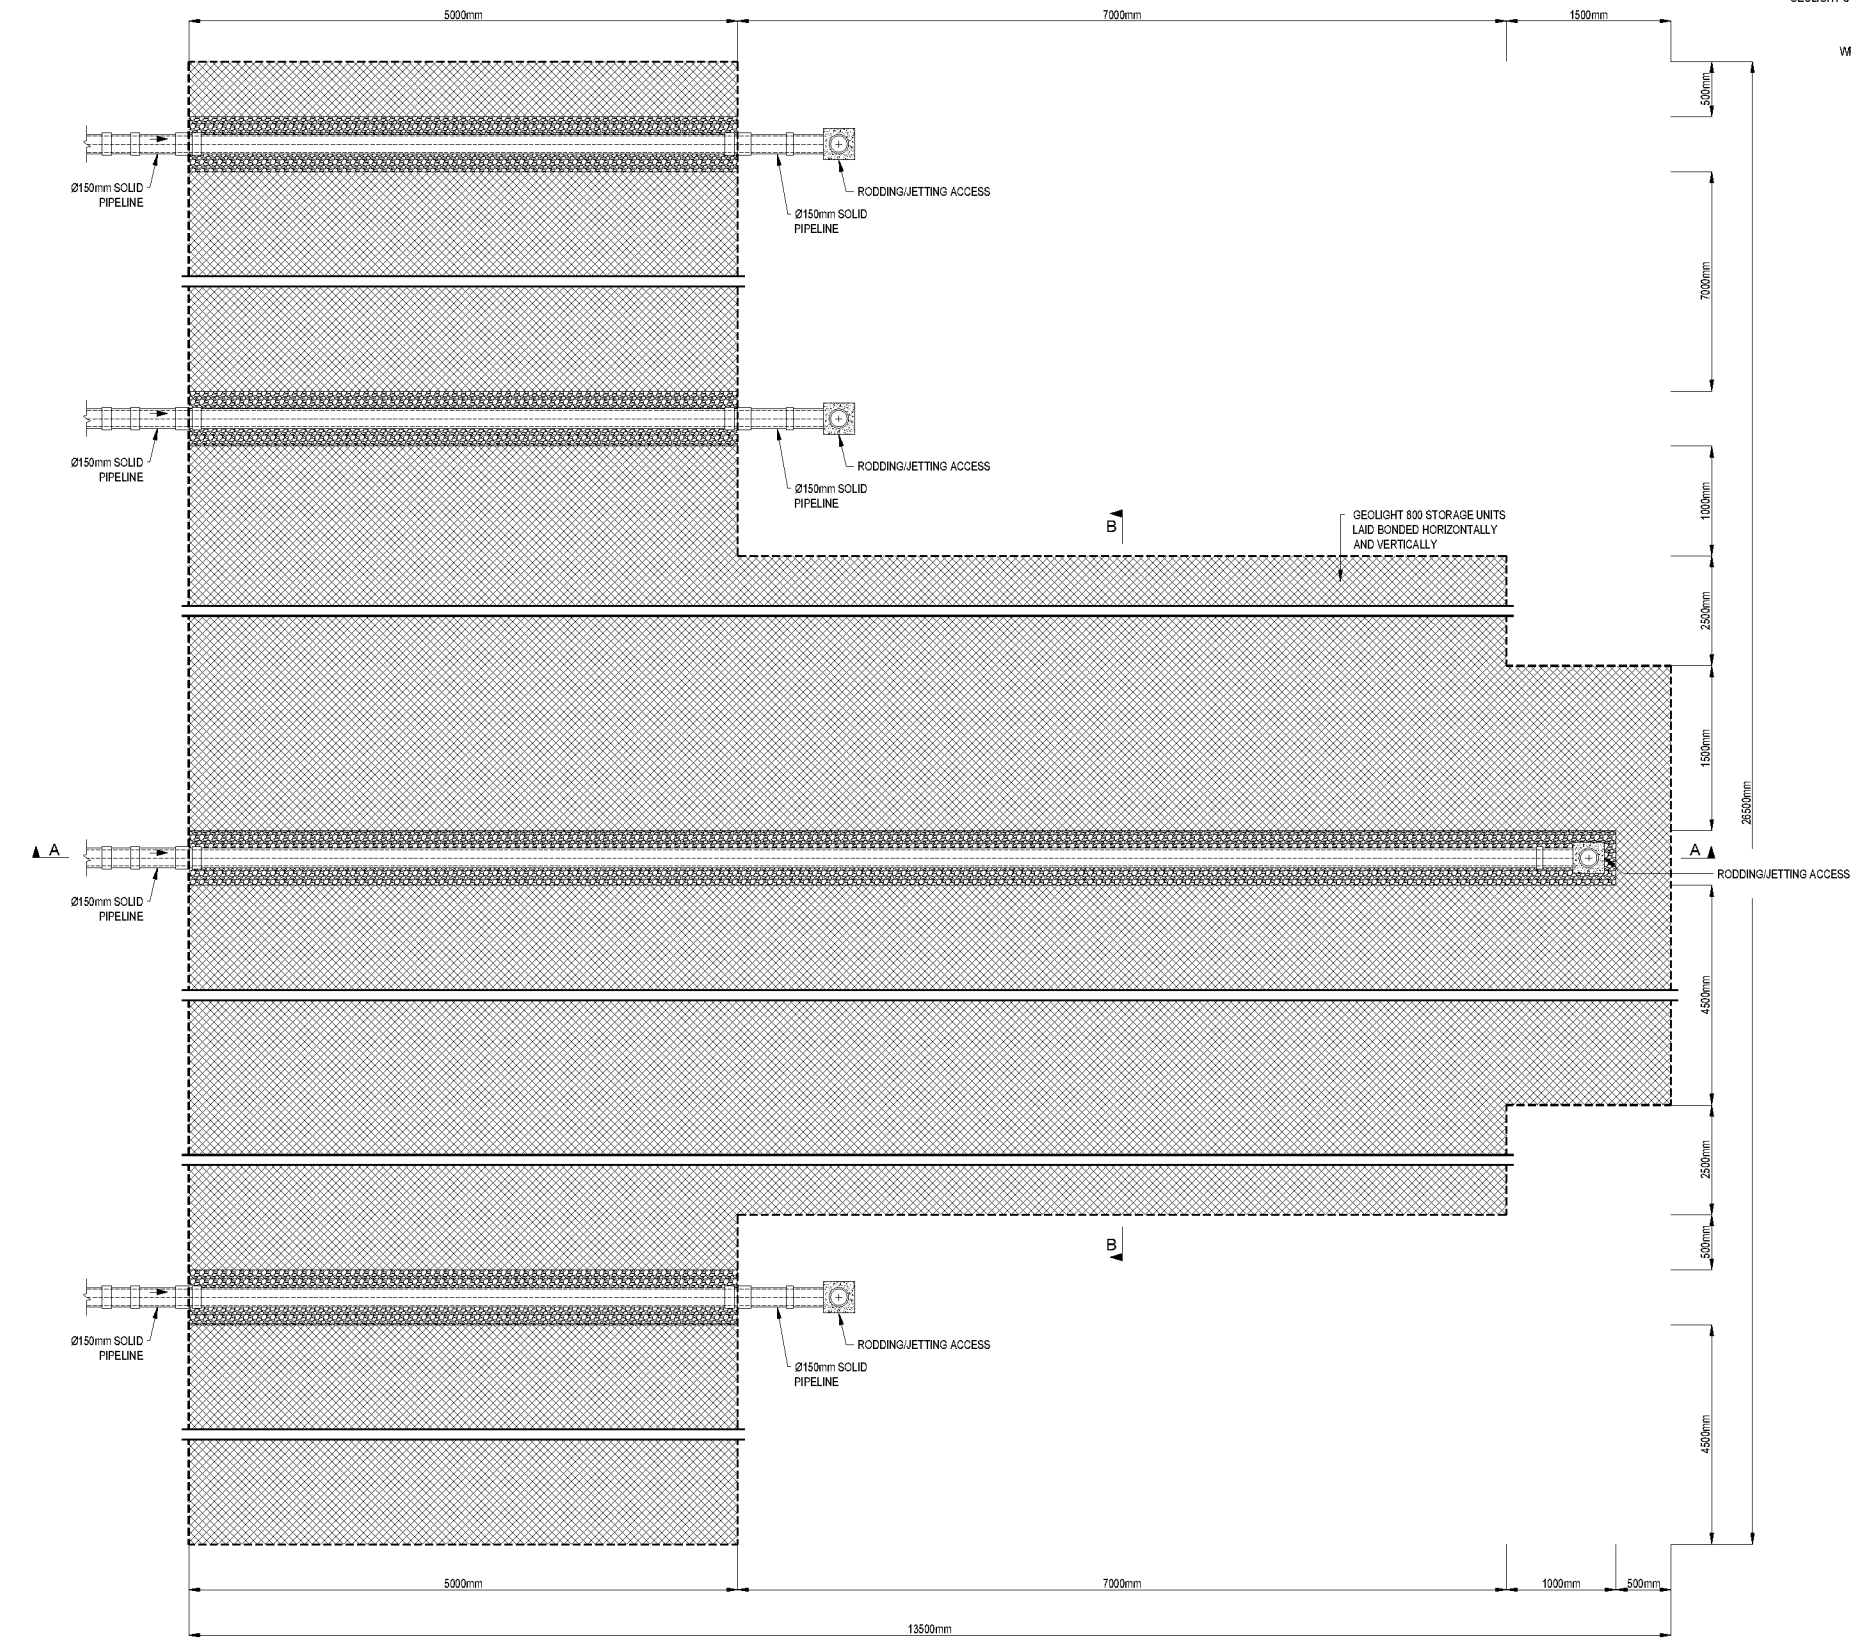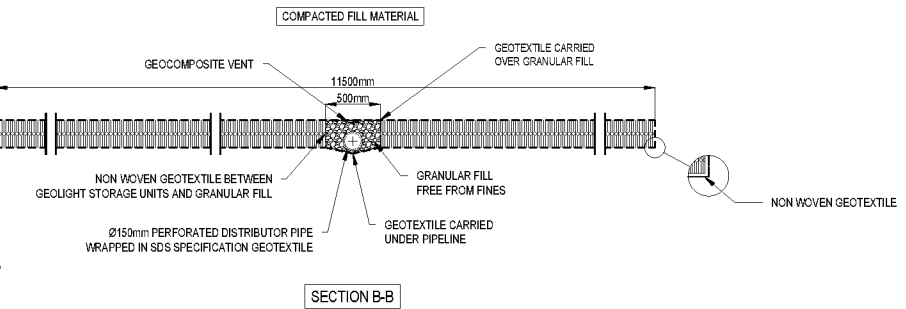

Notes:


This Drawing is to be read in conjunction with all relevant Architects' Engineers' and specialists' drawings and specifications.

Do not scale from this drawing in either paper or digital form. Use written dimensions only.

SDS to leave solid stub only, exiting tank for connection by others.

All external Manholes, Access Points, Junctions & Pipes are shown for guidance only and not part of the SDS program unless otherwise agreed.

ISSUED FOR APPROVAL	06.08.21
RJ	SP
Rev	Comments
	Date
	DRW/CHK



Clearwater House
Castlemills
Biddisham
Somerset
BS26 2RE
+44 (0)1934 751303

sdslimited.com



LAND AT STAKERS FARM,
YAPTON

PARCHOW GROUNDWORKS

SOAKAWAY TANK 12 DETAIL

REFERENCE DRAWINGS:			
Drawing Number	Revision	Drawing Title	Date
-	-	YAP-130-082C8 DRAINAGE LAYOUT SHEET 2 OF 6	-

Scale	NTS	Date	06.08.21
Drawing No	E24121_12	Rev	-

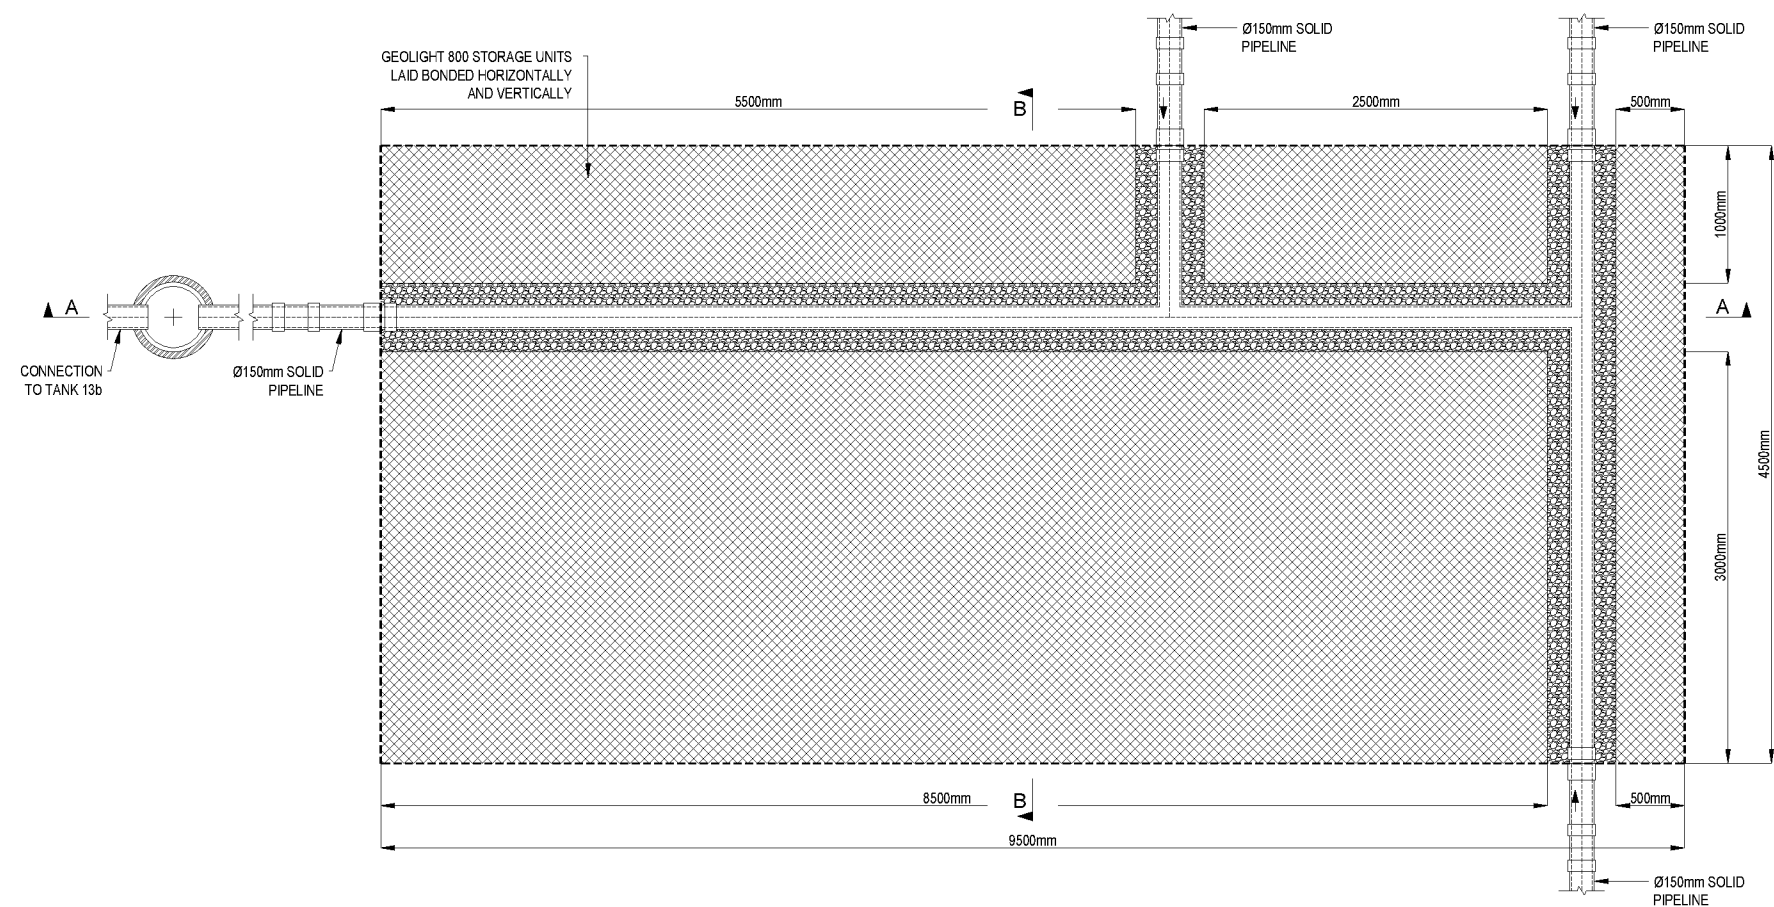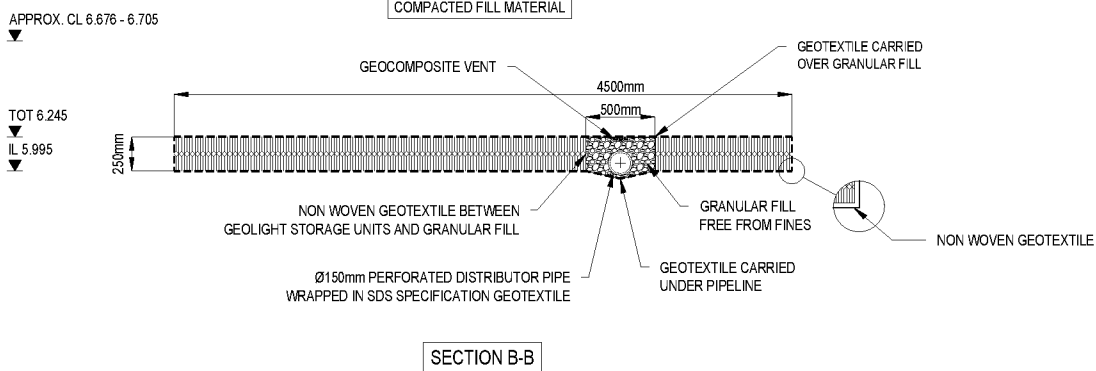


All external Manholes, Access Points, Junctions & Pipe are shown for guidance only and not part of the SDS program unless otherwise agreed.


NTS	Date 06.08.21
-----	---------------

REFERENCE DRAWINGS:			
Drawing Number	Revision	Drawing Title	Date
-	-	YAP-130-082C8 DRAINAGE LAYOUT SHEET 2 OF 6	-


PP SILT TRAP
REF: NEW
IL: 5.995



GEOCOMPOSITE VENT
TO ATMOSPHERE OR
CONNECTING MAN-HOLE

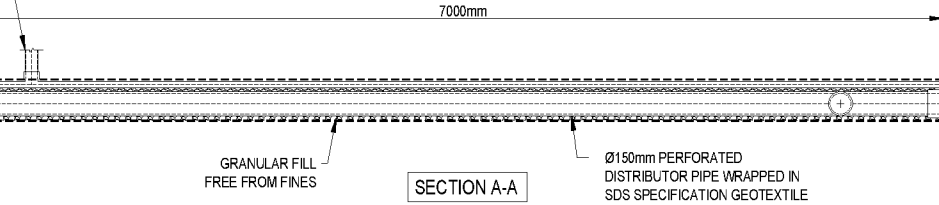


PP SILT TRAP
REF: NEW
IL: 5.995




APPROX. CL 6.620 - 6.705

TOT 6.245
IL 5.995

COMPACTED FILL MATERIAL

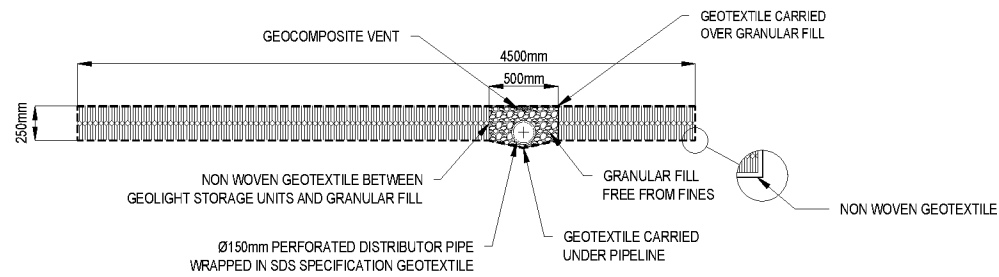

SECTION B-B

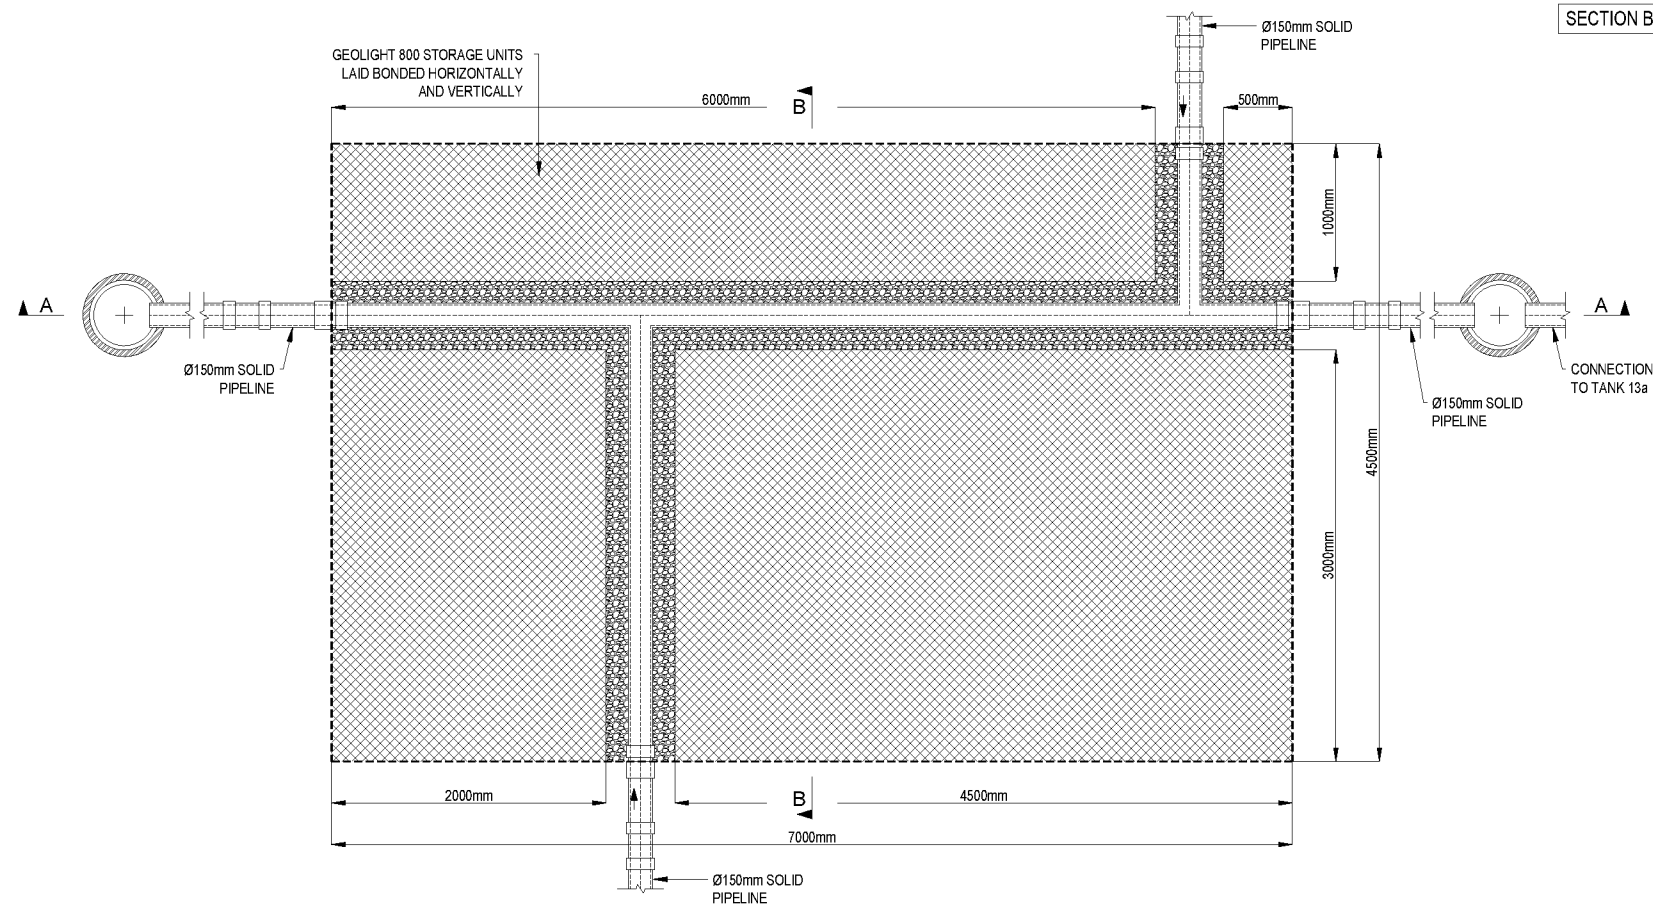

Notes:


This Drawing is to be read in conjunction with all relevant Architects' Engineers' and specialists' drawings and specifications.

Do not scale from this drawing in either paper or digital form. Use written dimensions only.

SDS to leave solid stub only, exiting tank for connection by others.

All external Manholes, Access Points, Junctions & Pipes are shown for guidance only and not part of the SDS program unless otherwise agreed.

ISSUED FOR APPROVAL	06.08.21
Rev	Comments
Rev	Comments



Clearwater House
Castlemills
Biddisham
Somerset
BS26 2RE
+44 (0)1934 751303

sdslimited.com


LAND AT STAKERS FARM,
YAPTON

PARCHOW GROUNDWORKS

SOAKAWAY TANK 13b DETAIL

REFERENCE DRAWINGS:			
Drawing Number	Revision	Drawing Title	Date
-	-	YAP-130-082C8 DRAINAGE LAYOUT SHEET 2 OF 6	-

Scale	NTS	Date	06.08.21
Drawing No	E24121_13b	Rev	-

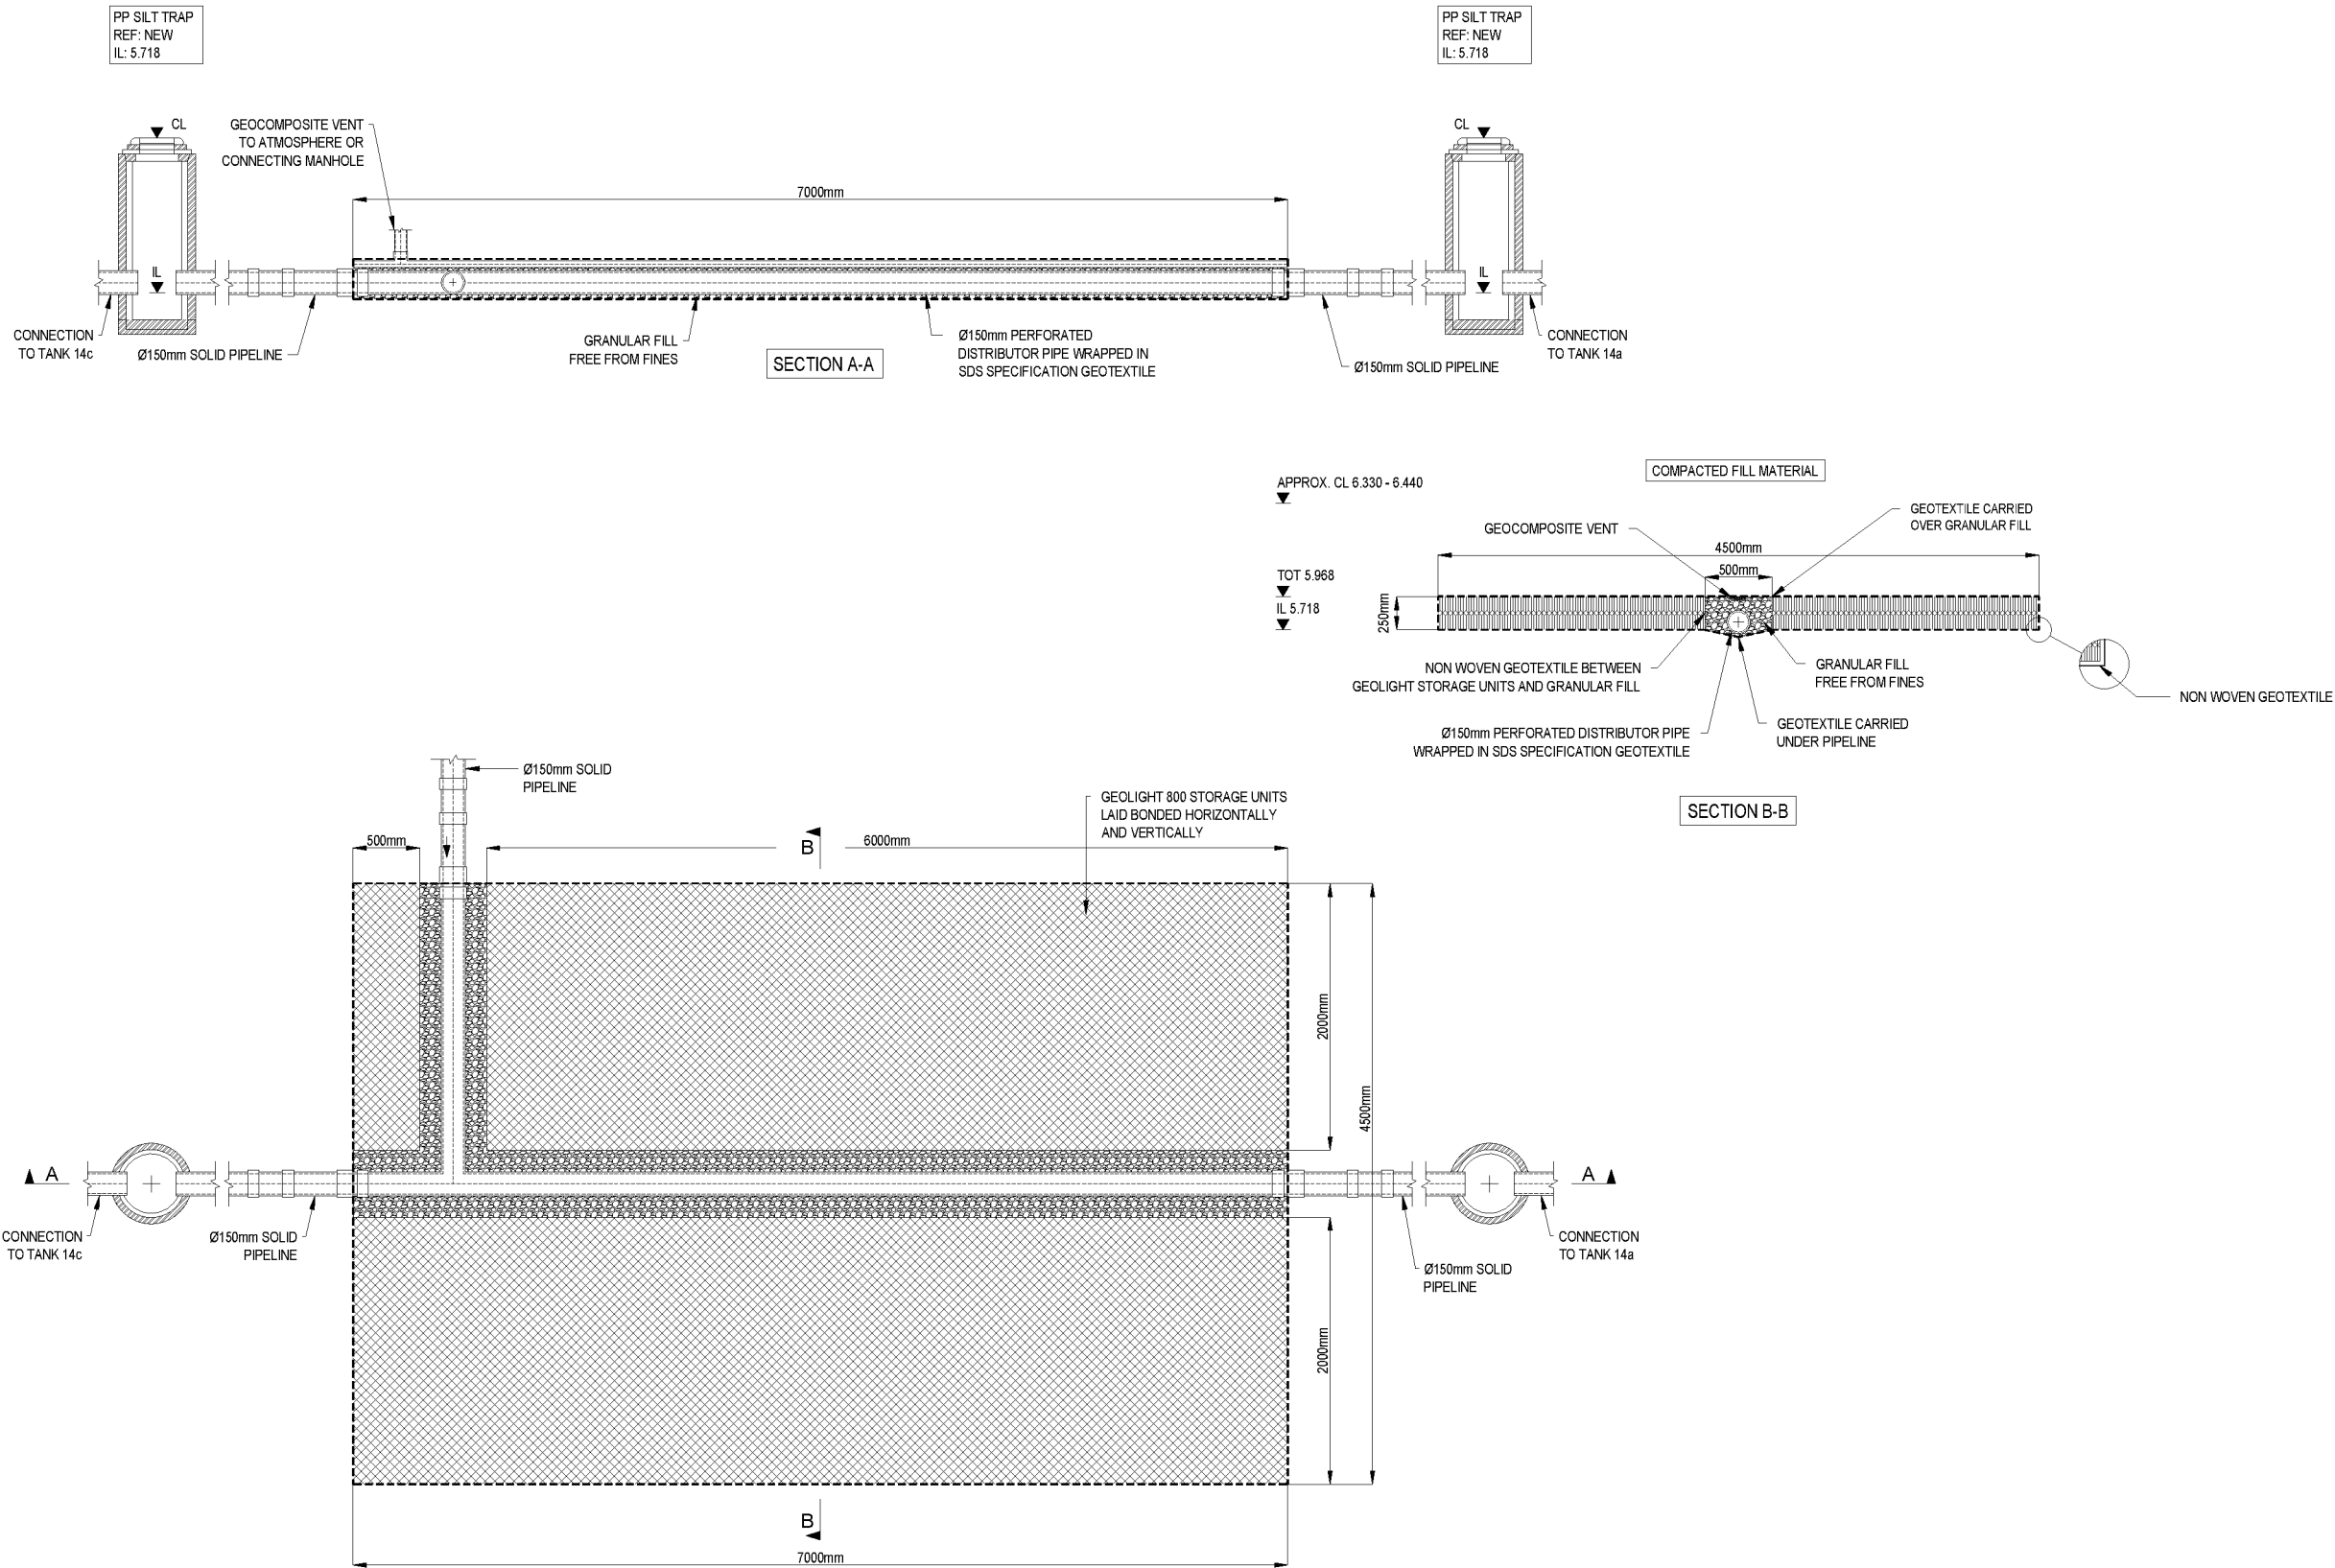

Notes:


This Drawing is to be read in conjunction with all relevant Architects' Engineers' and specialists' drawings and specifications.

Do not scale from this drawing in either paper or digital form. Use written dimensions only.

SDS to leave solid stub only, exiting tank for connection by others.

All external Manholes, Access Points, Junctions & Pipes are shown for guidance only and not part of the SDS program unless otherwise agreed.

ISSUED FOR APPROVAL	06.08.21
Rev	Comments
Rev	Comments
Rev	Comments



sdslimited.com

LAND AT STAKERS FARM,
YAPTON


PARCHOW GROUNDWORKS

SOAKAWAY TANK 14b DETAIL

Drawing Number	Revision	Drawing Title	Date
-	-	YAP-130-082C8 DRAINAGE LAYOUT SHEET 2 OF 6	-

Scale	NTS	Date	06.08.21
Drawing No	E24121_14b	Rev	-

PP SILT TRAP
REF: NEW
IL: 5.716



GEOCOMPOSITE VENT
TO ATMOSPHERE OR
CONNECTING MANHOLE

TOP HAT ARRANGEMENT
TO SEAL STORAGE TANK
AT PIPE CONNECTION

Ø150mm SOLID PIPELINE


20500mm

SECTION A-A

GRANULAR FILL
FREE FROM FINES

Ø150mm PERFORATED
DISTRIBUTOR PIPE WRAPPED IN
SDS SPECIFICATION GEOTEXTILE

PP SILT TRAP
REF: NEW
IL: 5.716



Ø150mm SOLID PIPELINE

CONNECTION
TO TANK 14b

APPROX. CL 6.190 - 6.330

TOT 5.968
IL 5.718

COMPACTED FILL MATERIAL

GEOCOMPOSITE VENT

GEOTEXTILE CARRIED
OVER GRANULAR FILL

NON WOVEN GEOTEXTILE BETWEEN
GEOLIGHT STORAGE UNITS AND GRANULAR FILL

Ø150mm PERFORATED DISTRIBUTOR PIPE
WRAPPED IN SDS SPECIFICATION GEOTEXTILE

GRANULAR FILL
FREE FROM FINES

GEOTEXTILE CARRIED
UNDER PIPELINE

NON WOVEN GEOTEXTILE

SECTION B-B

GEOLIGHT 800 STORAGE UNITS
LAID BONDED HORIZONTALLY
AND VERTICALLY

TOP HAT ARRANGEMENT
TO SEAL STORAGE TANK
AT PIPE CONNECTION

Ø150mm SOLID PIPELINE

Ø150mm SOLID PIPELINE

CONNECTION
TO TANK 14b

20500mm

REFERENCE DRAWINGS:			
Drawing Number	Revision	Drawing Title	Date
-	-	YAP-130-082C8 DRAINAGE LAYOUT SHEET 2 OF 6	-

Notes:


This Drawing is to be read in conjunction with all relevant Architects' Engineers' and specialists' drawings and specifications.

Do not scale from this drawing in either paper or digital form. Use written dimensions only.

SDS to leave solid stub only, exiting tank for connection by others.

All external Manholes, Access Points, Junctions & Pipes are shown for guidance only and not part of the SDS program unless otherwise agreed.

ISSUED FOR APPROVAL	06.08.21
RJ	SP
Rev	Comments
DRW	CHK



sdslimited.com

LAND AT STAKERS FARM,
YAPTON

PARCHOW GROUNDWORKS

SOAKAWAY TANK 14c DETAIL

Scale	NTS	Date	06.08.21
Drawing No	E24121_14c	Rev	-

Appendix G

Infiltration Blankets Evidence

S78

IL 5.994

IL 5.886

5.682

5.673

.650

IL 5.865

5.687

5.695

Dig Levels

26 May 2021 at 11:39:03
Arundel
Soak away





















