

M.H. REF.	INVEST LOWEST	COVER COVER	CHAMBER SIZE INTERNAL DIMS	COVER SIZE CLEAR OPENING	COVER TYPE	M.H. COMMENT / DRG.
F1	3,370	6,100	EXISTING MM	EXISTING	-	-
F2	3,750	6,400	EXISTING MM	EXISTING	-	-
F3	4,000	6,400	9/2000	6'5" x 6'5"	D400	STD 01.30
F4	4,200	6,500	EXISTING MM	EXISTING	-	-

M.H. REF.	INVENT COVER	CHAMBER SIZE	COVER SIZE	COVER OPENING	COVER TYPE	M.H. COMMENT / DRG.
NO.	LOWEST	INTERNAL	DIMS			
S1	6,425	EXISTING MH	EXISTING	EXISTING MH		EXISTING MH
S2	5,450	760 x 975	760 x 975	D460	CAT-CAPT	DEMOLISH EXIST MH
S3	6,300	EXISTING MH	EXISTING	D460	CAT-CAPT	DEMOLISH EXIST MH
S4	5,450	760 x 975	760 x 960	D460	CAT-CAPT	STUD 1-4
S5	5,400	760 x 975	760 x 960	D460	CAT-CAPT	STUD 1-4
S6	5,400	6,220	750 x 975	D460	CAT-CAPT	STUD 1-4
S7	5,400	6,220	750 x 975	D460	CAT-CAPT	STUD 1-4
S8	5,400	760 x 975	750 x 960	D460	CAT-CAPT	STUD 1-4
S9	5,400	760 x 975	760 x 960	D460	CAT-CAPT	STUD 1-4
S10	5,400	760 x 975	760 x 960	D460	P2	STUD 1-22

SOWKAYMA SCHEDULE

TYPE	EFFECTIVE (m)	TOTAL (m)	PII DIMENSIONS (L x W)	COVER SIZE (COVER SIZING) (mm)	COVER TYPE	COVER COMMENT
S.A.C. ¹	1,500	1,700	4.00 X 2.00	2. 0225	B125	2. 0225 is 2000mm x 1000mm
S.A.E ²	1,200	1,300	3.00 X 2.00	2. 0225	B125	2. 0225 is 2000mm x 1000mm
S.A.C. ³	1,500	1,700	7.00 X 2.00	2. 0225	B125	2. 0225 is 2000mm x 1000mm



1. The Contractor shall immediately notify the Engineer if groundwater is encountered in Sackway pits.

2. Sackways shall have a minimum of 5,000mm from any buildings or structures.

3. A provisional cost allowance rate of £25.10 per hour shall apply for the duration of Sackway design.

- Highway Works Agreement
- Sewer Connection Agreement
- Precise RWP Locations
- Precise Foul Outlet Locations
- Foundation (Pile & Ground Beam) Details
- Retaining Wall Design

- 1 This drawing is to be read in conjunction with all relevant Architects and Engineers drawings and specifications.
- 2 Dimensions are in millimetres unless noted otherwise.
- 3 Original topographic survey undertaken by Kings Surveys.
For full topographic survey information see Kings drawing No. 99526/0001.
All levels based on O.S. Datum by GPS.
Elevation levels shown here: 6.577

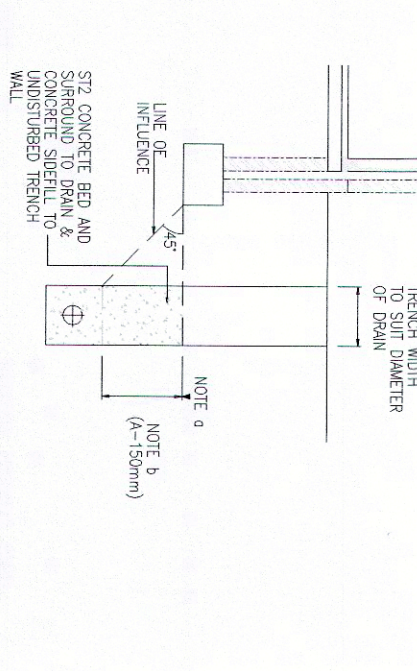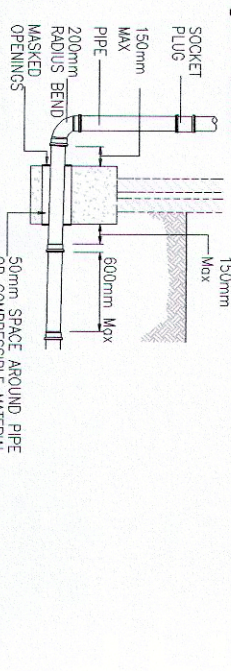

- [illegible]

P4	1200	CONC NO.	DRAWING NO.	P4	101	PRELIMINARY	REVISION	DESIGNED BY	PF	CHECKED BY	DATE	WARNINGS: - Continuation Sheet: - Restoration of contaminated soils may be required in future years. This may require further investigation. Please refer to the project's Ground Investigation Report (GIR) for details. - Future development: - Due to the close proximity of permeable materials (Subsides) within and across any of the new foot drainage system start from maximum 2.1.
WARNINGS: - Continuation Sheet: - Restoration of contaminated soils may be required in future years. This may require further investigation. Please refer to the project's Ground Investigation Report (GIR) for details. - Future development: - Due to the close proximity of permeable materials (Subsides) within and across any of the new foot drainage system start from maximum 2.1.												