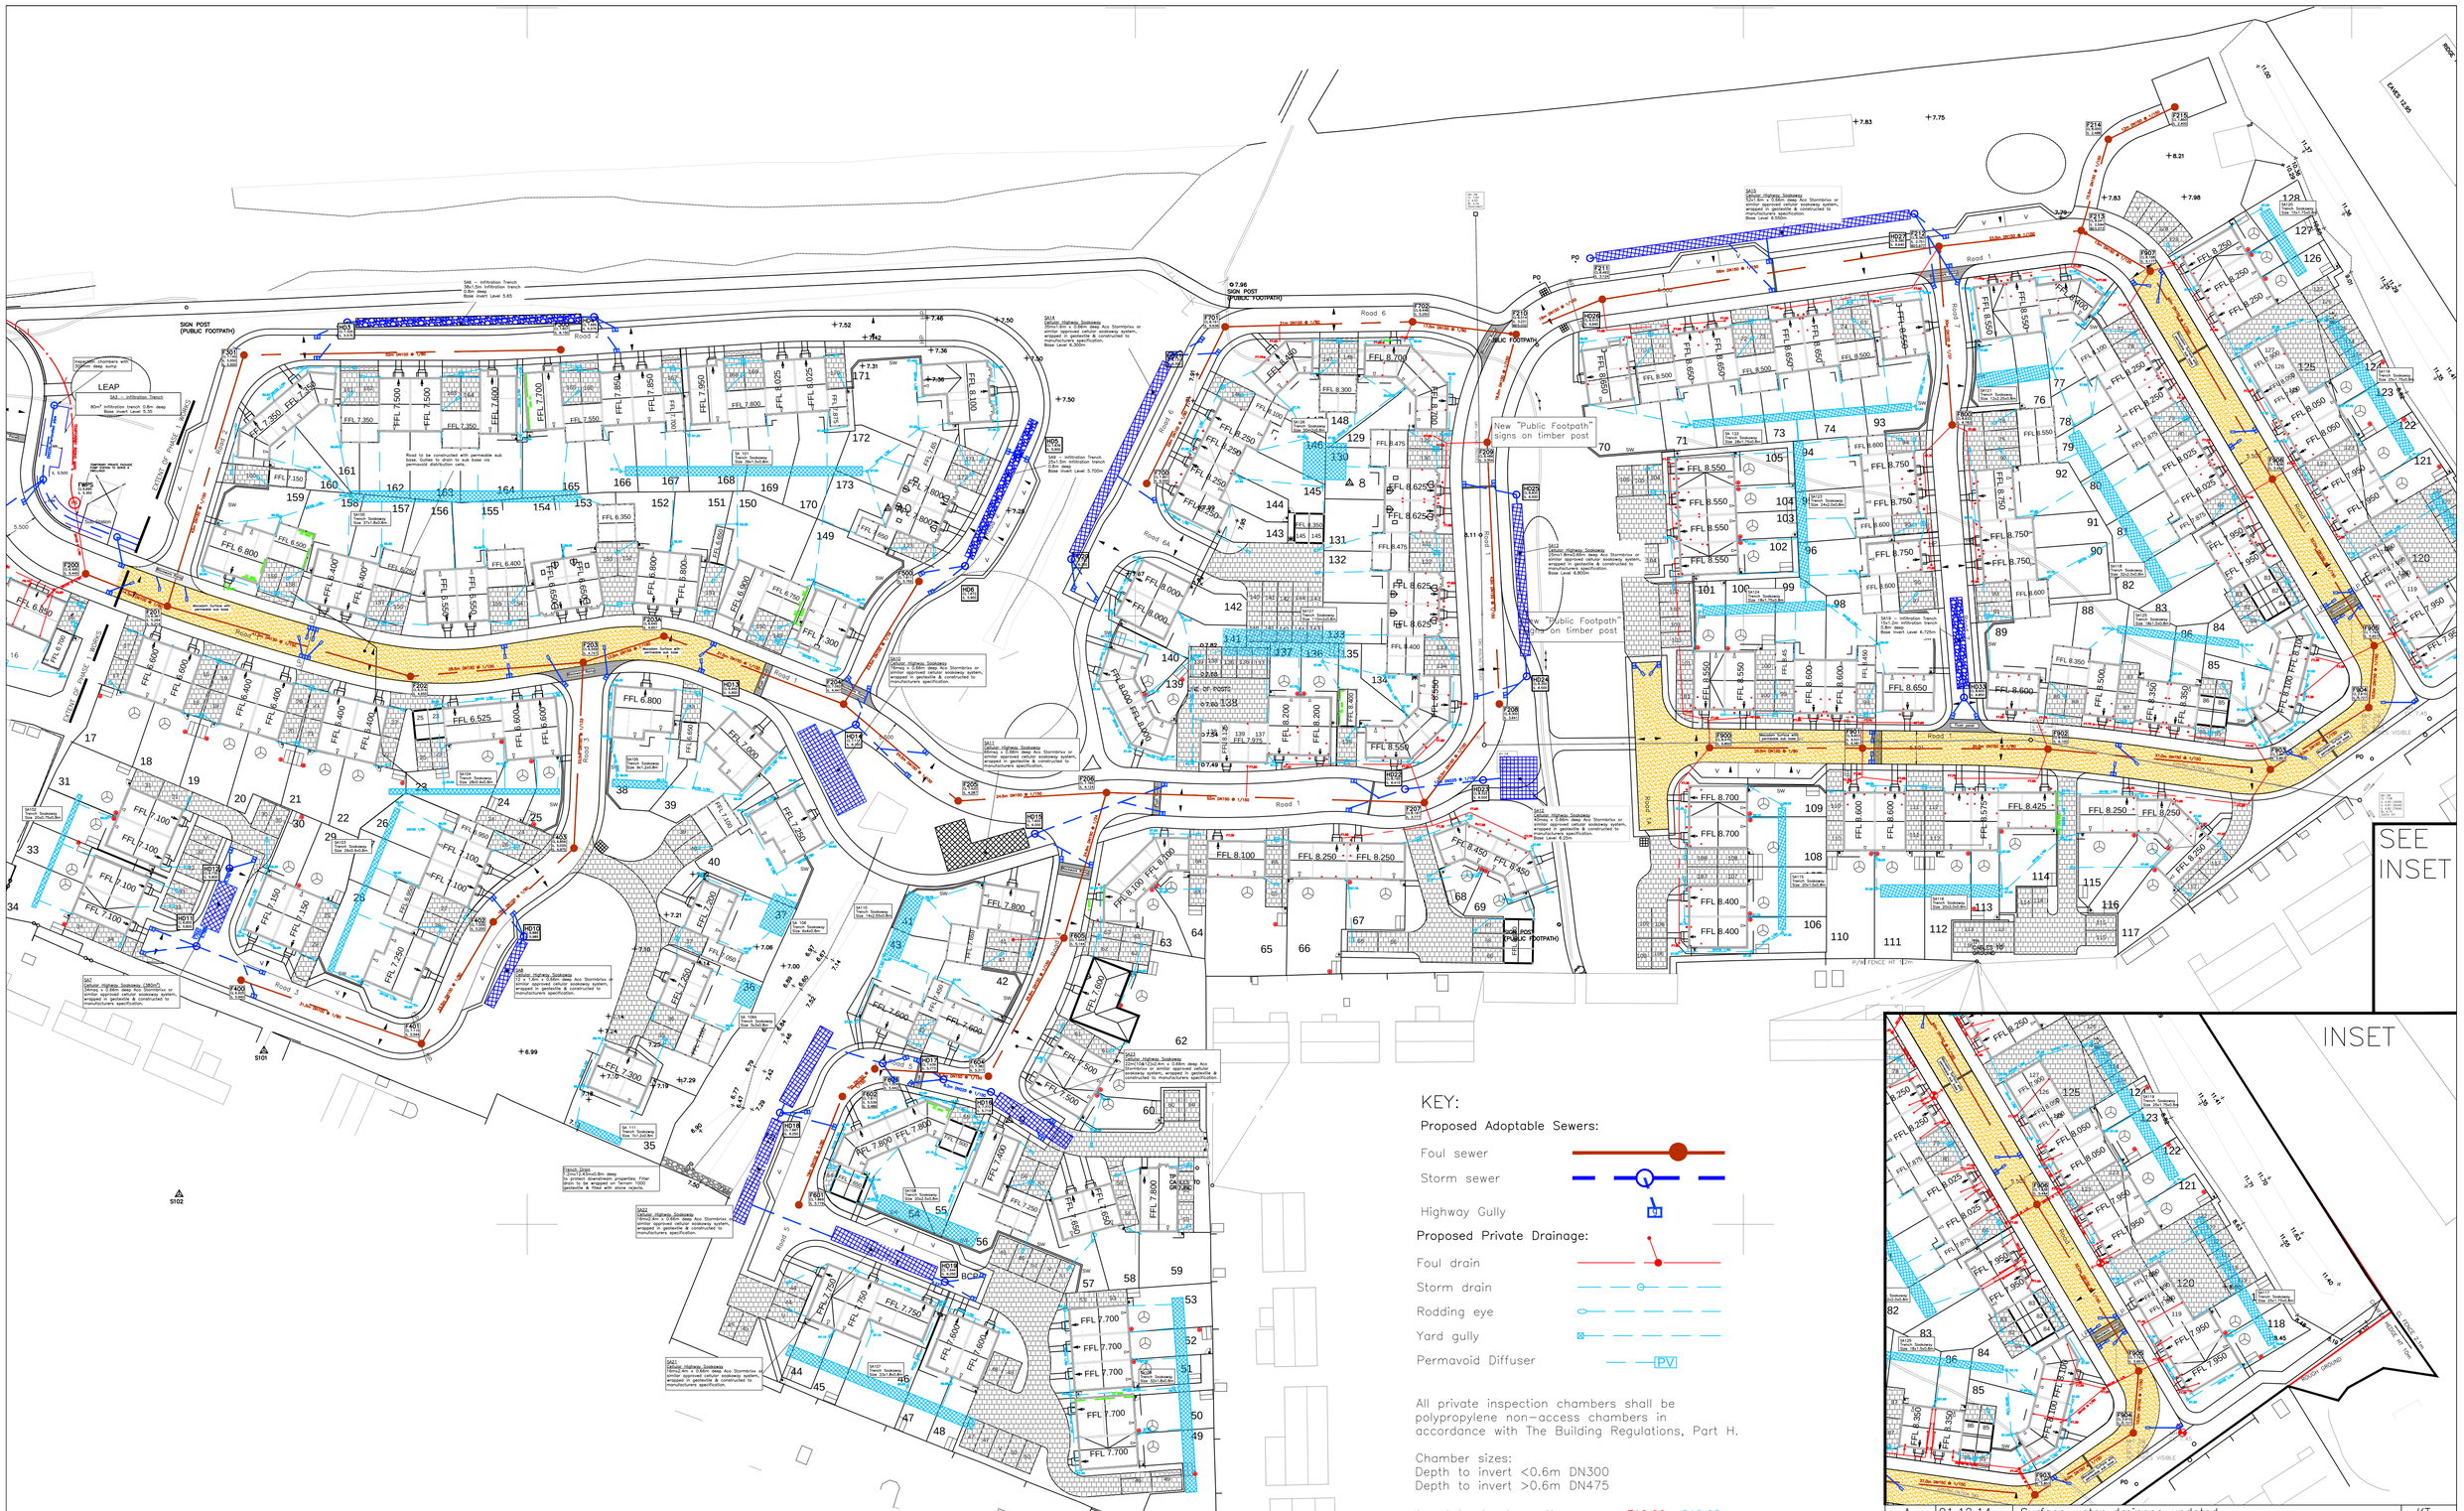

KEY:

Proposed Adoptable Sewers:

Foul sewer

Storm sewer

Highway Gully

Proposed Private Drainage:

Foul drain

Storm drain

Rodding eye

Yard gully

Permavoid Diffuser — PV

All private inspection chambers shall be polypropylene non-access chambers in accordance with The Building Regulations, Part H.

Chamber sizes:
Depth to invert <0.6m DN300
Depth to invert >0.6m DN475

Invert levels shown thus: F10.00 S10.00

Finished floor levels shown thus: FFL 10.00

Fall Arrows

Proposed Levels — XXX.XXX

Primary Access

Secondary Access

PRELIMINARY

REV. No.	DATE	DESCRIPTION	INITIALS
A	01.12.14	Surface water drainage updated.	KT

Client: CHARLES CHURCH

Project: Goodhew Close Phase 2, Yapton

Title: Soakaway Locations

MJA CONSULTING
CIVIL AND STRUCTURAL ENGINEERS
58-62 Ock Street, Abingdon
Oxon, OX14 5BZ
Tel: 01235 555173
Fax: 01235 523226

Scale	Date	Drawing No.	Rev
1:500@A1	Nov 14	4822:505	A
Checked TC	Drawn AMc		

© This drawing is the copyright of Michael A Jennings Associates Limited and may not be copied, altered or reproduced in any way without their permission.

ARUN DISTRICT COUNCIL Y/01/15/DOC