
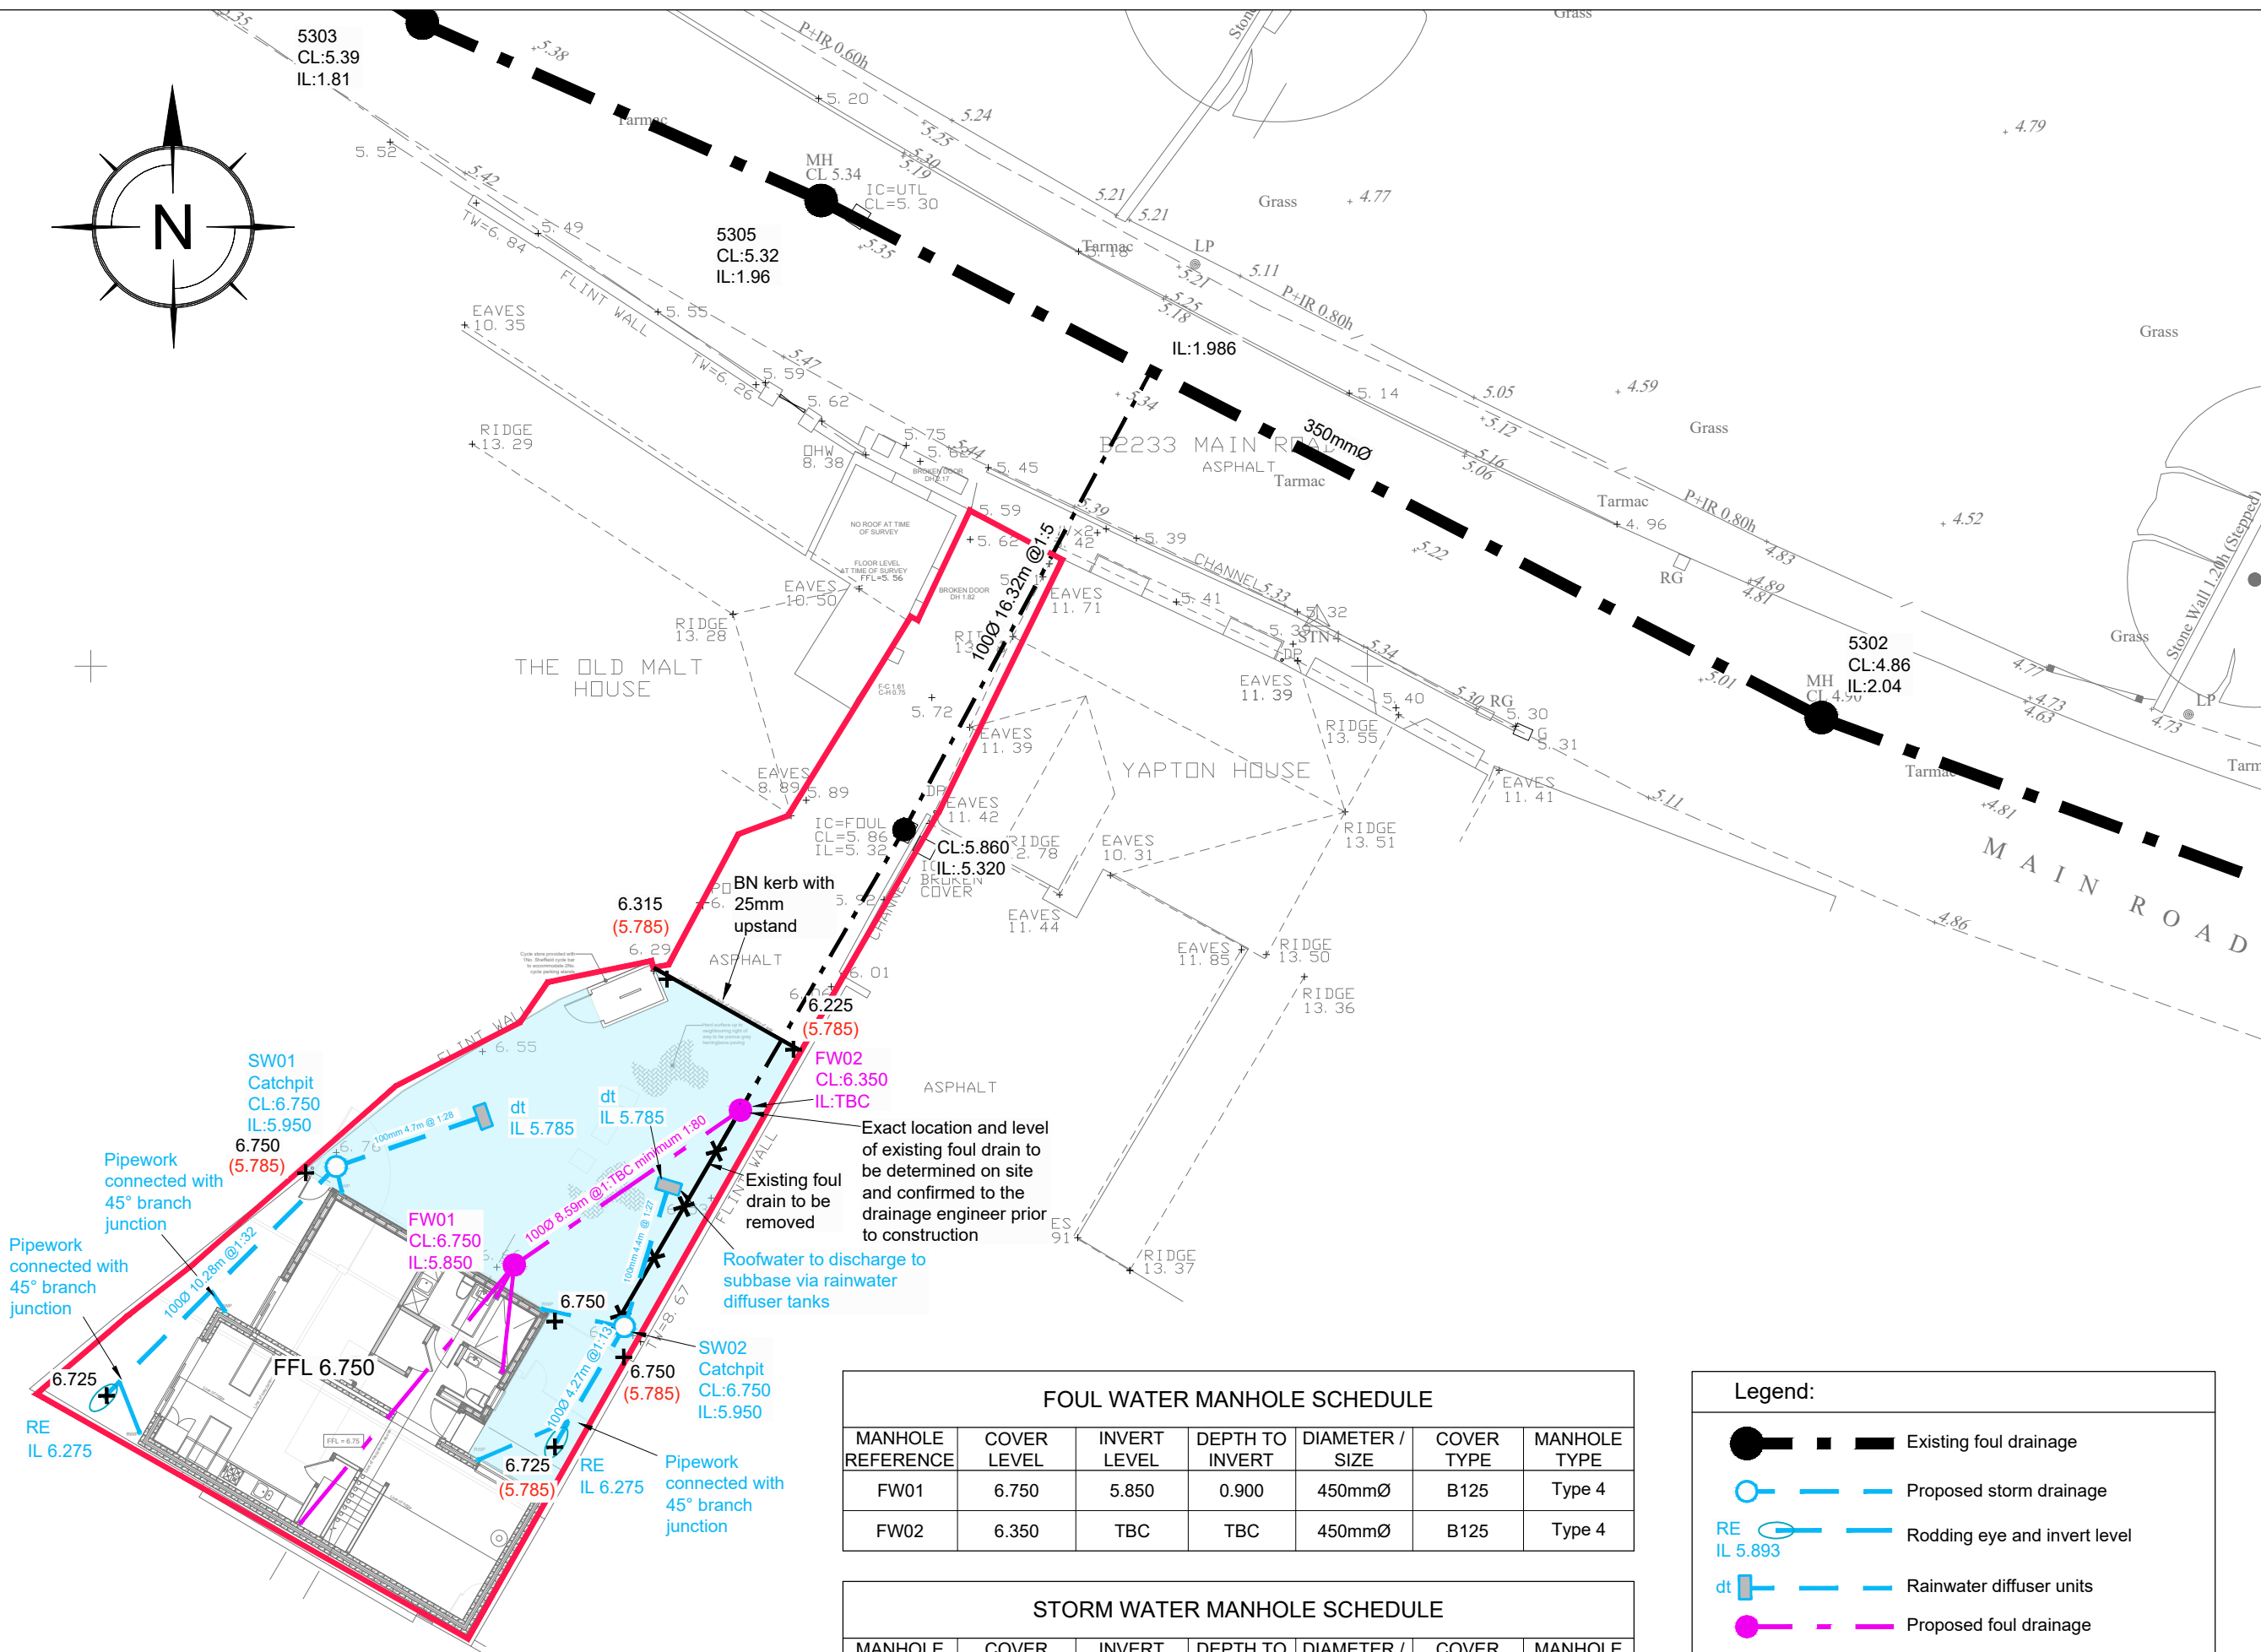


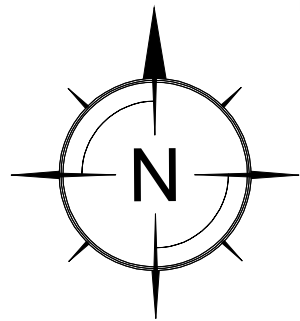

FOUL WATER MANHOLE SCHEDULE						
MANHOLE REFERENCE	COVER LEVEL	INVERT LEVEL	DEPTH TO INVERT	DIAMETER / SIZE	COVER TYPE	MANHOLE TYPE
FW01	6.750	5.850	0.900	450mmØ	B125	Type 4
FW02	6.350	TBC	TBC	450mmØ	B125	Type 4

STORM WATER MANHOLE SCHEDULE						
MANHOLE REFERENCE	COVER LEVEL	INVERT LEVEL	DEPTH TO INVERT	DIAMETER / SIZE	COVER TYPE	MANHOLE TYPE
SW1	6.750	5.950	0.800	500mmØ	B125	Catchpit
SW2	6.750	5.950	0.800	500mmØ	B125	Catchpit

Legend:

Existing foul drainage

Proposed storm drainage

RE IL 5.893 Rodding eye and invert level

dt Rainwater diffuser units

Proposed foul drainage

Extent of permeable paving surface with voided subbase beneath for stormwater attenuation 113m³

6.725 + (5.760) Proposed finished level. Bottom of subbase level in brackets

- GENERAL NOTES:
1. All dimensions to be checked on site. All details and dimensions relating to sub-Contractors work must be checked and agreed between the sub-Contractor or supplier and the general Contractor.

2. This drawing is to be read in conjunction with all relevant Architect's and Engineer's drawings and specification.

3. The main Contractor is responsible for ensuring the stability of the structure whilst the works are in progress.

4. Any information given regarding existing underground services is given in good faith after consultation with the relevant authority. No liability is accepted by the Consultant and the main Contractor is responsible for obtaining and checking all information and taking due care and attention whilst undertaking the works.
- DRAINAGE NOTES:
1. All adoptable pipes, bends and junctions shall be vitrified clay to BS EN 295-1, with flexible joints and kitemark certified.

2. All Adoptable sewers shall be in strict accordance with the 7th edition of Sewers For Adoption. Unless otherwise stated adoptable sewers shall be 150mm diameter and shall be laid in a class S bedding. Where the depth to soffit is less than 1.2m under a public highway or 0.9m elsewhere the pipe shall be laid with a class Z bedding.

3. All private building drainage shall be constructed in strict accordance with BS EN 752:2008. Unless otherwise specified building drainage shall be 100mm diameter and shall be laid at a minimum gradient of 1 in 40 for foul drains and 1 in 80 for surface water drains. All building drains shall be laid in class B bedding unless otherwise specified.

4. Where a pipe is within 1m of a foundation the trench shall be filled with class GEN 3 concrete up to the lowest level of the foundation. Where the trench is further than 1m from the foundation, the trench shall be filled with class GEN 3 concrete to a level below the lowest level for the foundation equal to the distance from the foundation less 150mm. In both cases the pipe shall be bedded and surrounded in 150mm thick class GEN 3 concrete.

5. Where pipes, external to the structures, have a depth to soffit from ground level of less than 450mm they shall have a class GEN 3 concrete encasement (150mm thick). In all other cases the pipes shall be bedded and surrounded with 100mm thick granular material.

6. In any circumstances where pipes are bedded and surrounded in concrete flexible joints should be provided. Compressible boards (fibreglass or polystyrene) shall be provided at a maximum of 8m centres (coinciding with pipe joints). The boards shall be pre-cut to pipe diameter and to a height and width equal to the concrete cross section. A board thickness of 18mm for pipes up to 450mm nominal diameter and 38mm for pipes over 450mm nominal diameter.

7. All svps shall have rodding access plates fitted at their bases (ground floor level).

8. Where existing pipes are to be abandoned they shall be dug out together with any abandoned manholes.

9. Any discrepancy between the drawing and site should be reported immediately to the Engineer.

10. All manhole and chamber sizes are given as a minimum to meet the 7th edition of Sewers For Adoption

11. Ground levels of surrounding land to be confirmed onsite

E [03.06.2020] MJP	Subbase levels added	MK
D [02.06.2020] MJP	Diffuser IL added to subbase levels	MK
C [12.05.2020] MJP	Updated to suit comments	MK
B [04.03.2020] NS	Surface Water Drainage and FFL Updated	MK
A [03.03.2020] MJP	Foul to existing run moved	MK

Issue Status FOR PLANNING

The Civil Engineering Practice

11 Tungsten Building

George Street

Fishergate

Sussex

BN41 1RA

01273 424424

reception@civil.co.uk

www.civil.co.uk

CLIENT		Mr Pete Mountford
PROJECT		Reptune Yapton West Sussex
TITLE		Proposed Layout Drainage Strategy Plan
DRAWN	DATE	PROJECT NO.
M Pacifico	Nov 2019	2326
ENGINEER	CHECKED	DRG NO.
M Kempshall	SRM	101
SCALE	1:200 @ A3	