


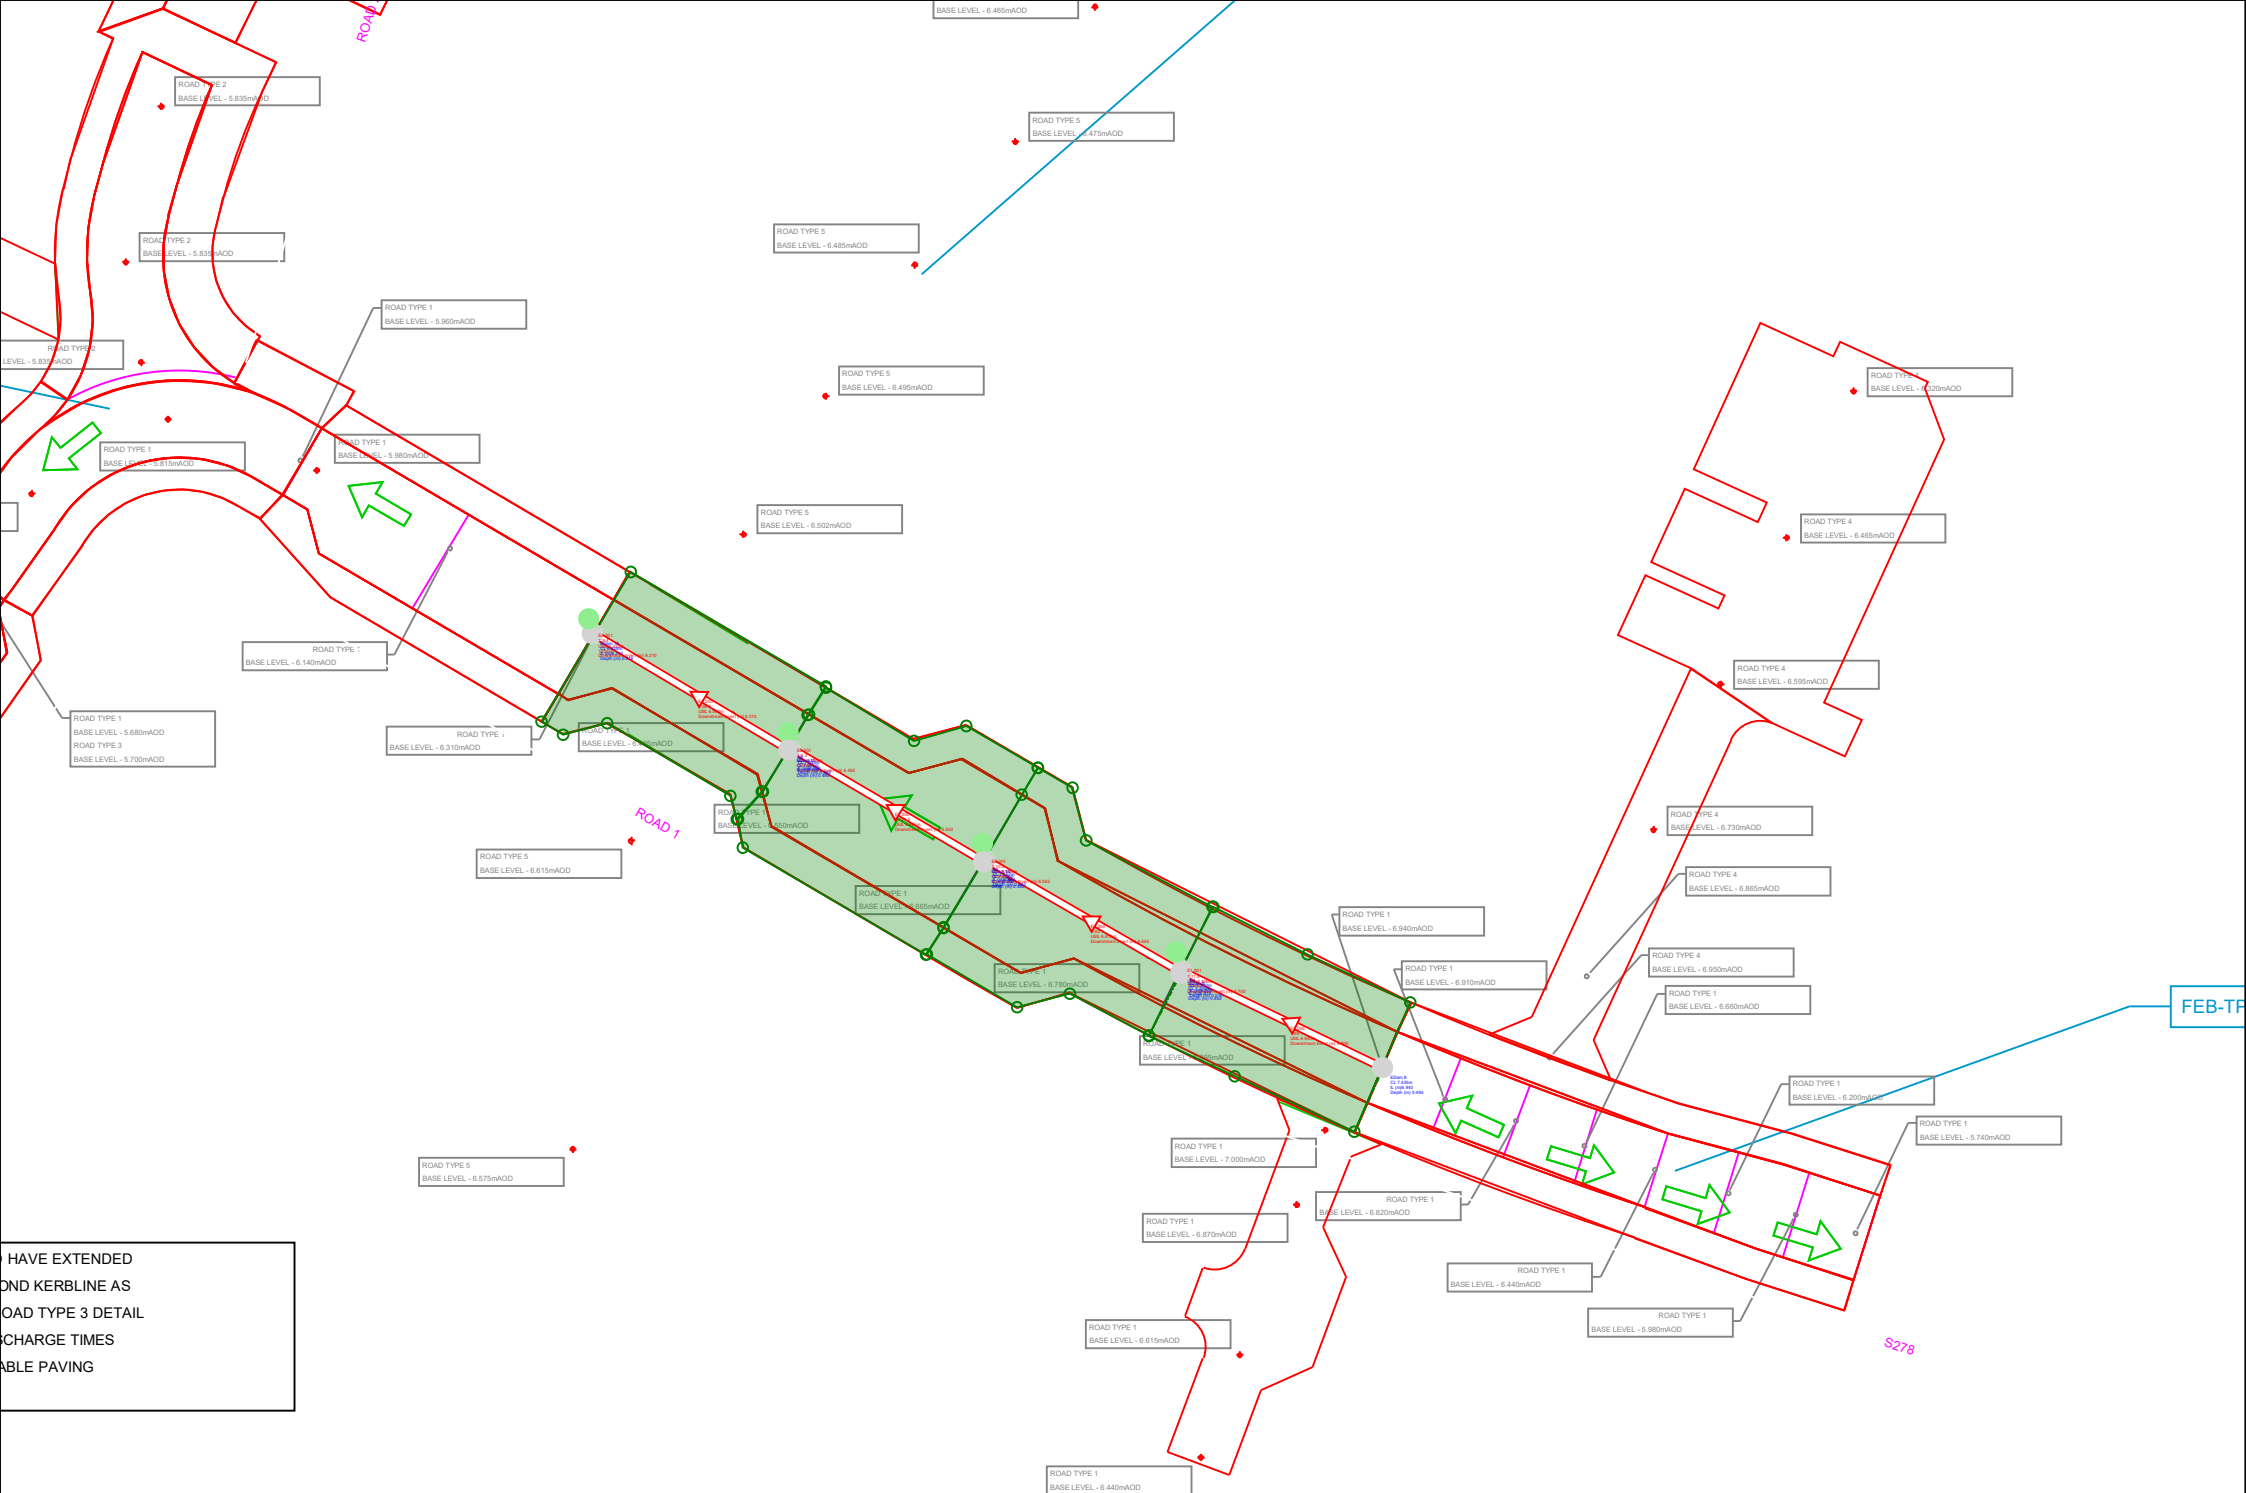

Odyssey		Page 1																								
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100																									
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by																									
Innovyze	Network 2020.1.3																									
<u>Time Area Diagram for Existing at outfall E (pipe E1.001)</u> <table border="1"> <thead> <tr> <th>Time (mins)</th> <th>Area (ha)</th> <th>Time (mins)</th> <th>Area (ha)</th> </tr> </thead> <tbody> <tr> <td>0-4</td> <td>0.007</td> <td>4-8</td> <td>0.005</td> </tr> </tbody> </table> Total Area Contributing (ha) = 0.012 Total Pipe Volume (m³) = 9.902 <u>Time Area Diagram at outfall E (pipe E2.001)</u> <table border="1"> <thead> <tr> <th>Time (mins)</th> <th>Area (ha)</th> <th>Time (mins)</th> <th>Area (ha)</th> </tr> </thead> <tbody> <tr> <td>0-4</td> <td>0.009</td> <td>4-8</td> <td>0.006</td> </tr> </tbody> </table> Total Area Contributing (ha) = 0.015 Total Pipe Volume (m³) = 14.772 <u>Time Area Diagram at outfall E (pipe E3.001)</u> <table border="1"> <thead> <tr> <th>Time (mins)</th> <th>Area (ha)</th> <th>Time (mins)</th> <th>Area (ha)</th> </tr> </thead> <tbody> <tr> <td>0-4</td> <td>0.010</td> <td>4-8</td> <td>0.007</td> </tr> </tbody> </table> Total Area Contributing (ha) = 0.017			Time (mins)	Area (ha)	Time (mins)	Area (ha)	0-4	0.007	4-8	0.005	Time (mins)	Area (ha)	Time (mins)	Area (ha)	0-4	0.009	4-8	0.006	Time (mins)	Area (ha)	Time (mins)	Area (ha)	0-4	0.010	4-8	0.007
Time (mins)	Area (ha)	Time (mins)	Area (ha)																							
0-4	0.007	4-8	0.005																							
Time (mins)	Area (ha)	Time (mins)	Area (ha)																							
0-4	0.009	4-8	0.006																							
Time (mins)	Area (ha)	Time (mins)	Area (ha)																							
0-4	0.010	4-8	0.007																							
©1982-2020 Innovyze																										

Odyssey		Page 2								
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100									
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by									
Innovyze	Network 2020.1.3									
<u>Time Area Diagram at outfall E (pipe E3.001)</u> Total Pipe Volume (m³) = 14.648 <u>Time Area Diagram at outfall E (pipe E4.001)</u> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Time (mins)</th> <th>Area (ha)</th> <th>Time (mins)</th> <th>Area (ha)</th> </tr> </thead> <tbody> <tr> <td>0-4</td> <td>0.008</td> <td>4-8</td> <td>0.005</td> </tr> </tbody> </table> Total Area Contributing (ha) = 0.013 Total Pipe Volume (m³) = 10.142			Time (mins)	Area (ha)	Time (mins)	Area (ha)	0-4	0.008	4-8	0.005
Time (mins)	Area (ha)	Time (mins)	Area (ha)							
0-4	0.008	4-8	0.005							
©1982-2020 Innovyze										

Odyssey										Page 3																																																																																																																																																	
Tuscany House White Hart Lane Basingstoke RG21 4AF					Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100																																																																																																																																																						
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX					Designed by WindesPC5 Checked by																																																																																																																																																						
Innovyze					Network 2020.1.3																																																																																																																																																						
<u>Existing Network Details for Existing</u> <table><tr><th>PN</th><th>Length (m)</th><th>Fall (m)</th><th>Slope (1:X)</th><th>I.Area (ha)</th><th>T.E. (mins)</th><th>Base Flow (l/s)</th><th>k (mm)</th><th>n</th><th>HYD SECT</th><th>DIA (mm)</th><th>Section Type</th></tr><tr><td>E1.000</td><td>13.878</td><td>0.140</td><td>99.1</td><td>0.012</td><td>5.00</td><td>0.0</td><td></td><td>0.075</td><td>→ ↓ →</td><td></td><td>Porous Car Park</td></tr><tr><td>E1.001</td><td>1.190</td><td>0.100</td><td>11.9</td><td>0.000</td><td>0.00</td><td>0.0</td><td>0.600</td><td></td><td>o</td><td>100</td><td>Pipe/Conduit</td></tr><tr><td>E2.000</td><td>14.088</td><td>0.153</td><td>92.1</td><td>0.015</td><td>5.00</td><td>0.0</td><td></td><td>0.075</td><td>→ ↓ →</td><td></td><td>Porous Car Park</td></tr><tr><td>E2.001</td><td>1.015</td><td>0.100</td><td>10.2</td><td>0.000</td><td>0.00</td><td>0.0</td><td>0.600</td><td></td><td>o</td><td>100</td><td>Pipe/Conduit</td></tr><tr><td>E3.000</td><td>13.971</td><td>0.115</td><td>121.5</td><td>0.017</td><td>5.00</td><td>0.0</td><td></td><td>0.075</td><td>→ ↓ →</td><td></td><td>Porous Car Park</td></tr><tr><td>E3.001</td><td>0.933</td><td>0.100</td><td>9.3</td><td>0.000</td><td>0.00</td><td>0.0</td><td>0.600</td><td></td><td>o</td><td>100</td><td>Pipe/Conduit</td></tr><tr><td>E4.000</td><td>14.218</td><td>0.240</td><td>59.2</td><td>0.013</td><td>5.00</td><td>0.0</td><td></td><td>0.075</td><td>→ ↓ →</td><td></td><td>Porous Car Park</td></tr></table> <u>Network Results Table</u> <table><tr><th>PN</th><th>US/IL (m)</th><th>Σ I.Area (ha)</th><th>Σ Base Flow (l/s)</th><th>Vel (m/s)</th><th>Cap (l/s)</th></tr><tr><td>E1.000</td><td>6.940</td><td>0.012</td><td>0.0</td><td>0.22</td><td>157.9</td></tr><tr><td>E1.001</td><td>6.800</td><td>0.012</td><td>0.0</td><td>2.25</td><td>17.7</td></tr><tr><td>E2.000</td><td>6.818</td><td>0.015</td><td>0.0</td><td>0.23</td><td>245.0</td></tr><tr><td>E2.001</td><td>6.665</td><td>0.015</td><td>0.0</td><td>2.44</td><td>19.2</td></tr><tr><td>E3.000</td><td>6.665</td><td>0.017</td><td>0.0</td><td>0.20</td><td>213.3</td></tr><tr><td>E3.001</td><td>6.550</td><td>0.017</td><td>0.0</td><td>2.55</td><td>20.0</td></tr><tr><td>E4.000</td><td>6.550</td><td>0.013</td><td>0.0</td><td>0.29</td><td>204.3</td></tr></table>												PN	Length (m)	Fall (m)	Slope (1:X)	I.Area (ha)	T.E. (mins)	Base Flow (l/s)	k (mm)	n	HYD SECT	DIA (mm)	Section Type	E1.000	13.878	0.140	99.1	0.012	5.00	0.0		0.075	→ ↓ →		Porous Car Park	E1.001	1.190	0.100	11.9	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit	E2.000	14.088	0.153	92.1	0.015	5.00	0.0		0.075	→ ↓ →		Porous Car Park	E2.001	1.015	0.100	10.2	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit	E3.000	13.971	0.115	121.5	0.017	5.00	0.0		0.075	→ ↓ →		Porous Car Park	E3.001	0.933	0.100	9.3	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit	E4.000	14.218	0.240	59.2	0.013	5.00	0.0		0.075	→ ↓ →		Porous Car Park	PN	US/IL (m)	Σ I.Area (ha)	Σ Base Flow (l/s)	Vel (m/s)	Cap (l/s)	E1.000	6.940	0.012	0.0	0.22	157.9	E1.001	6.800	0.012	0.0	2.25	17.7	E2.000	6.818	0.015	0.0	0.23	245.0	E2.001	6.665	0.015	0.0	2.44	19.2	E3.000	6.665	0.017	0.0	0.20	213.3	E3.001	6.550	0.017	0.0	2.55	20.0	E4.000	6.550	0.013	0.0	0.29	204.3
PN	Length (m)	Fall (m)	Slope (1:X)	I.Area (ha)	T.E. (mins)	Base Flow (l/s)	k (mm)	n	HYD SECT	DIA (mm)	Section Type																																																																																																																																																
E1.000	13.878	0.140	99.1	0.012	5.00	0.0		0.075	→ ↓ →		Porous Car Park																																																																																																																																																
E1.001	1.190	0.100	11.9	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit																																																																																																																																																
E2.000	14.088	0.153	92.1	0.015	5.00	0.0		0.075	→ ↓ →		Porous Car Park																																																																																																																																																
E2.001	1.015	0.100	10.2	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit																																																																																																																																																
E3.000	13.971	0.115	121.5	0.017	5.00	0.0		0.075	→ ↓ →		Porous Car Park																																																																																																																																																
E3.001	0.933	0.100	9.3	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit																																																																																																																																																
E4.000	14.218	0.240	59.2	0.013	5.00	0.0		0.075	→ ↓ →		Porous Car Park																																																																																																																																																
PN	US/IL (m)	Σ I.Area (ha)	Σ Base Flow (l/s)	Vel (m/s)	Cap (l/s)																																																																																																																																																						
E1.000	6.940	0.012	0.0	0.22	157.9																																																																																																																																																						
E1.001	6.800	0.012	0.0	2.25	17.7																																																																																																																																																						
E2.000	6.818	0.015	0.0	0.23	245.0																																																																																																																																																						
E2.001	6.665	0.015	0.0	2.44	19.2																																																																																																																																																						
E3.000	6.665	0.017	0.0	0.20	213.3																																																																																																																																																						
E3.001	6.550	0.017	0.0	2.55	20.0																																																																																																																																																						
E4.000	6.550	0.013	0.0	0.29	204.3																																																																																																																																																						
©1982-2020 Innovyze																																																																																																																																																											

Odyssey											Page 4																																					
Tuscany House White Hart Lane Basingstoke RG21 4AF						Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100																																										
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX						Designed by WindesPC5 Checked by																																										
Innovyze						Network 2020.1.3																																										
<u>Existing Network Details for Existing</u> <table><thead><tr><th>PN</th><th>Length (m)</th><th>Fall (m)</th><th>Slope (1:X)</th><th>I.Area (ha)</th><th>T.E. (mins)</th><th>Base Flow (l/s)</th><th>k (mm)</th><th>n</th><th>HYD SECT</th><th>DIA (mm)</th><th>Section Type</th></tr></thead><tbody><tr><td>E4.001</td><td>0.938</td><td>0.100</td><td>9.4</td><td>0.000</td><td>0.00</td><td>0.0</td><td>0.600</td><td></td><td>o</td><td>100</td><td>Pipe/Conduit</td></tr></tbody></table> <u>Network Results Table</u> <table><thead><tr><th>PN</th><th>US/IL (m)</th><th>Σ I.Area (ha)</th><th>Σ Base Flow (l/s)</th><th>Vel (m/s)</th><th>Cap (l/s)</th></tr></thead><tbody><tr><td>E4.001</td><td>6.310</td><td>0.013</td><td>0.0</td><td>2.54</td><td>19.9</td></tr></tbody></table>													PN	Length (m)	Fall (m)	Slope (1:X)	I.Area (ha)	T.E. (mins)	Base Flow (l/s)	k (mm)	n	HYD SECT	DIA (mm)	Section Type	E4.001	0.938	0.100	9.4	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit	PN	US/IL (m)	Σ I.Area (ha)	Σ Base Flow (l/s)	Vel (m/s)	Cap (l/s)	E4.001	6.310	0.013	0.0	2.54	19.9
PN	Length (m)	Fall (m)	Slope (1:X)	I.Area (ha)	T.E. (mins)	Base Flow (l/s)	k (mm)	n	HYD SECT	DIA (mm)	Section Type																																					
E4.001	0.938	0.100	9.4	0.000	0.00	0.0	0.600		o	100	Pipe/Conduit																																					
PN	US/IL (m)	Σ I.Area (ha)	Σ Base Flow (l/s)	Vel (m/s)	Cap (l/s)																																											
E4.001	6.310	0.013	0.0	2.54	19.9																																											
©1982-2020 Innovyze																																																

Odyssey										Page 5	
Tuscany House White Hart Lane Basingstoke RG21 4AF					Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100						
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX					Designed by WindesPC5 Checked by						
Innovyze					Network 2020.1.3						
<u>Manhole Schedules for Existing</u>											
MH Name	MH CL (m)	MH Depth (m)	MH Connection	MH Diam., L*W (mm)	PN	Pipe Out Invert Level (m)	Diameter (mm)	PN	Pipes In Invert Level (m)	Diameter (mm)	Backdrop (mm)
EDam 8	7.435	0.495	Open Manhole	250	E1.000	6.940					
E2	7.310	0.510	Open Manhole	250	E1.001	6.800	100	E1.000	6.800		
E	7.310	0.610	Open Manhole	0		OUTFALL		E1.001	6.700	100	
EDam 9	7.310	0.492	Open Manhole	250	E2.000	6.818					
E4	7.157	0.492	Open Manhole	250	E2.001	6.665	100	E2.000	6.665		
E	7.157	0.592	Open Manhole	0		OUTFALL		E2.001	6.565	100	
EDam 10	7.157	0.492	Open Manhole	250	E3.000	6.665					
E6	7.045	0.495	Open Manhole	250	E3.001	6.550	100	E3.000	6.550		
E	7.045	0.595	Open Manhole	0		OUTFALL		E3.001	6.450	100	
EDam 11	7.045	0.495	Open Manhole	250	E4.000	6.550					
EDam 12	6.828	0.518	Open Manhole	250	E4.001	6.310	100	E4.000	6.310		
E	6.828	0.618	Open Manhole	0		OUTFALL		E4.001	6.210	100	
MH Name	Manhole Easting (m)	Manhole Northing (m)	Intersection Easting (m)	Intersection Northing (m)	Manhole Access	Layout (North)					
EDam 8	497796.296	103761.183	497796.296	103761.183	Required						
©1982-2020 Innovyze											

Odyssey					Page 6																																																																
Tuscany House White Hart Lane Basingstoke RG21 4AF			Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100																																																																		
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX			Designed by WindesPC5 Checked by																																																																		
Innovyze			Network 2020.1.3																																																																		
<u>Manhole Schedules for Existing</u> <table><tr><th>MH Name</th><th>Manhole Easting (m)</th><th>Manhole Northing (m)</th><th>Intersection Easting (m)</th><th>Intersection Northing (m)</th><th>Manhole Access</th><th>Layout (North)</th></tr><tr><td>E2</td><td>497783.808</td><td>103767.237</td><td>497783.808</td><td>103767.237</td><td>Required</td><td></td></tr><tr><td>E</td><td>497783.463</td><td>103768.376</td><td></td><td></td><td>No Entry</td><td></td></tr><tr><td>EDam 9</td><td>497783.731</td><td>103767.045</td><td>497783.731</td><td>103767.045</td><td>Required</td><td></td></tr><tr><td>E4</td><td>497771.547</td><td>103774.117</td><td>497771.547</td><td>103774.117</td><td>Required</td><td></td></tr><tr><td>E</td><td>497771.391</td><td>103775.120</td><td></td><td></td><td>No Entry</td><td></td></tr><tr><td>EDam 10</td><td>497771.467</td><td>103773.979</td><td>497771.467</td><td>103773.979</td><td>Required</td><td></td></tr><tr><td>E6</td><td>497759.430</td><td>103781.071</td><td>497759.430</td><td>103781.071</td><td>Required</td><td></td></tr><tr><td>E</td><td>497759.304</td><td>103781.996</td><td></td><td></td><td>No Entry</td><td></td></tr></table>							MH Name	Manhole Easting (m)	Manhole Northing (m)	Intersection Easting (m)	Intersection Northing (m)	Manhole Access	Layout (North)	E2	497783.808	103767.237	497783.808	103767.237	Required		E	497783.463	103768.376			No Entry		EDam 9	497783.731	103767.045	497783.731	103767.045	Required		E4	497771.547	103774.117	497771.547	103774.117	Required		E	497771.391	103775.120			No Entry		EDam 10	497771.467	103773.979	497771.467	103773.979	Required		E6	497759.430	103781.071	497759.430	103781.071	Required		E	497759.304	103781.996			No Entry	
MH Name	Manhole Easting (m)	Manhole Northing (m)	Intersection Easting (m)	Intersection Northing (m)	Manhole Access	Layout (North)																																																															
E2	497783.808	103767.237	497783.808	103767.237	Required																																																																
E	497783.463	103768.376			No Entry																																																																
EDam 9	497783.731	103767.045	497783.731	103767.045	Required																																																																
E4	497771.547	103774.117	497771.547	103774.117	Required																																																																
E	497771.391	103775.120			No Entry																																																																
EDam 10	497771.467	103773.979	497771.467	103773.979	Required																																																																
E6	497759.430	103781.071	497759.430	103781.071	Required																																																																
E	497759.304	103781.996			No Entry																																																																
©1982-2020 Innovyze																																																																					

Odyssey					Page 7	
Tuscany House White Hart Lane Basingstoke RG21 4AF			Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100			
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX			Designed by WindesPC5 Checked by			
Innovyze			Network 2020.1.3			
<u>Manhole Schedules for Existing</u>						
MH Name	Manhole Easting (m)	Manhole Northing (m)	Intersection Easting (m)	Intersection Northing (m)	Manhole Access	Layout (North)
EDam 11	497759.349	103780.938	497759.349	103780.938	Required	
EDam 12	497747.126	103788.201	497747.126	103788.201	Required	
E	497746.895	103789.111			No Entry	

Odyssey				Page 8																																																																																																												
Tuscany House White Hart Lane Basingstoke RG21 4AF				Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100																																																																																																												
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX				Designed by WindesPC5 Checked by																																																																																																												
Innovyze				Network 2020.1.3																																																																																																												
<u>Area Summary for Existing</u> <table><tr><th>Pipe Number</th><th>PIMP Type</th><th>PIMP Name</th><th>PIMP (%)</th><th>Gross Area (ha)</th><th>Imp. Area (ha)</th><th>Pipe Total (ha)</th></tr><tr><td>1.000</td><td>User</td><td>-</td><td>100</td><td>0.012</td><td>0.012</td><td>0.012</td></tr><tr><td>1.001</td><td>-</td><td>-</td><td>100</td><td>0.000</td><td>0.000</td><td>0.000</td></tr><tr><td>2.000</td><td>User</td><td>-</td><td>100</td><td>0.015</td><td>0.015</td><td>0.015</td></tr><tr><td>2.001</td><td>-</td><td>-</td><td>100</td><td>0.000</td><td>0.000</td><td>0.000</td></tr><tr><td>3.000</td><td>User</td><td>-</td><td>100</td><td>0.017</td><td>0.017</td><td>0.017</td></tr><tr><td>3.001</td><td>-</td><td>-</td><td>100</td><td>0.000</td><td>0.000</td><td>0.000</td></tr><tr><td>4.000</td><td>User</td><td>-</td><td>100</td><td>0.013</td><td>0.013</td><td>0.013</td></tr><tr><td>4.001</td><td>-</td><td>-</td><td>100</td><td>0.000</td><td>0.000</td><td>0.000</td></tr><tr><td colspan="4"></td><td>Total</td><td>Total</td><td>Total</td></tr><tr><td colspan="4"></td><td>0.058</td><td>0.058</td><td>0.058</td></tr></table> <u>Free Flowing Outfall Details for Existing</u> <table><tr><th>Outfall Pipe Number</th><th>Outfall Name</th><th>C. Level (m)</th><th>I. Level (m)</th><th>Min I. Level (m)</th><th>D,L (mm)</th><th>W (mm)</th></tr><tr><td>E1.001</td><td>E</td><td>7.310</td><td>6.700</td><td>0.000</td><td>0</td><td>0</td></tr></table> <u>Free Flowing Outfall Details for Existing</u> <table><tr><th>Outfall Pipe Number</th><th>Outfall Name</th><th>C. Level (m)</th><th>I. Level (m)</th><th>Min I. Level (m)</th><th>D,L (mm)</th><th>W (mm)</th></tr><tr><td>E2.001</td><td>E</td><td>7.157</td><td>6.565</td><td>0.000</td><td>0</td><td>0</td></tr></table>								Pipe Number	PIMP Type	PIMP Name	PIMP (%)	Gross Area (ha)	Imp. Area (ha)	Pipe Total (ha)	1.000	User	-	100	0.012	0.012	0.012	1.001	-	-	100	0.000	0.000	0.000	2.000	User	-	100	0.015	0.015	0.015	2.001	-	-	100	0.000	0.000	0.000	3.000	User	-	100	0.017	0.017	0.017	3.001	-	-	100	0.000	0.000	0.000	4.000	User	-	100	0.013	0.013	0.013	4.001	-	-	100	0.000	0.000	0.000					Total	Total	Total					0.058	0.058	0.058	Outfall Pipe Number	Outfall Name	C. Level (m)	I. Level (m)	Min I. Level (m)	D,L (mm)	W (mm)	E1.001	E	7.310	6.700	0.000	0	0	Outfall Pipe Number	Outfall Name	C. Level (m)	I. Level (m)	Min I. Level (m)	D,L (mm)	W (mm)	E2.001	E	7.157	6.565	0.000	0	0
Pipe Number	PIMP Type	PIMP Name	PIMP (%)	Gross Area (ha)	Imp. Area (ha)	Pipe Total (ha)																																																																																																										
1.000	User	-	100	0.012	0.012	0.012																																																																																																										
1.001	-	-	100	0.000	0.000	0.000																																																																																																										
2.000	User	-	100	0.015	0.015	0.015																																																																																																										
2.001	-	-	100	0.000	0.000	0.000																																																																																																										
3.000	User	-	100	0.017	0.017	0.017																																																																																																										
3.001	-	-	100	0.000	0.000	0.000																																																																																																										
4.000	User	-	100	0.013	0.013	0.013																																																																																																										
4.001	-	-	100	0.000	0.000	0.000																																																																																																										
				Total	Total	Total																																																																																																										
				0.058	0.058	0.058																																																																																																										
Outfall Pipe Number	Outfall Name	C. Level (m)	I. Level (m)	Min I. Level (m)	D,L (mm)	W (mm)																																																																																																										
E1.001	E	7.310	6.700	0.000	0	0																																																																																																										
Outfall Pipe Number	Outfall Name	C. Level (m)	I. Level (m)	Min I. Level (m)	D,L (mm)	W (mm)																																																																																																										
E2.001	E	7.157	6.565	0.000	0	0																																																																																																										
©1982-2020 Innovyze																																																																																																																

Odyssey		Page 9
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100	
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by	
Innovyze	Network 2020.1.3	

Free Flowing Outfall Details for Existing

Outfall Pipe Number	Outfall Name	C. Level (m)	I. Level (m)	Min I. Level (m)	D,L (mm)	W (mm)
E3.001	E	7.045	6.450	0.000	0	0

Free Flowing Outfall Details for Existing

Outfall Pipe Number	Outfall Name	C. Level (m)	I. Level (m)	Min I. Level (m)	D,L (mm)	W (mm)
E4.001	E	6.828	6.210	0.000	0	0

©1982-2020 Innovyze

Odyssey		Page 10
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100	
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by	
Innovyze	Network 2020.1.3	
<u>Online Controls for Existing</u> <u>Pump Manhole: E2, DS/PN: E1.001, Volume (m³): 9.7</u> Invert Level (m) 6.800 <u>Pump Manhole: E4, DS/PN: E2.001, Volume (m³): 14.5</u> Invert Level (m) 6.665 <u>Pump Manhole: E6, DS/PN: E3.001, Volume (m³): 14.4</u> Invert Level (m) 6.550 <u>Pump Manhole: EDam 12, DS/PN: E4.001, Volume (m³): 10.0</u> Invert Level (m) 6.310		
©1982-2020 Innovyze		

Odyssey		Page 11
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100	
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by	
Innovyze	Network 2020.1.3	
<u>Offline Controls for Existing</u> <u>Weir Manhole: E2, DS/PN: E1.001, Loop to PN: E2.000</u> Discharge Coef 0.544 Width (m) 4.800 Invert Level (m) 7.310 <u>Weir Manhole: E4, DS/PN: E2.001, Loop to PN: E3.000</u> Discharge Coef 0.544 Width (m) 4.800 Invert Level (m) 7.157 <u>Weir Manhole: E6, DS/PN: E3.001, Loop to PN: E4.000</u> Discharge Coef 0.544 Width (m) 4.800 Invert Level (m) 7.045		
©1982-2020 Innovyze		

Odyssey		Page 12																																																																																										
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100																																																																																											
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by																																																																																											
Innovyze	Network 2020.1.3																																																																																											
<u>Storage Structures for Existing</u> <u>Porous Car Park Pipe: E1.000</u> <table> <tr> <td>Manning's N</td> <td>0.075</td> <td>Porosity</td> <td>0.30</td> <td>Depression Storage (mm)</td> <td>5</td> </tr> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00648</td> <td>Invert Level (m)</td> <td>6.940</td> <td>Evaporation (mm/day)</td> <td>3</td> </tr> <tr> <td>Membrane Percolation (mm/hr)</td> <td>1000</td> <td>Width (m)</td> <td>4.8</td> <td>Membrane Depth (mm)</td> <td>0</td> </tr> <tr> <td>Max Percolation (l/s)</td> <td>18.5</td> <td>Length (m)</td> <td>13.9</td> <td></td> <td></td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>99.1</td> <td></td> <td></td> </tr> </table> <u>Porous Car Park Pipe: E2.000</u> <table> <tr> <td>Manning's N</td> <td>0.075</td> <td>Porosity</td> <td>0.30</td> <td>Depression Storage (mm)</td> <td>5</td> </tr> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00648</td> <td>Invert Level (m)</td> <td>6.818</td> <td>Evaporation (mm/day)</td> <td>3</td> </tr> <tr> <td>Membrane Percolation (mm/hr)</td> <td>1000</td> <td>Width (m)</td> <td>7.1</td> <td>Membrane Depth (mm)</td> <td>0</td> </tr> <tr> <td>Max Percolation (l/s)</td> <td>27.8</td> <td>Length (m)</td> <td>14.1</td> <td></td> <td></td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>92.1</td> <td></td> <td></td> </tr> </table> <u>Porous Car Park Pipe: E3.000</u> <table> <tr> <td>Manning's N</td> <td>0.075</td> <td>Porosity</td> <td>0.30</td> <td>Depression Storage (mm)</td> <td>5</td> </tr> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00648</td> <td>Invert Level (m)</td> <td>6.665</td> <td>Evaporation (mm/day)</td> <td>3</td> </tr> <tr> <td>Membrane Percolation (mm/hr)</td> <td>1000</td> <td>Width (m)</td> <td>7.1</td> <td>Membrane Depth (mm)</td> <td>0</td> </tr> <tr> <td>Max Percolation (l/s)</td> <td>27.6</td> <td>Length (m)</td> <td>14.0</td> <td></td> <td></td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>121.5</td> <td></td> <td></td> </tr> </table>			Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5	Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.940	Evaporation (mm/day)	3	Membrane Percolation (mm/hr)	1000	Width (m)	4.8	Membrane Depth (mm)	0	Max Percolation (l/s)	18.5	Length (m)	13.9			Safety Factor	2.0	Slope (1:X)	99.1			Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5	Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.818	Evaporation (mm/day)	3	Membrane Percolation (mm/hr)	1000	Width (m)	7.1	Membrane Depth (mm)	0	Max Percolation (l/s)	27.8	Length (m)	14.1			Safety Factor	2.0	Slope (1:X)	92.1			Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5	Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.665	Evaporation (mm/day)	3	Membrane Percolation (mm/hr)	1000	Width (m)	7.1	Membrane Depth (mm)	0	Max Percolation (l/s)	27.6	Length (m)	14.0			Safety Factor	2.0	Slope (1:X)	121.5		
Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5																																																																																							
Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.940	Evaporation (mm/day)	3																																																																																							
Membrane Percolation (mm/hr)	1000	Width (m)	4.8	Membrane Depth (mm)	0																																																																																							
Max Percolation (l/s)	18.5	Length (m)	13.9																																																																																									
Safety Factor	2.0	Slope (1:X)	99.1																																																																																									
Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5																																																																																							
Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.818	Evaporation (mm/day)	3																																																																																							
Membrane Percolation (mm/hr)	1000	Width (m)	7.1	Membrane Depth (mm)	0																																																																																							
Max Percolation (l/s)	27.8	Length (m)	14.1																																																																																									
Safety Factor	2.0	Slope (1:X)	92.1																																																																																									
Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5																																																																																							
Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.665	Evaporation (mm/day)	3																																																																																							
Membrane Percolation (mm/hr)	1000	Width (m)	7.1	Membrane Depth (mm)	0																																																																																							
Max Percolation (l/s)	27.6	Length (m)	14.0																																																																																									
Safety Factor	2.0	Slope (1:X)	121.5																																																																																									
©1982-2020 Innovyze																																																																																												

Odyssey		Page 13																														
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100																															
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by																															
Innovyze	Network 2020.1.3																															
<u>Porous Car Park Pipe: E4.000</u> <table> <tr> <td>Manning's N</td> <td>0.075</td> <td>Porosity</td> <td>0.30</td> <td>Depression Storage (mm)</td> <td>5</td> </tr> <tr> <td>Infiltration Coefficient Base (m/hr)</td> <td>0.00648</td> <td>Invert Level (m)</td> <td>6.550</td> <td>Evaporation (mm/day)</td> <td>3</td> </tr> <tr> <td>Membrane Percolation (mm/hr)</td> <td>1000</td> <td>Width (m)</td> <td>4.8</td> <td>Membrane Depth (mm)</td> <td>0</td> </tr> <tr> <td>Max Percolation (l/s)</td> <td>19.0</td> <td>Length (m)</td> <td>14.2</td> <td></td> <td></td> </tr> <tr> <td>Safety Factor</td> <td>2.0</td> <td>Slope (1:X)</td> <td>59.2</td> <td></td> <td></td> </tr> </table>			Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5	Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.550	Evaporation (mm/day)	3	Membrane Percolation (mm/hr)	1000	Width (m)	4.8	Membrane Depth (mm)	0	Max Percolation (l/s)	19.0	Length (m)	14.2			Safety Factor	2.0	Slope (1:X)	59.2		
Manning's N	0.075	Porosity	0.30	Depression Storage (mm)	5																											
Infiltration Coefficient Base (m/hr)	0.00648	Invert Level (m)	6.550	Evaporation (mm/day)	3																											
Membrane Percolation (mm/hr)	1000	Width (m)	4.8	Membrane Depth (mm)	0																											
Max Percolation (l/s)	19.0	Length (m)	14.2																													
Safety Factor	2.0	Slope (1:X)	59.2																													
©1982-2020 Innovyze																																

Odyssey		Page 14
Tuscany House White Hart Lane Basingstoke RG21 4AF	Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100	
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX	Designed by WindesPC5 Checked by	
Innovyze	Network 2020.1.3	

100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Existing

Simulation Criteria

Areal Reduction Factor	1.000	Manhole Headloss Coeff (Global)	0.500	MADD Factor * 10m³/ha Storage	2.000
Hot Start (mins)	0	Foul Sewage per hectare (l/s)	0.000	Inlet Coefficient	0.800
Hot Start Level (mm)	0	Additional Flow - % of Total Flow	0.000	Flow per Person per Day (l/per/day)	0.000

Number of Input Hydrographs	0	Number of Offline Controls	3	Number of Time/Area Diagrams	0
Number of Online Controls	4	Number of Storage Structures	4	Number of Real Time Controls	0

Synthetic Rainfall Details

Rainfall Model	FEH	Data Type	Point
FEH Rainfall Version	2013	Cv (Summer)	0.750
Site Location	GB 497682 103581 SU 97682 03581	Cv (Winter)	0.840

Margin for Flood Risk Warning (mm)	300.0	DVD Status	OFF
Analysis Timestep	2.5 Second Increment (Extended)	Inertia Status	OFF
DTS Status	ON		

Profile(s)	Summer and Winter
Duration(s) (mins)	15, 30, 60, 120, 180, 240, 360, 480, 600, 720, 960, 1440, 2160, 2880, 4320, 5760, 7200, 8640, 10080
Return Period(s) (years)	100
Climate Change (%)	40

		Water Flooded			Maximum Pipe		
US/MH	US/CL	Level	Volume	Flow /	Maximum	Velocity	Flow
PN Name Event	(m)	(m)	(m³)	Cap. Vol (m³)	(m/s)	(l/s)	Status

©1982-2020 Innovyze

Odyssey										Page 15			
Tuscany House White Hart Lane Basingstoke RG21 4AF							Stakers Farm, Yapton - 19-156 As built - chainage 45 to 100						
Date 19/04/2022 13:09 File Road 1_dams 8 to 12.MDX							Designed by WindesPC5 Checked by						
Innovyze							Network 2020.1.3						
<u>100 year Return Period Summary of Critical Results by Maximum Level (Rank 1) for Existing</u>													
PN	US/MH Name	Event				US/CL (m)	Water Level (m)	Flooded Volume (m³)	Flow / Cap.	Maximum Vol (m³)	Maximum Velocity (m/s)	Pipe Flow (l/s)	Status
E1.000	EDam 8	600 minute	100 year	Winter	I+40%	7.435	7.298	0.000	0.00	0.017	0.0	0.4	FLOOD RISK
E1.001	E2	600 minute	100 year	Winter	I+40%	7.310	7.298	0.000	0.00	8.315	0.0	0.0	FLOOD RISK
E2.000	EDam 9	600 minute	100 year	Winter	I+40%	7.310	7.083	0.000	0.00	0.013	0.0	0.5	FLOOD RISK
E2.001	E4	600 minute	100 year	Winter	I+40%	7.157	7.084	0.000	0.00	9.951	0.0	0.0	FLOOD RISK
E3.000	EDam 10	600 minute	100 year	Winter	I+40%	7.157	7.004	0.000	0.00	0.016	0.0	0.5	FLOOD RISK
E3.001	E6	600 minute	100 year	Winter	I+40%	7.045	7.004	0.000	0.00	11.451	0.0	0.0	FLOOD RISK
E4.000	EDam 11	720 minute	100 year	Winter	I+40%	7.045	6.826	0.000	0.00	0.013	0.0	0.4	FLOOD RISK
E4.001	EDam 12	720 minute	100 year	Winter	I+40%	6.828	6.826	0.000	0.00	7.833	0.0	0.0	FLOOD RISK
©1982-2020 Innovyze													