

Technical Specification

Single socket outlet not exceeding 32A and not exceeding 250V A.C. single phase.


Cable to be capable of utilising a 7.4KWh supply not exceeding 32A.

Cable size to be to BS 7671.

Type D MCB to be installed in consumer unit (optional extra).


Sales Specification

Car charging unit can be fitted within an attached or detached garage or to the side wall of a house wih an adjacent driveway.

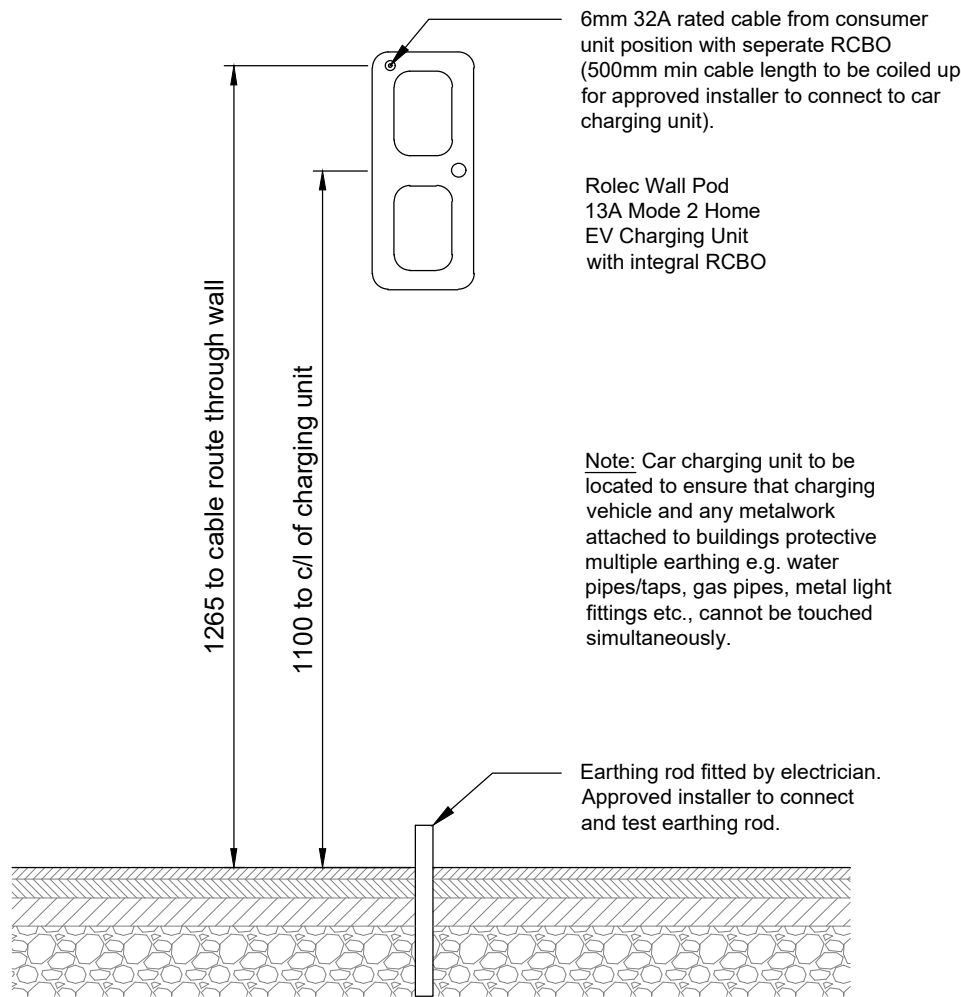


Elevation of Driveway Car Charging Unit


To be provided at 1100mm high to inside of front access points of all integral, attached and detached garages. 6mm 32A rated cable from consumer unit position with seperate RCBO (500mm min cable length to be coiled up for approved installer to connect to car charging unit).

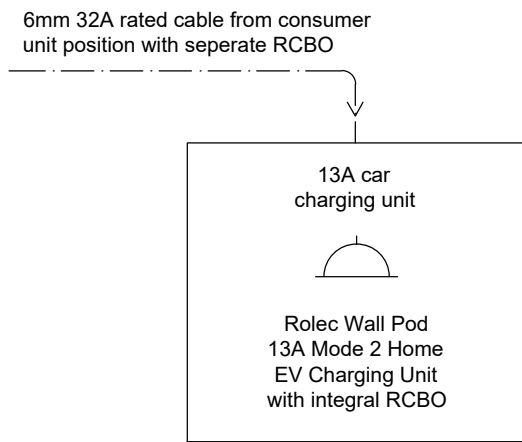

Attached Garage Car Charging Point

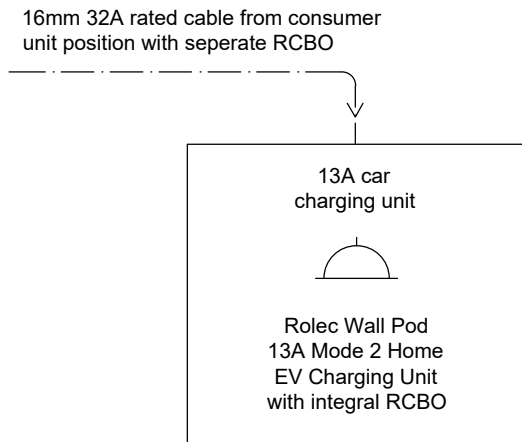

Detached Garage Car Charging Point

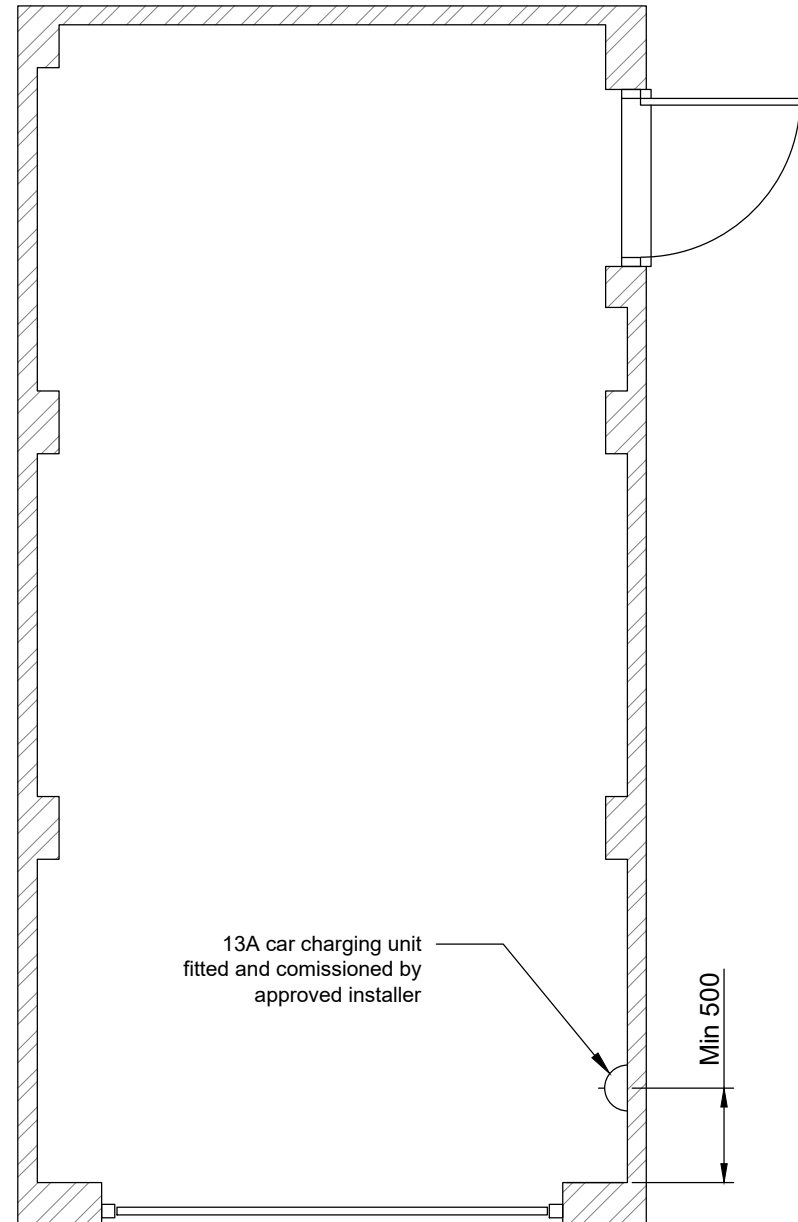

Indicative Floor Plan

 ARUN DISTRICT COUNCIL Y/72/20/RES Roman House, South Hampshire Industrial Park, Eddystone Road, Totton, SO40 3SA Tel: 02382 124061	Development	Status	Scale	Paper Size	Date	Drawn	Checked
	Land at Stakers Farm, Yapton	FOR INFORMATION	NTS	A3	28.07.20	MA	COB
	Drawing Title			Drwg. No.			Rev.
	EV Charging Point Details			YAP-EVD-01			A