


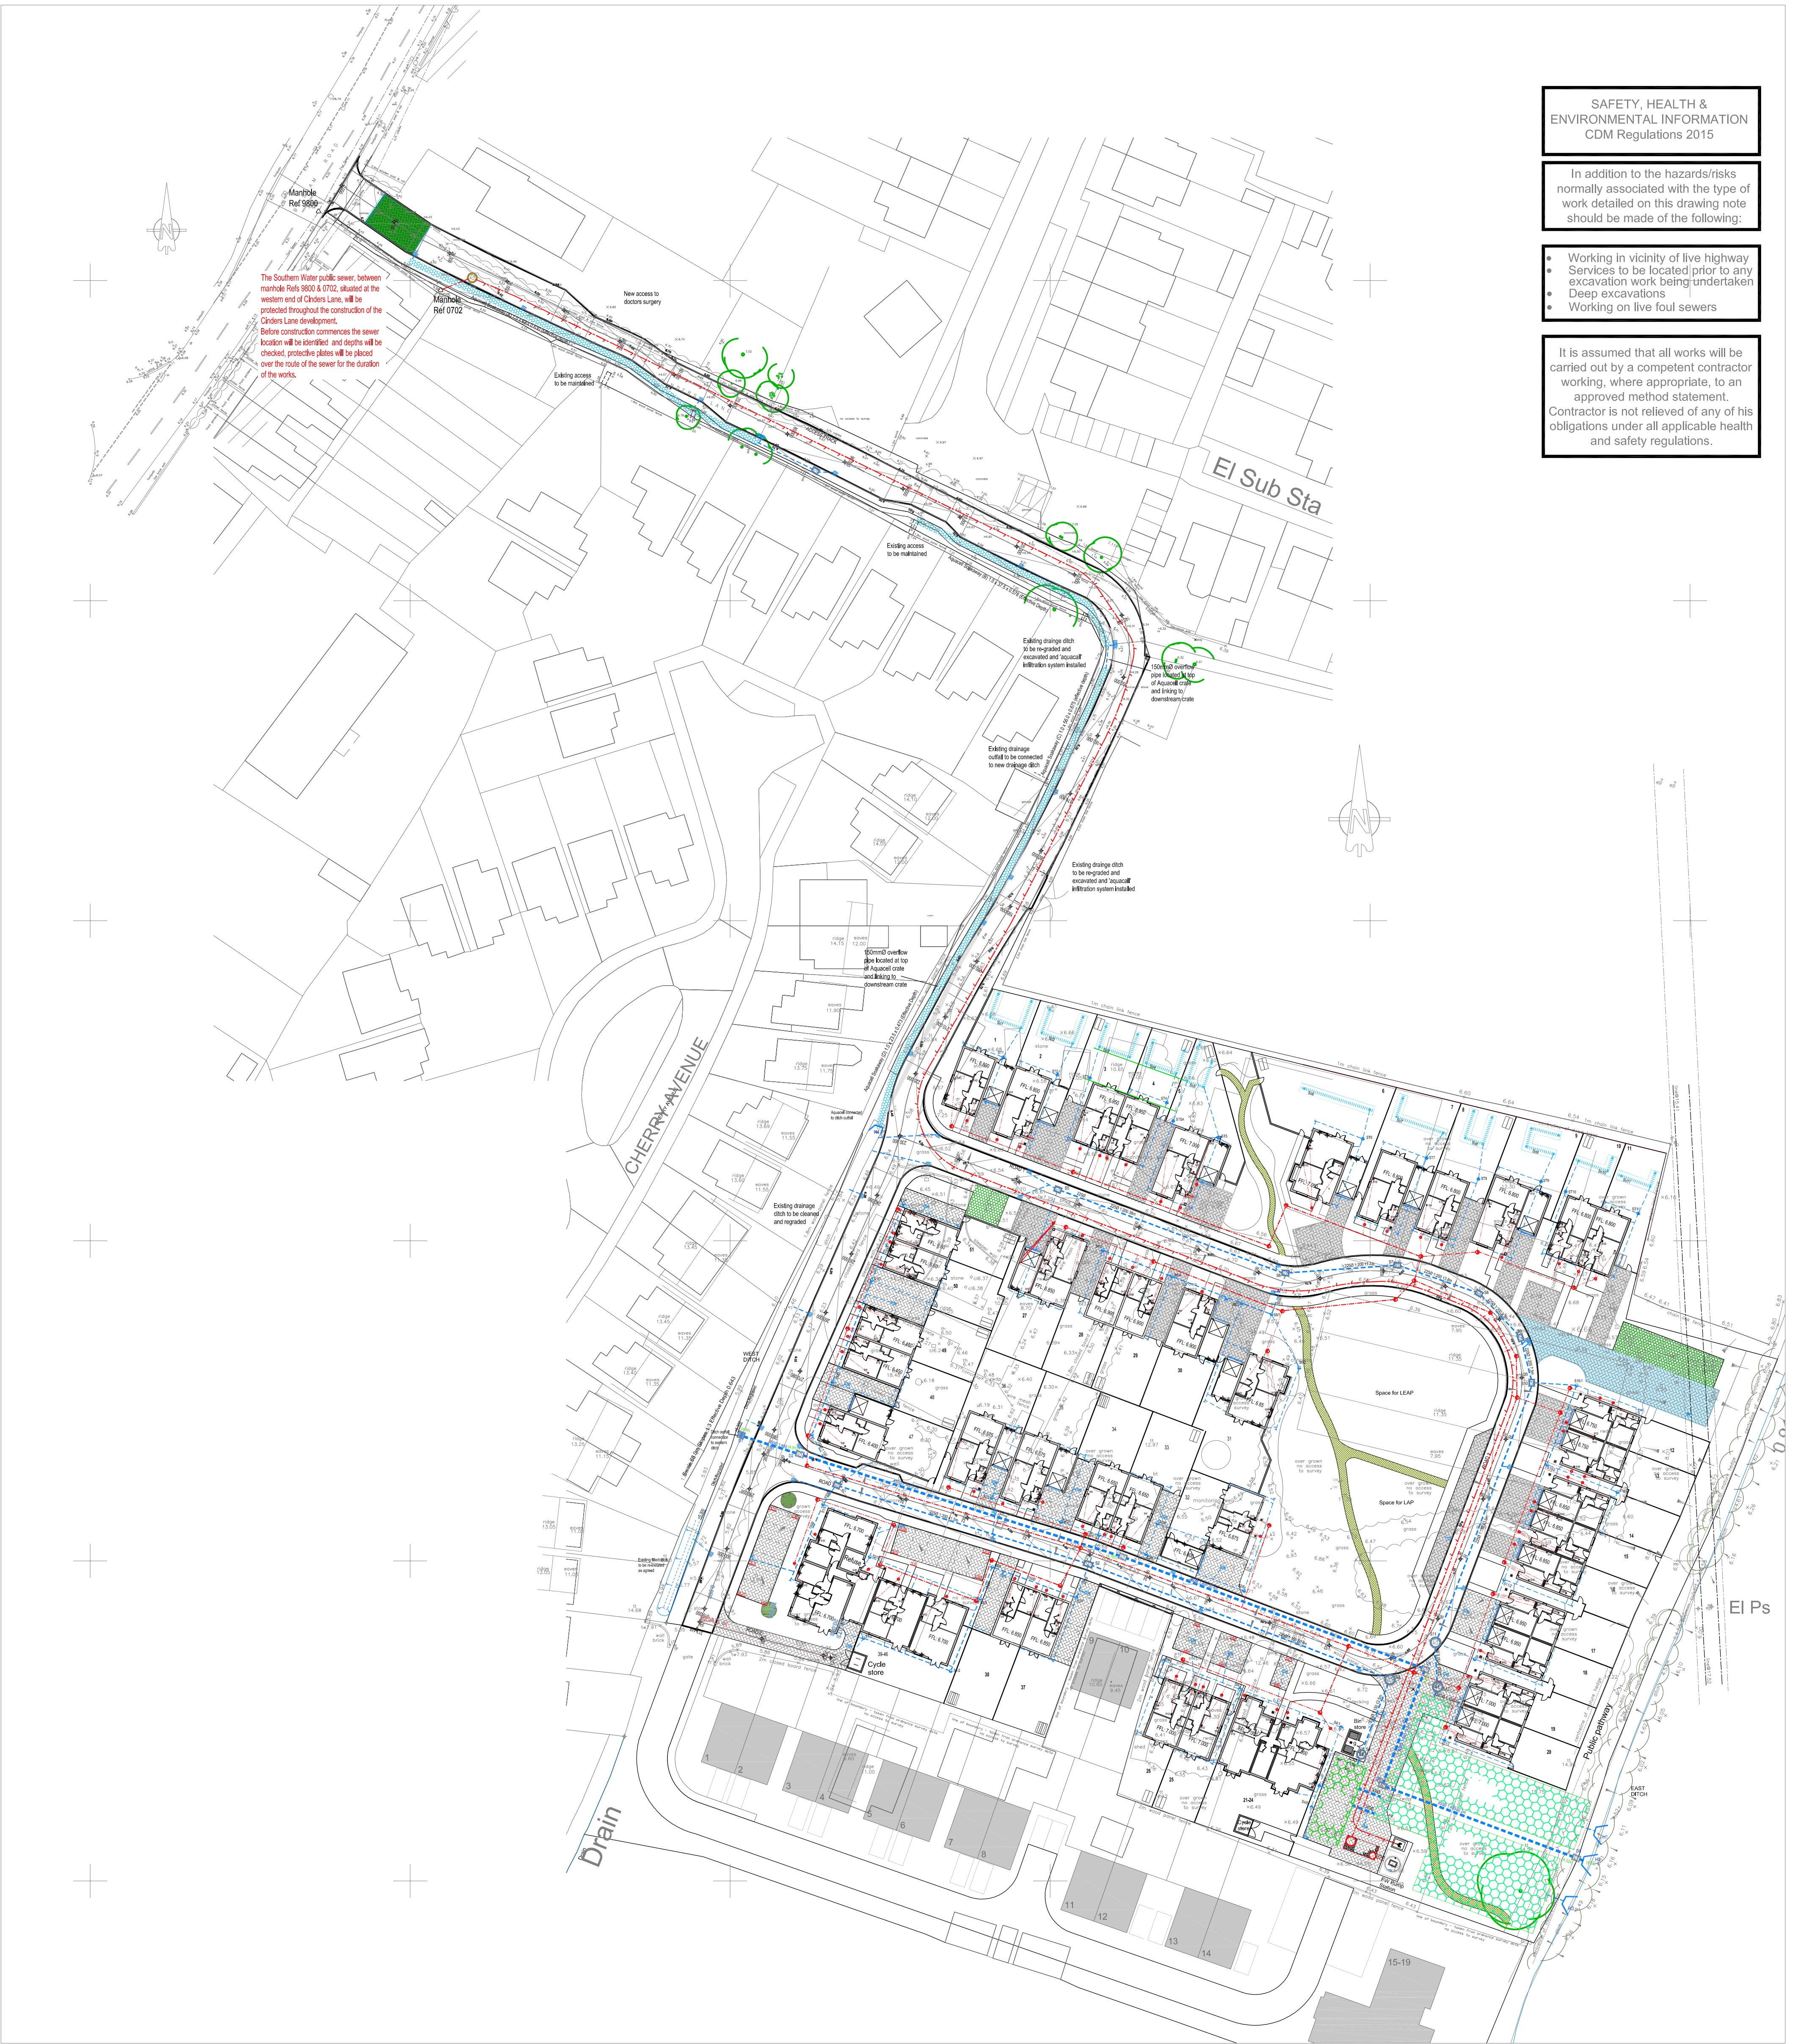

SAFETY, HEALTH & ENVIRONMENTAL INFORMATION
CDM Regulations 2015

In addition to the hazards/risks normally associated with the type of work detailed on this drawing note should be made of the following:

- Working in vicinity of live highway
- Services to be located prior to any excavation work being undertaken
- Deep excavations
- Working on live foul sewers

It is assumed that all works will be carried out by a competent contractor working, where appropriate, to an approved method statement. Contractor is not relieved of any of his obligations under all applicable health and safety regulations.

LEGEND:

Foul Water Drainage Legend:

- Existing foul water sewer (sited in Blisnam Road)
- Domestic foul water sewer and manholes
- Foul sewer rising main
- Foul water pumping station (not adopted)
- Type 2 - 1200mm Ø
- Type 3 - 450mm or 600mm Ø
- Type 4 Shallow PPIC inspection chamber - 250mm Ø. Invert 750mm lower than FFL unless noted otherwise
- Type 2 - 1200mm Ø
- Type 6 - 1050mm Ø salt trap manhole
- Type C 1240 x 675 (see schedule)
- Type D 900 x 675 (see schedule)

Surface Water Drainage Legend:

- Domestic surface water drain with rodding eye
- TYPE 3 - 450mm
- Type 5 - 450mm Silt Trap
- Unadopted highway gully
- Unadopted highway gully
- Aco drainage channel (installed at all garage entrances)
- Domestic trench soakaways. Sizing determined by in-situ infiltration testing. Soakaways designed in accordance with Environment Agency criteria for 1 in 100 years storm return +40% climate change and sited a minimum of 5.0m from new dwellings.
- Existing drainage ditch replaced with 'Aquaqual' Prime infiltration/swale system adjacent to Cinders Lane. Inspection access points at 25 metre intervals. 150 mm dia overflow at high level as indicated.
- 'Aquaqual' Core attenuation tank with air valve
- H1 Headwall discharge to ditch

Surfacing Legend:

- Block paved domestic drive
- Permeable block paved domestic drive Depth of sub base - 225mm
- Permeable block paved shared drive Depth of sub base - 320mm
- Permeable block paved access entrance Depth of sub base - 385mm
- Reinforced grass parking construction
- Unbound gravel footpath (TBA)

- Notes:
- All levels are to local Datum.
 - All Highway work's on or adjacent to existing public highway shall be executed in accordance with the Traffic Safety Code for Roadwork's and Chapter 8 of the Traffic Signs Manual.
 - At the commencement of works on site the contractor is to carry out trial pits and liaise with Utility Companies in order to establish the exact position of all existing statutory utility plant in the vicinity of works and take adequate precautions or their protection.
 - The Contractor is to comply fully with the CDM Regulations in the course of constructing the works.
 - Highways in the vicinity of the works must be kept free from mud, debris and dust falling from vehicles or the wheels of vehicles connected with the works.
 - All drain and sewer pipes to be laid soffit to soffit, unless shown otherwise.
 - Minimum gradient for 1000 SW is 1:100 and 1000 FW is 1:80 with one W/C connected otherwise 1:40. Bedding for domestic drainage Class B. All pipe runs near buildings to comply with the Building Regulations 2010 Part H1.
 - Position of soil pipes, standing wastes, wc outlets etc. are shown on the Architect's working drawings. Rainwater downpipe positions are to be checked against Architects details to ensure compatibility. Rainwater downpipes to have rodding access facilities where surface water drainage passes under buildings.
 - All concrete and concrete products to be in accordance with BRE 363 for sulphates.
 - All slab levels shown are for guidance only and may need to be adjusted on site, subject to approval by the engineer.
 - Do not scale from this drawing, work only from stated dimensions or setting out details.
 - Refer to tables for manhole schedules
 - Where paths falls towards the front door use suitable linear/slot drainage system connected to surface water system as per architects details.
 - All plots to have gardens sloping away from properties otherwise interceptor drains to be installed.
 - Surface water drainage connected to catchment manhole prior to discharge to soakaway
 - Soakaways to be minimum 5.0m from dwelling foundations and 2.0m from boundary wall foundations. Boundary walls within 2.0m of soakaways to have reinforced foundations. Prior to construction of soakaways trial holes to be dug to the invert of base to establish ground water level.
 - This drawing is to be read in conjunction with all relevant engineering drawings issued by Escher Silverman and Crayfern Homes for this site only.

A	08.11.19	First Issue	KN
Rev.	Date	Details	Initials

Drawing Status

FOR TENDER

Project

**CINDERS NURSERY
YAPTON**

Client

**Crayfern
HOMES**

**KAZYS NARBUTAS
CONSULTING**
Civil Engineering Consultant
Kington, A2 Omega Park, Elmwood Way, Chislehurst Ford. S015 4SE
Telephone: 023 8027 8643 Email: karys@knc.co.uk

Drawing Title

**Engineering Details
Drainage Layout**

Drawn	Checked	Scales	Paper Size	Date
KN		1:500	A1	11.19
Job No.	Drawing No.			Revision
ES1826	502-03			A